



R1

INSPECTION SIDE
INSPEKSJONSSIDE

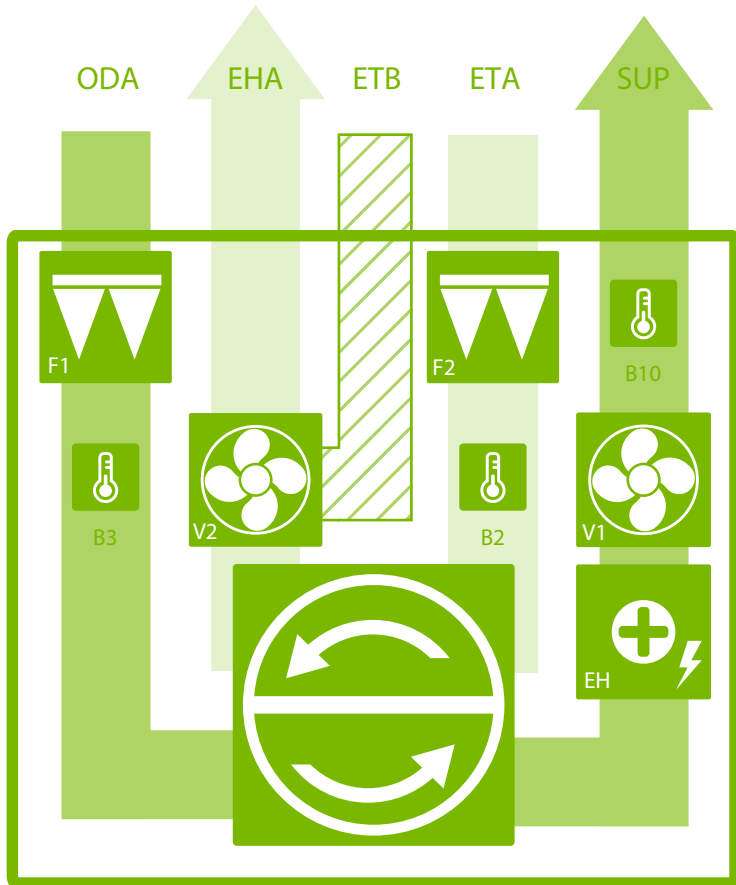

L1

INSPECTION SIDE
INSPEKSJONSSIDE

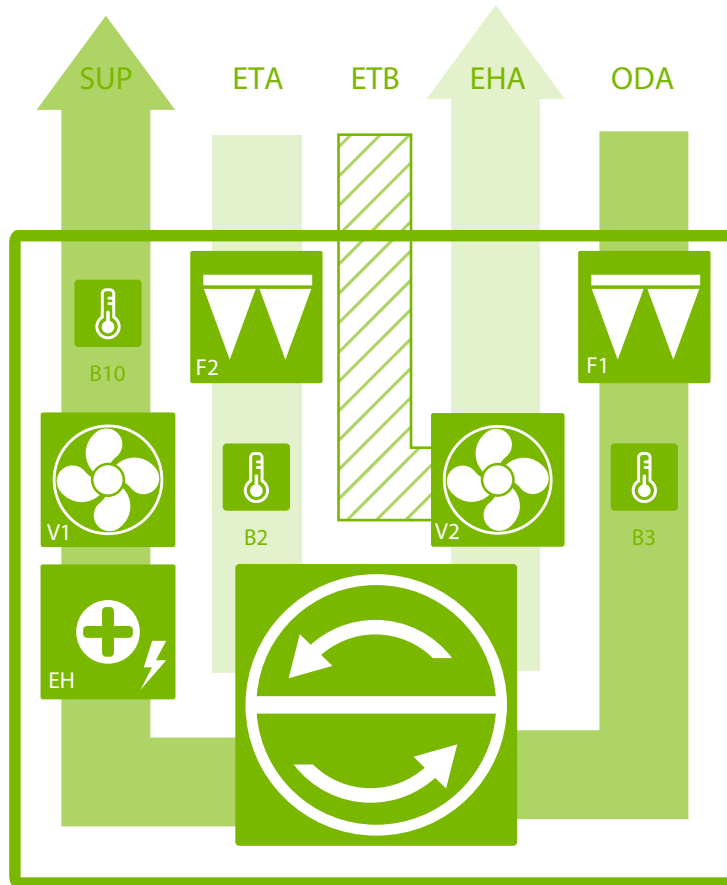

ODA Outdoor air / Inntak

SUP Supply air / Tilluft

ETA Extract air / Avtrekk

EHA Exhaust air / Avkast

ETB By-pass extraction without heat recovery /
Bypass uten gjenvinning



Rotary heatexchanger / Roterende
varmegjenvinner



Extract temperature sensor / Uttrekk temperatur
sensr

B2



Outdoor temperature sensor /
Utetemperaturføler

B3



Supply temperature sensor /
Tilluftstemperatursensor

B10



Supply air fan / Tilluftsvifte

V1



Extract air fan / Avtrekksvifte

V2



Electrical heater / Elektrisk varmebatteri

EH



Outdoor air filter / Friskluftsfiler

F1



Extract air filter / Avtrekks filter

F2