VEX1000 Wiring diagram

EXcon+ automatic
EXcon+ automatik
Système de règulation EXcon+

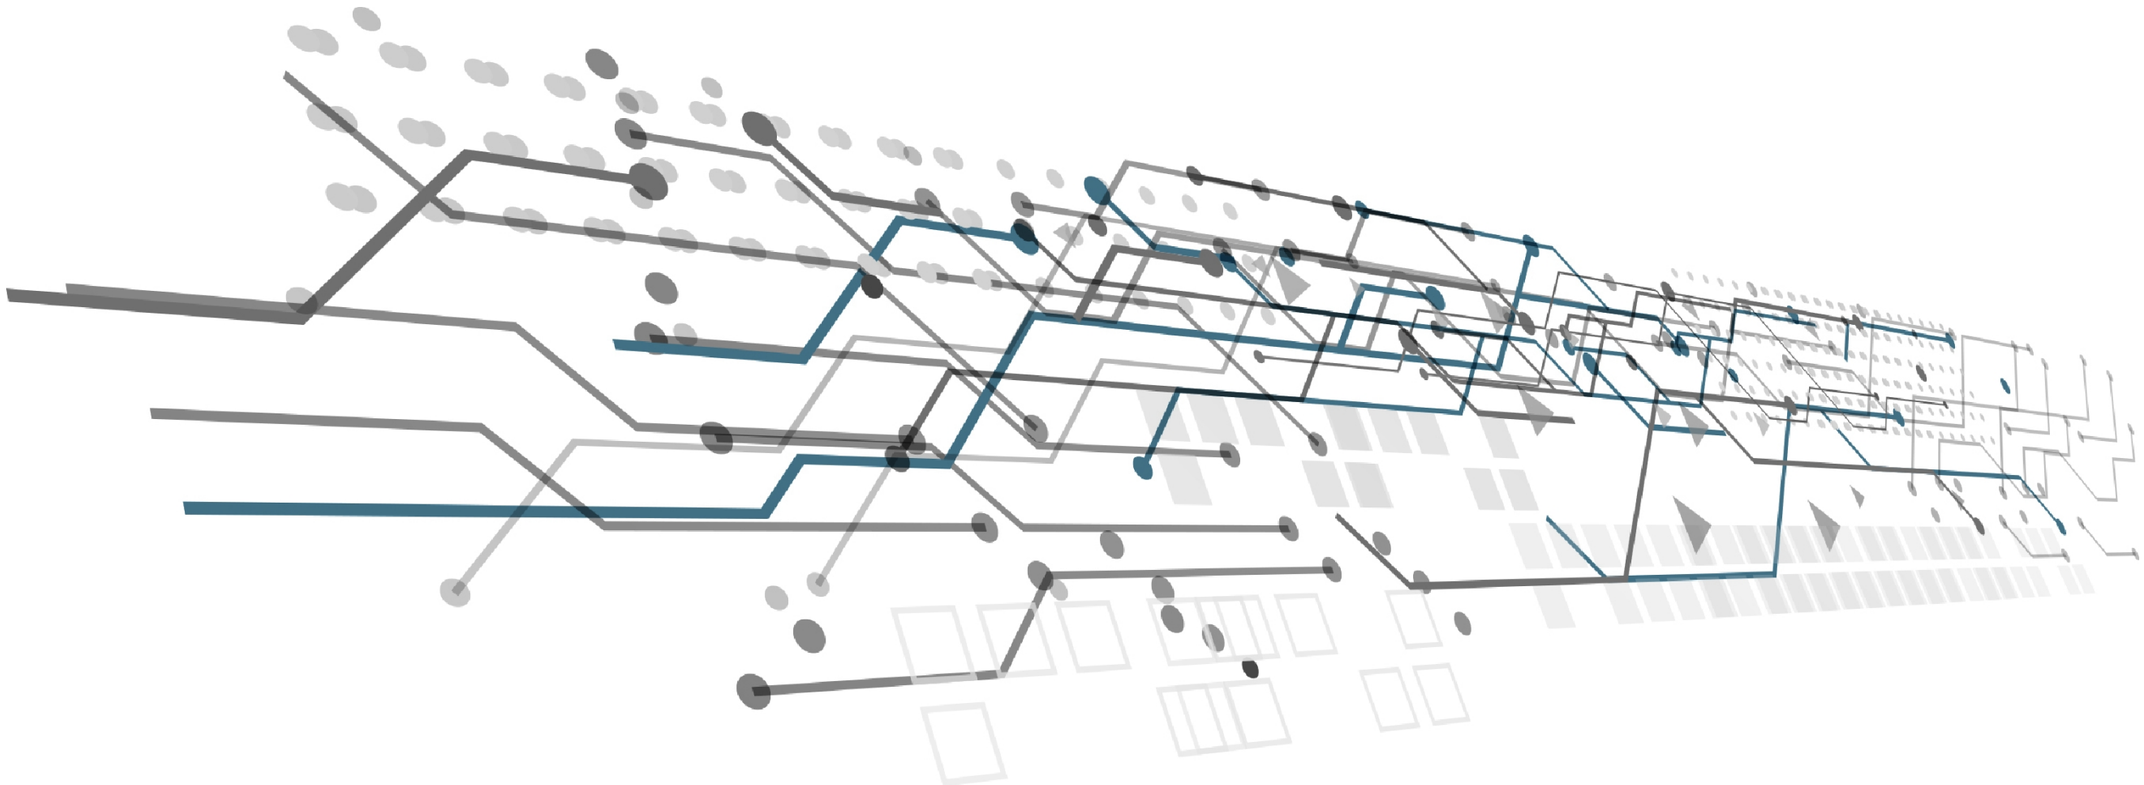

EXHAUSTO A/S
Odensevej 76
DK-5550 Langeskov
Denmark

Tel. +45 65 66 12 34
Fax +45 65 66 11 10
exhausto@exhausto.dk
www.exhausto.dk

EXHAUSTO

VEX1000 - Control panel (1x230V+HE)

2028125

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: 1
			Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 0
Drawing number: 2028125	Revision: C	Page Title: Project information	Replaces:	B	Scale:	1:1	Next page: 2
			EC no.:	-	Format:	A3	Pages in total: 36

Page	Title Note #1 GB	Titel DE	Titre FR	Last edit
1	Project information	Projektinformationen	Informations sur le projet	21-10-2025
3	Standards	Standard	Normes	06-11-2024
4	Standards	Standard	Normes	15-11-2024
5	Component overview	Komponentenübersicht	Vue d’ensemble des composants	15-07-2025
9	Principles for all configuration options	Prinzipien für alle Konfigurationsoptionen	Principes pour toutes les options de configuration	25-10-2024
10	Control panel layout	Layout des Schaltschrank	Disposition du tableau de commande	17-10-2025
11	Control panel terminals	Klemmen des Schaltschranks	Bornes du tableau de commande	21-05-2025
20	Main current	Hauptstrom	Courant principal	21-10-2025
21	Pilot current	Steuerstrom	Courant pilote	21-10-2025
22	Standard - Modbus connections	Standard – Modbus-Anschlüsse	Standard – Raccordements pour modbus	15-05-2025
23	Standard - Fan & Rotor/Bypass controls	Standard – Ventilator- und Rotor-/Bypass-Steuerungen	Standard – Commandes by-pass / du ventilateur et du rotor	30-06-2025
24	Standard - Dampers	Standard – Register	Standard - Volets	09-01-2025
25	Options - Dampers	Optionen – Register	Options - Volets	09-01-2025
26	Options - Pre-heating controls	Optionen – Vorheizregler	Options – Commandes de préchauffage	06-11-2024
27	Options - Post-heating controls	Optionen – Nachheizregler	Options – Commandes de post-chauffage	21-10-2025
28	Options - HW/CW/CO controls	Optionen – HW/CW/CO-Regler	Options – Commandes HW/CW/CO	21-10-2025
29	Options - Temperature & CO2 sensors	Optionen – Temperatur- und CO2-Sensoren	Options – Capteurs de température et de CO2	06-11-2024
30	Standard - Customer connections	Standard – Kundenseitige Anschlüsse	Standard – Raccordements du client	21-05-2025
40	Standard - Dual PTH 1	Standard – Doppel-PTH 1	Standard – Double PTH 1	14-05-2025
41	Standard - Dual PTH 2	Standard – Doppel-PTH 2	Standard – Double PTH 2	15-07-2025
42	Option - ALC™ - Rotor deicing	Option - ALC™ - Rotorenteisung	Option - ALC™ - Dégivrage du rotor	30-06-2025
50	Option – Coil control box layout	Option – Layout des Spulensteuerkastens	Option – Disposition du boîtier de commande du serpentin	17-10-2025
51	Option - Combi Coil (CO)	Option – Kombiregister (CO)	Option - Serpentin mixte (CO)	17-10-2025
52	Option - Direct Expansion Heat pump (DX)	Option – Heizregister für Direkte Expansion (DX)	Option - Batterie de chauffage à détente directe (DX)	17-10-2025
53	Option - Direct Expansion Cooling (DX)	Option – Kühlregister für Direkte Expansion (DX)	Option - Batterie de refroidissement à détente directe (DX)	17-10-2025

Identification of wires by colour (according to EN 60204-1) Note #2

Main current:	Hauptstrom:	Courant principal:	400/230VAC
Phase:	Phase:	Phase :	BK
Neutral:	Neutral:	Neutre :	BK
Earth:	Erde:	Terre :	GNYE
Pilot current:	Steuerstrom:	Courant pilote:	230/24VAC
Phase:	Phase:	Phase :	RD
Neutral:	Neutral:	Neutre :	RD
Earth:	Erde:	Terre :	GNYE
Pilot current:	Steuerstrom:	Courant pilote:	24VDC
Positive (+):	Positiv (+):	Positif (+) :	BU
Negative (-):	Negativ (-):	Négatif (-) :	BU
Unknown potential:	Unbekanntes Potenzial:	Potentiel inconnu:	
All:	Alle:	Tout:	OG

Abbreviations of colours (according to IEC 60757) Note #3

Black	Schwarz	Noir	BK
Brown	Braun	Marron	BN
Red	Rot	Rouge	RD
Orange	Orange	Orange	OG
Yellow	Gelb	Jaune	YE
Green	Grün	Vert	GN
Blue	Blau	Bleu	BU
Light Blue	Hellblau	Bleu clair	BU
Violet	Violett	Violet	VT
Gray	Grau	Gris	GY
White	Weiß	Blanc	WH
Pink	Rosa	Rose	PK
Green/Yellow	Grün/Gelb	Vert/Jaune	GNYE
Light-	Hell-	-clair	LT-

Labelling of cables and cores (according to IEC 62491) Note #4

Method CL

Method	Description
0	No labelling
A	Use of designated cables or cores
R	Identification labelling by means of reference designation (including cable number)
CL	Local-end connection labelling
CR	Remote-end connection labelling
CB	Both-end connection labelling
S	Signal labelling

Methode	Beschreibung
0	Keine Kennzeichnung
A	Verwendung vorgesehener Kabel oder Adern
R	Identifikationskennzeichnung mittels Referenzbezeichnung (inkl. Kabelnummer)
CL	Kennzeichnung der lokalen Verbindung
CR	Kennzeichnung der Remote-End-Verbindung
CB	Beidseitige Anschlussbeschriftung
S	Signalbeschriftung

Méthode	Description
0	Pas d'étiquetage
A	Utilisation de câbles ou d'âmes désignés
R	Marquage d'identification au moyen d'une désignation de référence
CL	Étiquetage des connexions locales
CR	Étiquetage des connexions distantes
CB	Étiquetage des connexions aux deux extrémités
S	Étiquetage des signaux

GB	All "Note #" in this document refer to non-English translations in the electrical installation instructions
DK	Alle "Note #" i dette dokument henviser til den danske oversættelse i elektriske installationsvejledningen
DE	Alle "Note #" in diesem Dokument beziehen sich auf die deutsche Übersetzung in der Elektroinstallationsanleitung
NO	Alle "Note #" i dette dokumentet refererer til den norske oversettelsen i den elektriske installasjonsveiledningen
SE	Alla "Note #" i detta dokument hänvisar till den svenska översättningen i den elektriska installationsanvisningen
NL	Alle "Note #" in dit document verwijzen naar de Nederlandse vertaling in de elektrische installatie-instructies
FR	Tous les "Note #" dans ce document se réfèrent à la traduction française du manuel d'installation électrique

Component	Location Note #5 (GB)	Standort (DE)	Emplacement (FR)
+A0	Customer connections	Kundenanschlüsse	Raccordements du client
+A1	Control Panel	Schaltschrank	Tableau de commande
+A2	Cable connections to AHU aggregate	Kabelverbindungen zum RLT-Lüftungsgerät	Raccordements de câbles à l'appareil CTA
+A3	AHU aggregate	RLT-Lüftungsgerät	Appareil CTA
+A4	Outside AHU aggregate	Außenseite des RLT-Lüftungsgeräts	À l'extérieur de l'appareil CTA

Component	Object	Examples	Objekt	Beispiele	Objet	Exemples
-B	Sensing	CO2 & temperature sensors	Sensorik	CO2- und Temperatursensoren	Détection	Sondes de CO2 et de température
-E	Emitting	Electric heaters	Emission	Elektrische Heizgeräte	Émetteur	Chauffages électriques
-F	Protecting	Miniature circuit-breaker	Schutz	Miniaturleistungsschalter	Protection	Disjoncteur à maximum miniature
-G	Generating	Circulation pumps	Erzeugung	Umwälzpumpen	Générateur	Pompes de circulation
-K	Information processing	AHU Controller	Informationsverarbeitung	RLT-Lüftungsgerätesteuerung	Traitement de l'information	Cerveau de l'appareil CTA
-M	Driving	Motors	Antrieb	Motoren	Entrainement	Moteurs
-Q	Controlling	Supply disconnecting device	Steuerung	Versorgungstrennvorrichtung	Commande	Dispositif de déconnexion de l'alimentation
-R	Restricting	Valves & dampers	Drosselung	Ventile und Register	Limitation	Vannes et volets
-S	Human interaction	Touch panel	Menschliche Interaktion	Bedienfeld mit Touchscreen	Interaction humaine	Écran tactile
-T	Transforming	Power supply	Transformation	Stromversorgung	Transformation	Alimentation électrique
-U	Holding	Cabinet, wire-duct & DIN-rails	Halten	Schrank, Kabelkanal und DIN-Schienen	Maintien	Cabinet de ventilateur, gaine de câbles et rails DIN
-W	Guiding	Cables, wires & tubes	Führung	Kabel, Drähte und Rohre	Guidage	Câbles, fils & tubes
-X	Interfacing	Terminals & plugs	Schnitstellen	Klemmen und Stecker	Interface	Terminaux & bornes
(=)	Function		Funktion		Fonction	
(+)	Location		Standort		Lieu	
(-)	Product		Produkt		Produit	
(.)	Sub name		Unterbezeichnung		Sous-titre	

Principles of structures and reference designations according to ISO/IEC RDS 81346

Grundlagen von Strukturen und Referenzbezeichnungen gemäß ISO/IEC RDS 81346

Principes de structures et désignations de référence selon ISO/IEC RDS 81346

Component	Function Note #6 GB	Funktion DE	Fonction FR
-0V	Terminals for 0VDC	Anschlüsse für 0 V DC	Bornes pour 0VDC
-24V	Terminals for 24VDC	Anschlüsse für 24 V DC	Bornes pour 24VDC
-B1.1	Extract air temperature	Außenlufttemperatur	Température de l'air extrait
-B1.2	Exhaust air temperature	Fortlufttemperatur	Température de l'air rejeté
-B2.1	Outdoor air temperature	Außenlufttemperatur	Température de l’air extérieur
-B2.2	Heat recovery temperature	Wärmerückgewinnungstemperatur	Température de récupération de chaleur
-B3	Heating return water temperature sensor	Temperatursensor Heizungsrücklaufwasser	Capteur thermique de l’eau de retour du chauffage
-B4	CO/CW return water temperature sensor	CO/CW-Rücklauf-Temperatursensor	Capteur thermique de retour CO/CW
-B5	Outdoor air temperature sensor (Pre-heater)	Außenluft-Temperatursensor (Vorwärmgerät)	Capteur thermique d’air extérieur (préchauffage)
-B6	CO2 sensor	CO2-Sensor	Capteur CO2
-B7	Duct temperature sensor	Kanaltemperatursensor	Capteur de température de conduit
-B8	CO supply water temperature sensor	CO-Vorlauf-Temperatursensor	Capteur thermique d’alimentation en CO
-BP1	DualPTH 1	DualPTH 1	DualPTH 1
-BP2	DualPTH 2	DualPTH 2	DualPTH 2
-BP3	DualPTH 3	DualPTH 3	DualPTH 3
-E1	Cabinet heater	Schaltschrankheizung	Chauffage de l’armoire
-E2	Change over coils	Change-Over-Register	Serpentin de commutation
-E3	Electric pre-heating	Elektrisches Vorheizen	Préchauffage électrique
-E4	Electric post-heating	Elektrisches Nachheizen	Post-chauffage électrique
-F1	MCB for Exhaust air fan	Miniaturleistungsschalter für Fortluftventilator	MCB pour ventilateur de rejet extérieur
-F2	MCB for Supply air fan	Miniaturleistungsschalter für Zuluftventilator	MCB pour ventilateur d’air soufflé
-F3	MCB for Rotor/Control systems	Miniaturleistungsschalter für Rotor-/Reglersysteme	MCB pour rotor/systèmes de régulation
-F4	MCB for Circulation pumps	Miniaturleistungsschalter für Umwälzpumpe	MCB pour pompe de circulation
-F5	MCB for Electric post-heating	Miniaturleistungsschalter für Elektrisches Vorheizen	MCB pour préchauffage électrique
-G1	Heating circulation pump	Heizungsumwälzpumpe	Pompe de circulation du chauffage
-G2	CW/CO/DX circulation pump	CW/CO/DX-Umwälzpumpe	Pompe de circulation CW/CO/DX
-K1	AHU Controller	Regler für RLT	Contrôleur CTA
-K2	EXT module for Change over	EXT-Modul für Change-Over	Module EXT pour inversion
-M1.2	Exhaust air fan	Fortluftventilator	Ventilateur d'évacuation de l’air

Component	Function Note #6 GB	Funktion DE	Fonction FR
-M2.2	Supply air fan	Zuluftventilator	Ventilateur d’air soufflé
-M3	Rotor	Rotor	Rotor
-Q1	Supply disconnecting device	Versorgungstrennvorrichtung	Dispositif de coupure de l’alimentation
-R1.1	Extract air damper (ALC™)	Abluftregister (ALC™)	Volet d’air extrait (ALC™)
-R1.2	Exhaust air damper	Fortluftregister	Volet d’air rejeté
-R2.1	Outdoor air damper	Außenluftregister	Volet d'air extérieur
-R2.2	Supply air damper	Zuluftregister	Volet d’air soufflé
-R3	Bypass damper	Bypassregister	Volet de dérivation
-R4	Mixing air damper	Mischluftregister	Volets d'air de recirculation
-R5	Valve HW	Ventil HW	Vanne HW
-R6	Valve CW	Ventil CW	Vanne CW
-R7	Valve CO/DX	Ventil CO/DX	Vanne CO/DX
-S1	Touch panel	Bedienfeld mit Touchscreen	Écran tactile
-S2	CO system alarm	CO-Systemalarm	Système d'alarme CO
-S3	DX control Heat pump	DX-Steuerung Wärmepumpe	Pompe à chaleur à régulation DX
-T1	Power supply 230VAC/24VDC	Stromversorgung 230 V AC/24 V DC	Alimentation 230 V CA/24 V CC
-U1	Automation board	Automatisierungsplatine	Carte d’automatisation
-X1.1	Aggregate power terminals	Klemmen für Gerätestrom	Bornes de puissance agrégées
-X1.2	Aggregate signal terminals	Klemmen für Gerätesignal	Bornes de signal agrégées
-X1.3	Modbus splitter 9 x Molex	Modbus-Splitter 9 x Molex	Répartiteur Modbus 9 x Molex
-X1	Aggregate power & signal terminals	Klemmen für Gerätestrom und -signal	Bornes d’alimentation et de signal agrégées
-X2	Air dampers terminals	Klemmen für Luftklappen	Bornes des volets d’air
-X3	Pre-HE signal terminals	Vor-HE-Signalklemmen	Bornes de signal de pré-CH
-X4	Post-HE power terminals	Post-HE Stromklemmen	Bornes d’alimentation de post-CH
-X5	HW - Power & signal terminals	HW – Strom- und Signalklemmen	HW – Bornes d’alimentation et de signal
-X6	CW/CO - Power & signal terminals	CW/CO – Strom- und Signalklemmen	CW/CO – Bornes d’alimentation et de signal
-X7	Temperature & CO2 sensors terminals	Klemmen für Temperatur- und CO2-Sensoren	Bornes d’alimentation et de signal agrégées
-X8	Customer connections terminals	Kundenseitige Anschlussklemmen	Bornes de raccord client
-X10	Modbus splitter 4 x RJ12	Modbus-Splitter 4 x RJ12	Répartiteur Modbus 4 x RJ12

Component	Function Note #6 GB	Funktion DE	Fonction FR
-X51	CO/DX – MODBUS & signal terminals	CO/DX – MODBUS- und Signalklemmen	CO/DX – Bornes d'MODBUS et signaux
-X52	CO/DX - Power & signal terminals	CO/DX – Strom- und Signalklemmen	CO/DX – Bornes d'alimentation et de signal
-X-B3	Heating return water temperature sensor plug	Stecker für Temperatursensor Heizungsrücklauf	Connecteur capteur de température retour eau de chauffage
-X-E4.2	HE - Signal plug	Stecker für HE – Signal	HE – Connecteur de signal
-X-M1.2	Exhaust air fan plug	Stecker für Fortluftventilator	Connecteur de ventilateur de rejet extérieur
-X-M2.2	Supply air fan plug	Stecker für Zuluftventilator	Connecteur de ventilateur d'air soufflé
-X-M3	Rotor plug	Stecker für Rotor	Connecteur de rotor
-X-R1.2	Exhaust air damper plug	Stecker für Fortluftregister	Connecteur des volets d'air rejeté
-X-R2.1	Outdoor air damper plug	Stecker für Außenluftregister	Connecteur des volets d'air extérieur
-X-R4	Mixing air damper plug	Stecker für Mischluftregister	Connecteur des volts d'air mélangé

Principles

COUNTER-FLOW

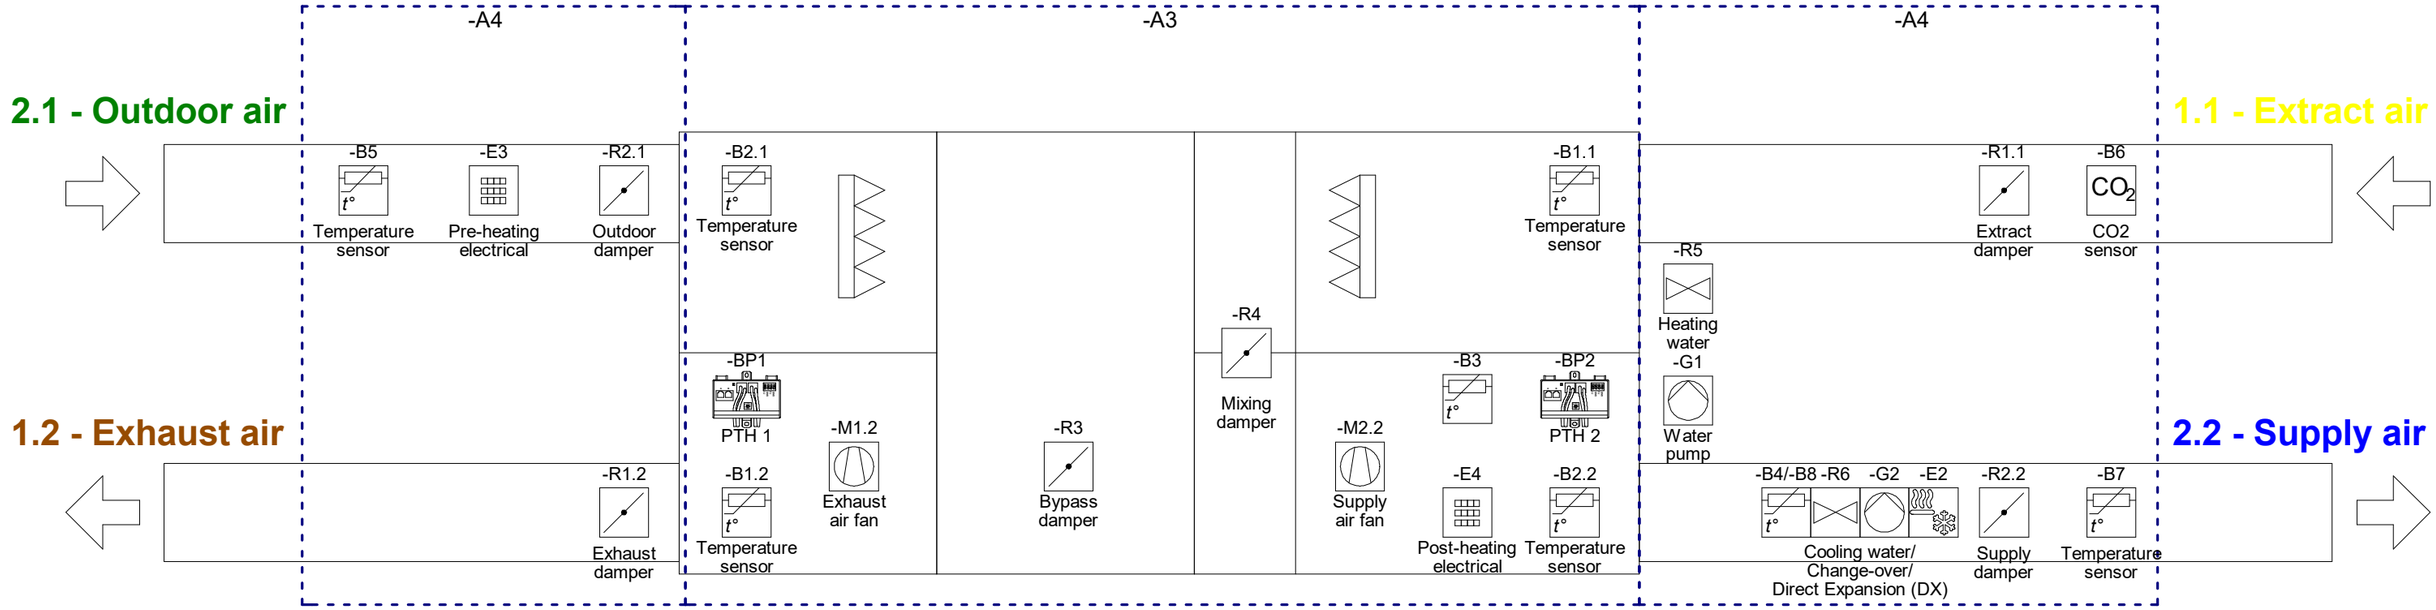

ROTOR

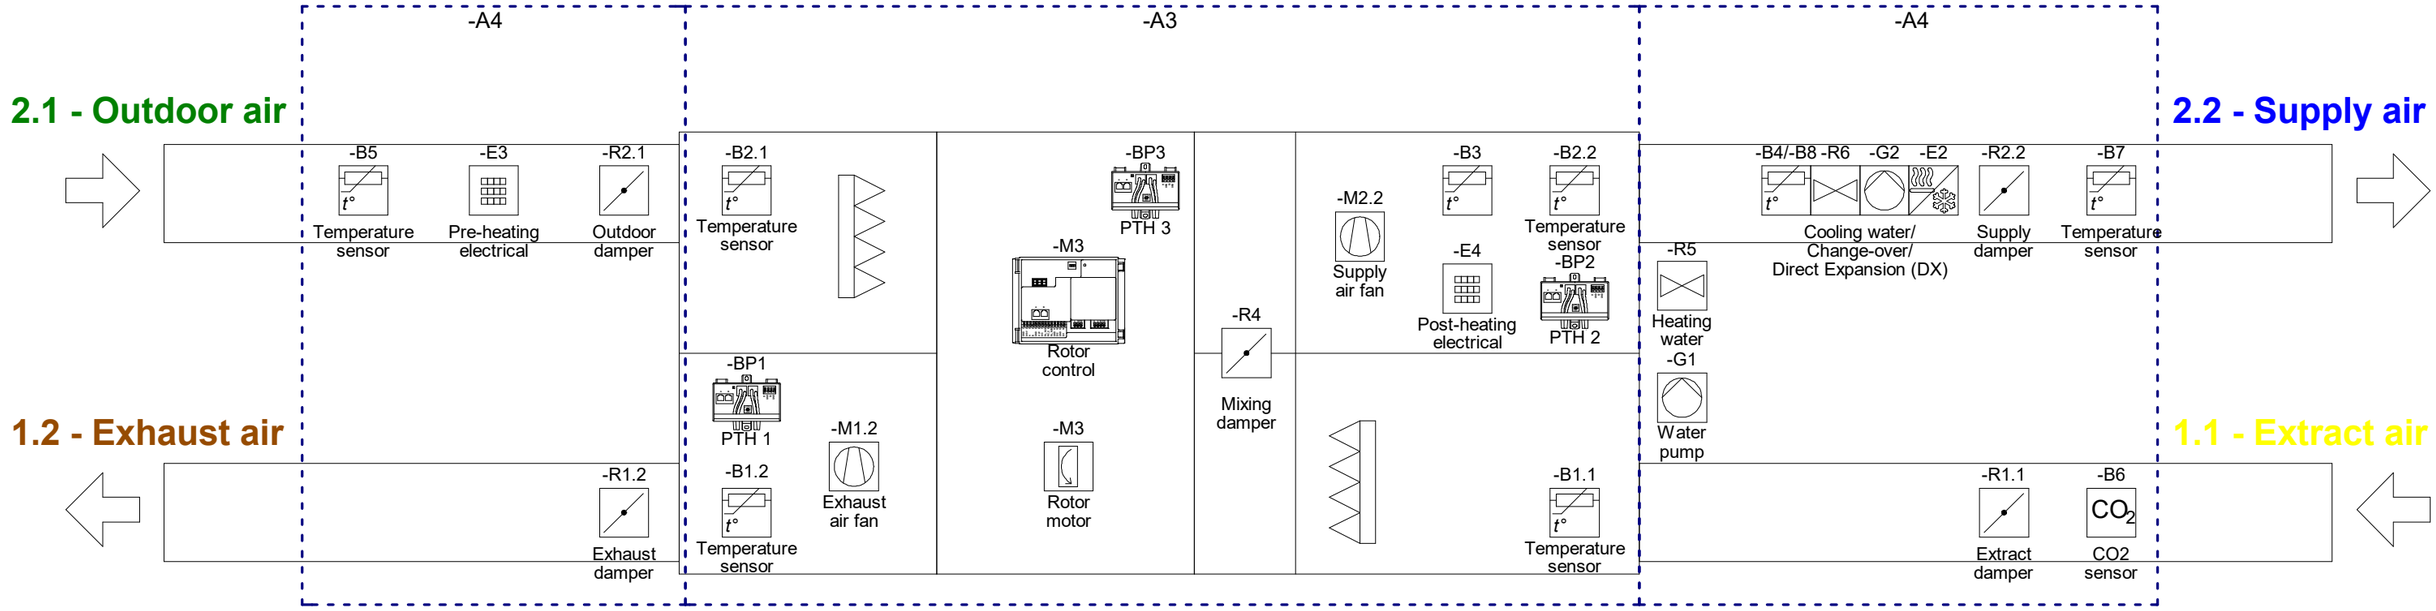

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 9	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 7	
Drawing number: 2028125	Revision: C	Page Title: Principles for all configuration options	Replaces: B	Scale: 1:5	Next page: 10	
			EC no.: -	Format: A3	Pages in total: 36	

Arrangement drawings

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: Arrangement
			Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 9
Drawing number: 2028125	Revision: C	Page Title: Arrangement drawings	Replaces:	B	Scale:	1:1	Next page: 10
			EC no.:	-	Format:	A3	Pages in total: 36

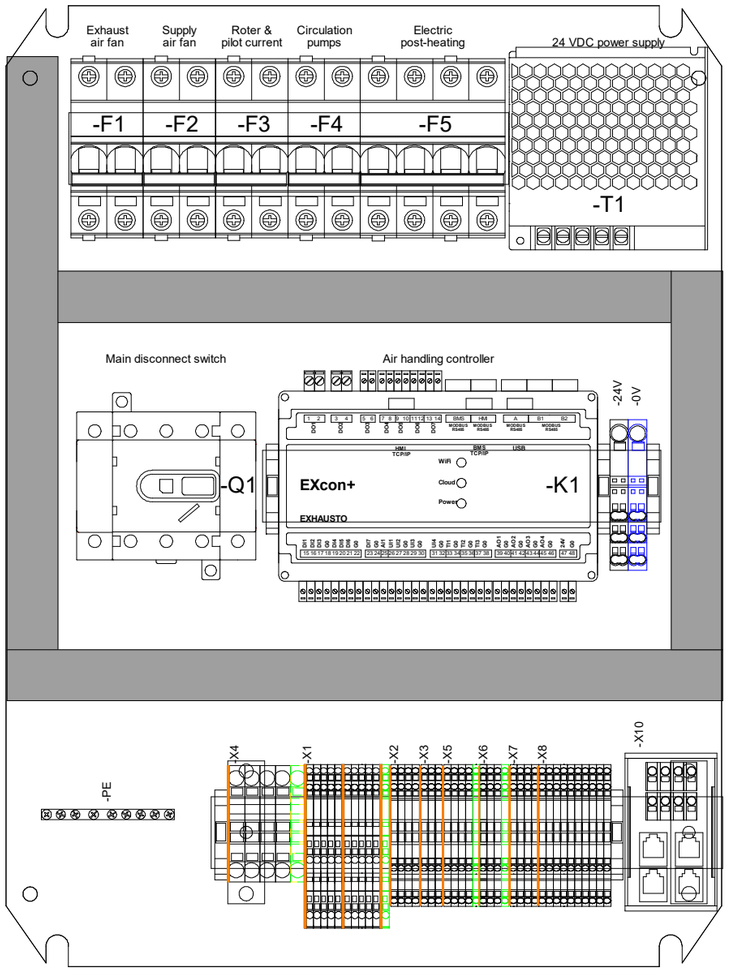

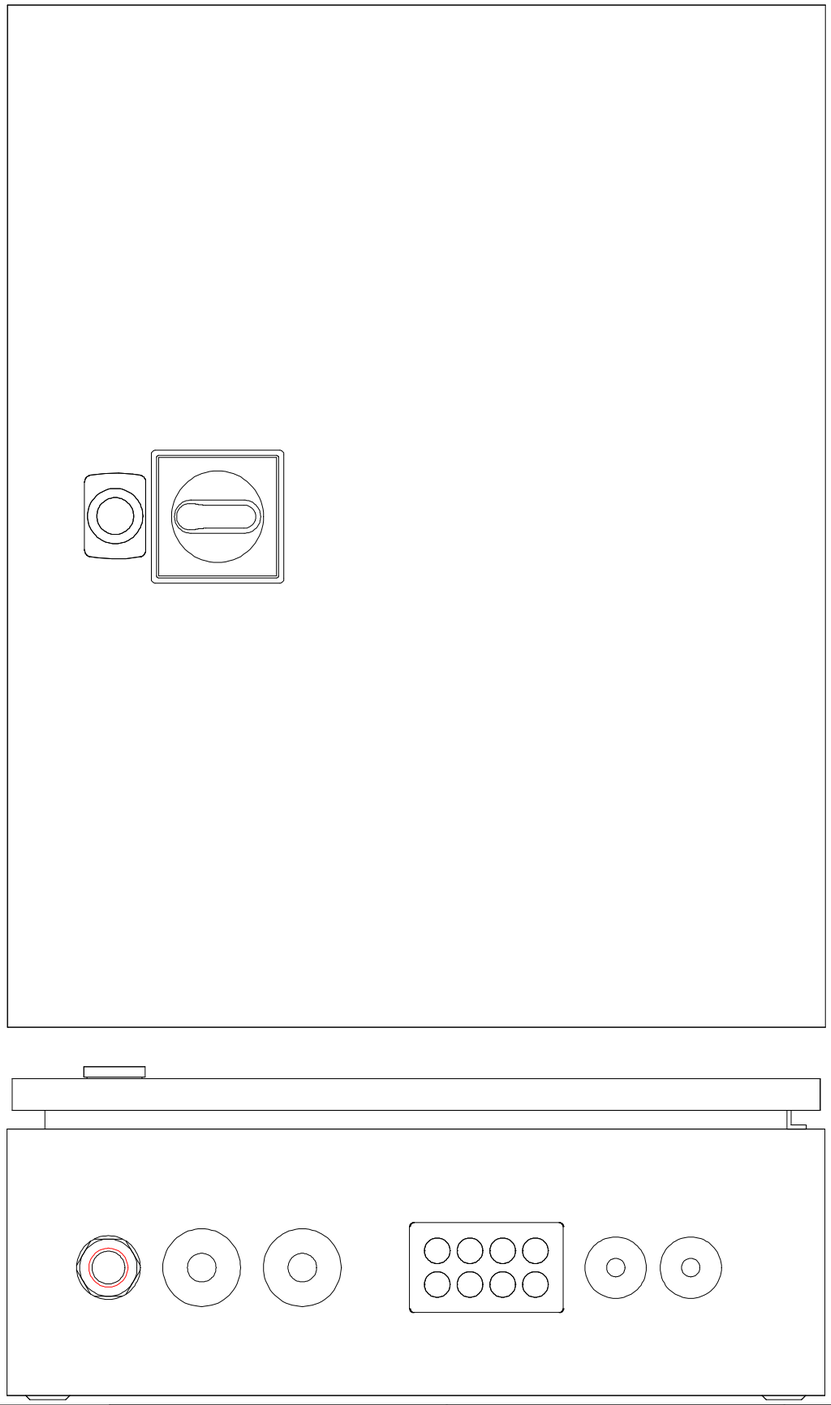

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: 10
			Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 9
Drawing number: 2028125	Revision: C	Page Title: Control panel layout	Replaces:	B	Scale:	1:3	Next page: 11
			EC no.:	-	Format:	A3	Pages in total: 36

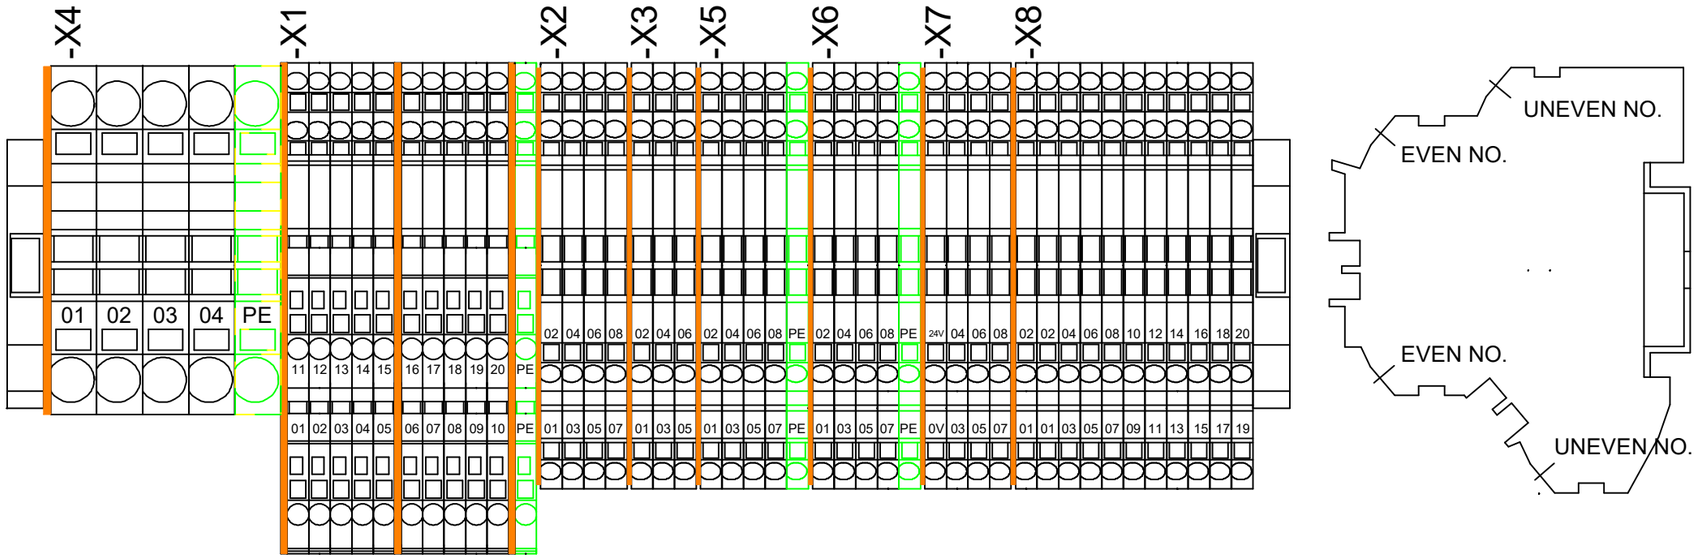

-X1:01	-M1.2	Exhaust air fan	L1
-X1:02	-M1.2	Exhaust air fan	L2
-X1:03	-M1.2	Exhaust air fan	L3
-X1:04	-M2.2	Supply air fan	L1
-X1:05	-M2.2	Supply air fan	L2
-X1:06	-M2.2	Supply air fan	L3
-X1:07	-M3	Rotor	L
-X1:08	-M3	Rotor	N
-X1:09	-MB	Modbus	0V
-X1:10	-MB	Modbus	24V
-X1:11	-MB	Modbus	B-
-X1:12	-MB	Modbus	A+
-X1:13	-E4	Electric post-heating	0-10V
-X1:14	-E4	Electric post-heating	GND
-X1:15	-E4	Electric post-heating	Fire
-X1:16	-E4	Electric post-heating	Fail
-X1:17	-E4	Electric post-heating	Run OK
-X1:18	-E4	Electric post-heating	Run OK
-X1:19	-B3	Temperature sensor	-
-X1:20	-B3	Temperature sensor	-
-X1:PE	-PE	Protective Earth	PE

-X2:01	-R1.1	Extract air damper	0V
-X2:03	-R1.1	Extract air damper	24V
-X2:05	-R1.1	Extract air damper	B-
-X2:07	-R1.1	Extract air damper	A+
-X2:02	-R2.2	Supply air damper	0V
-X2:04	-R2.2	Supply air damper	24V
-X2:06	-R2.2	Supply air damper	B-
-X2:08	-R2.2	Supply air damper	A+
-X3:01	-E3	Electric pre-heating	0-10V
-X3:02	-E3	Electric pre-heating	GND
-X3:03	-E3	Electric pre-heating	Fire
-X3:04	-E3	Electric pre-heating	Fail
-X3:05	-E3	Electric pre-heating	Run OK
-X3:06	-E3	Electric pre-heating	Run OK
-X4:01	-E4	PWR Electric heating	L1
-X4:02	-E4	PWR Electric heating	L2
-X4:03	-E4	PWR Electric heating	L3
-X4:04	-E4	PWR Electric heating	N
-X4:PE	-E4	PWR Electric heating	PE

-X5:01	-R1	Valve HW	0V
-X5:02	-R1	Valve HW	24V
-X5:03	-R1	Valve HW	Signal
-X5:04	-R1	Valve HW	Not used
-X5:05	-G1	HW circulation pump	NC
-X5:06	-G1	HW circulation pump	COM
-X5:07	-G1	HW circulation pump	L
-X5:08	-G1	HW circulation pump	N
-X5:PE	-G1	HW circulation pump	PE
-X6:01	-R2	Valve CW/CO	0V
-X6:02	-R2	Valve CW/CO	24V
-X6:03	-R2	Valve CW/CO	Signal
-X6:04	-R2	Valve CW/CO	Not used
-X6:05	-G2	CW/CO circulation pump	NC
-X6:06	-G2	CW/CO circulation pump	COM
-X6:07	-G2	CW/CO circulation pump	L
-X6:08	-G2	CW/CO circulation pump	N
-X6:PE	-G2	CW/CO circulation pump	PE

-X7:01	-B5	Pre-heater temperature sensor	-
-X7:02	-B5	Pre-heater temperature sensor	-
-X7:03	-B6	CO2 sensor	GND
-X7:04	-B6	CO2 sensor	OUT
-X7:05	-B6	CO2 sensor	+VCC
-X7:06	-	Spare terminal	
-X7:07	-B7	Duct temperature sensor	-
-X7:08	-B7	Duct temperature sensor	-
-X8:0V		Customer connections	24V power supply
-X8:24V		Customer connections	24V power supply
-X8:01		Customer connections	Fire alarm input
-X8:02		Customer connections	Fire alarm input
-X8:03		Customer connections	Option input 1
-X8:04		Customer connections	Option input 1
-X8:05		Customer connections	Option input 2
-X8:06		Customer connections	Option input 2
-X8:07		Customer connections	Option input 3
-X8:08		Customer connections	Option input 3
-X8:09		Customer connections	Option input 4
-X8:10		Customer connections	Option input 4
-X8:11		Customer connections	A alarm output
-X8:12		Customer connections	A alarm output
-X8:13		Customer connections	Option output 1
-X8:14		Customer connections	Option output 1
-X8:15		Customer connections	Option output 2
-X8:16		Customer connections	Option output 2
-X8:17		Customer connections	BMS - RS485
-X8:18		Customer connections	BMS - RS485
-X8:19		Customer connections	Start signal
-X8:20		Customer connections	Start signal

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: 11
			Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 10
Drawing number: 2028125	Revision: C	Page Title: Control panel terminals	Replaces:	B	Scale:	1:1	Next page: 20
			EC no.:	-	Format:	A3	Pages in total: 36

Circuit diagrams

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: Circuit diagrams
			Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 11
Drawing number: 2028125	Revision: C	Page Title: Circuit diagrams	Replaces:	B	Scale:	1:1	Next page: 20
			EC no.:	-	Format:	A3	Pages in total: 36

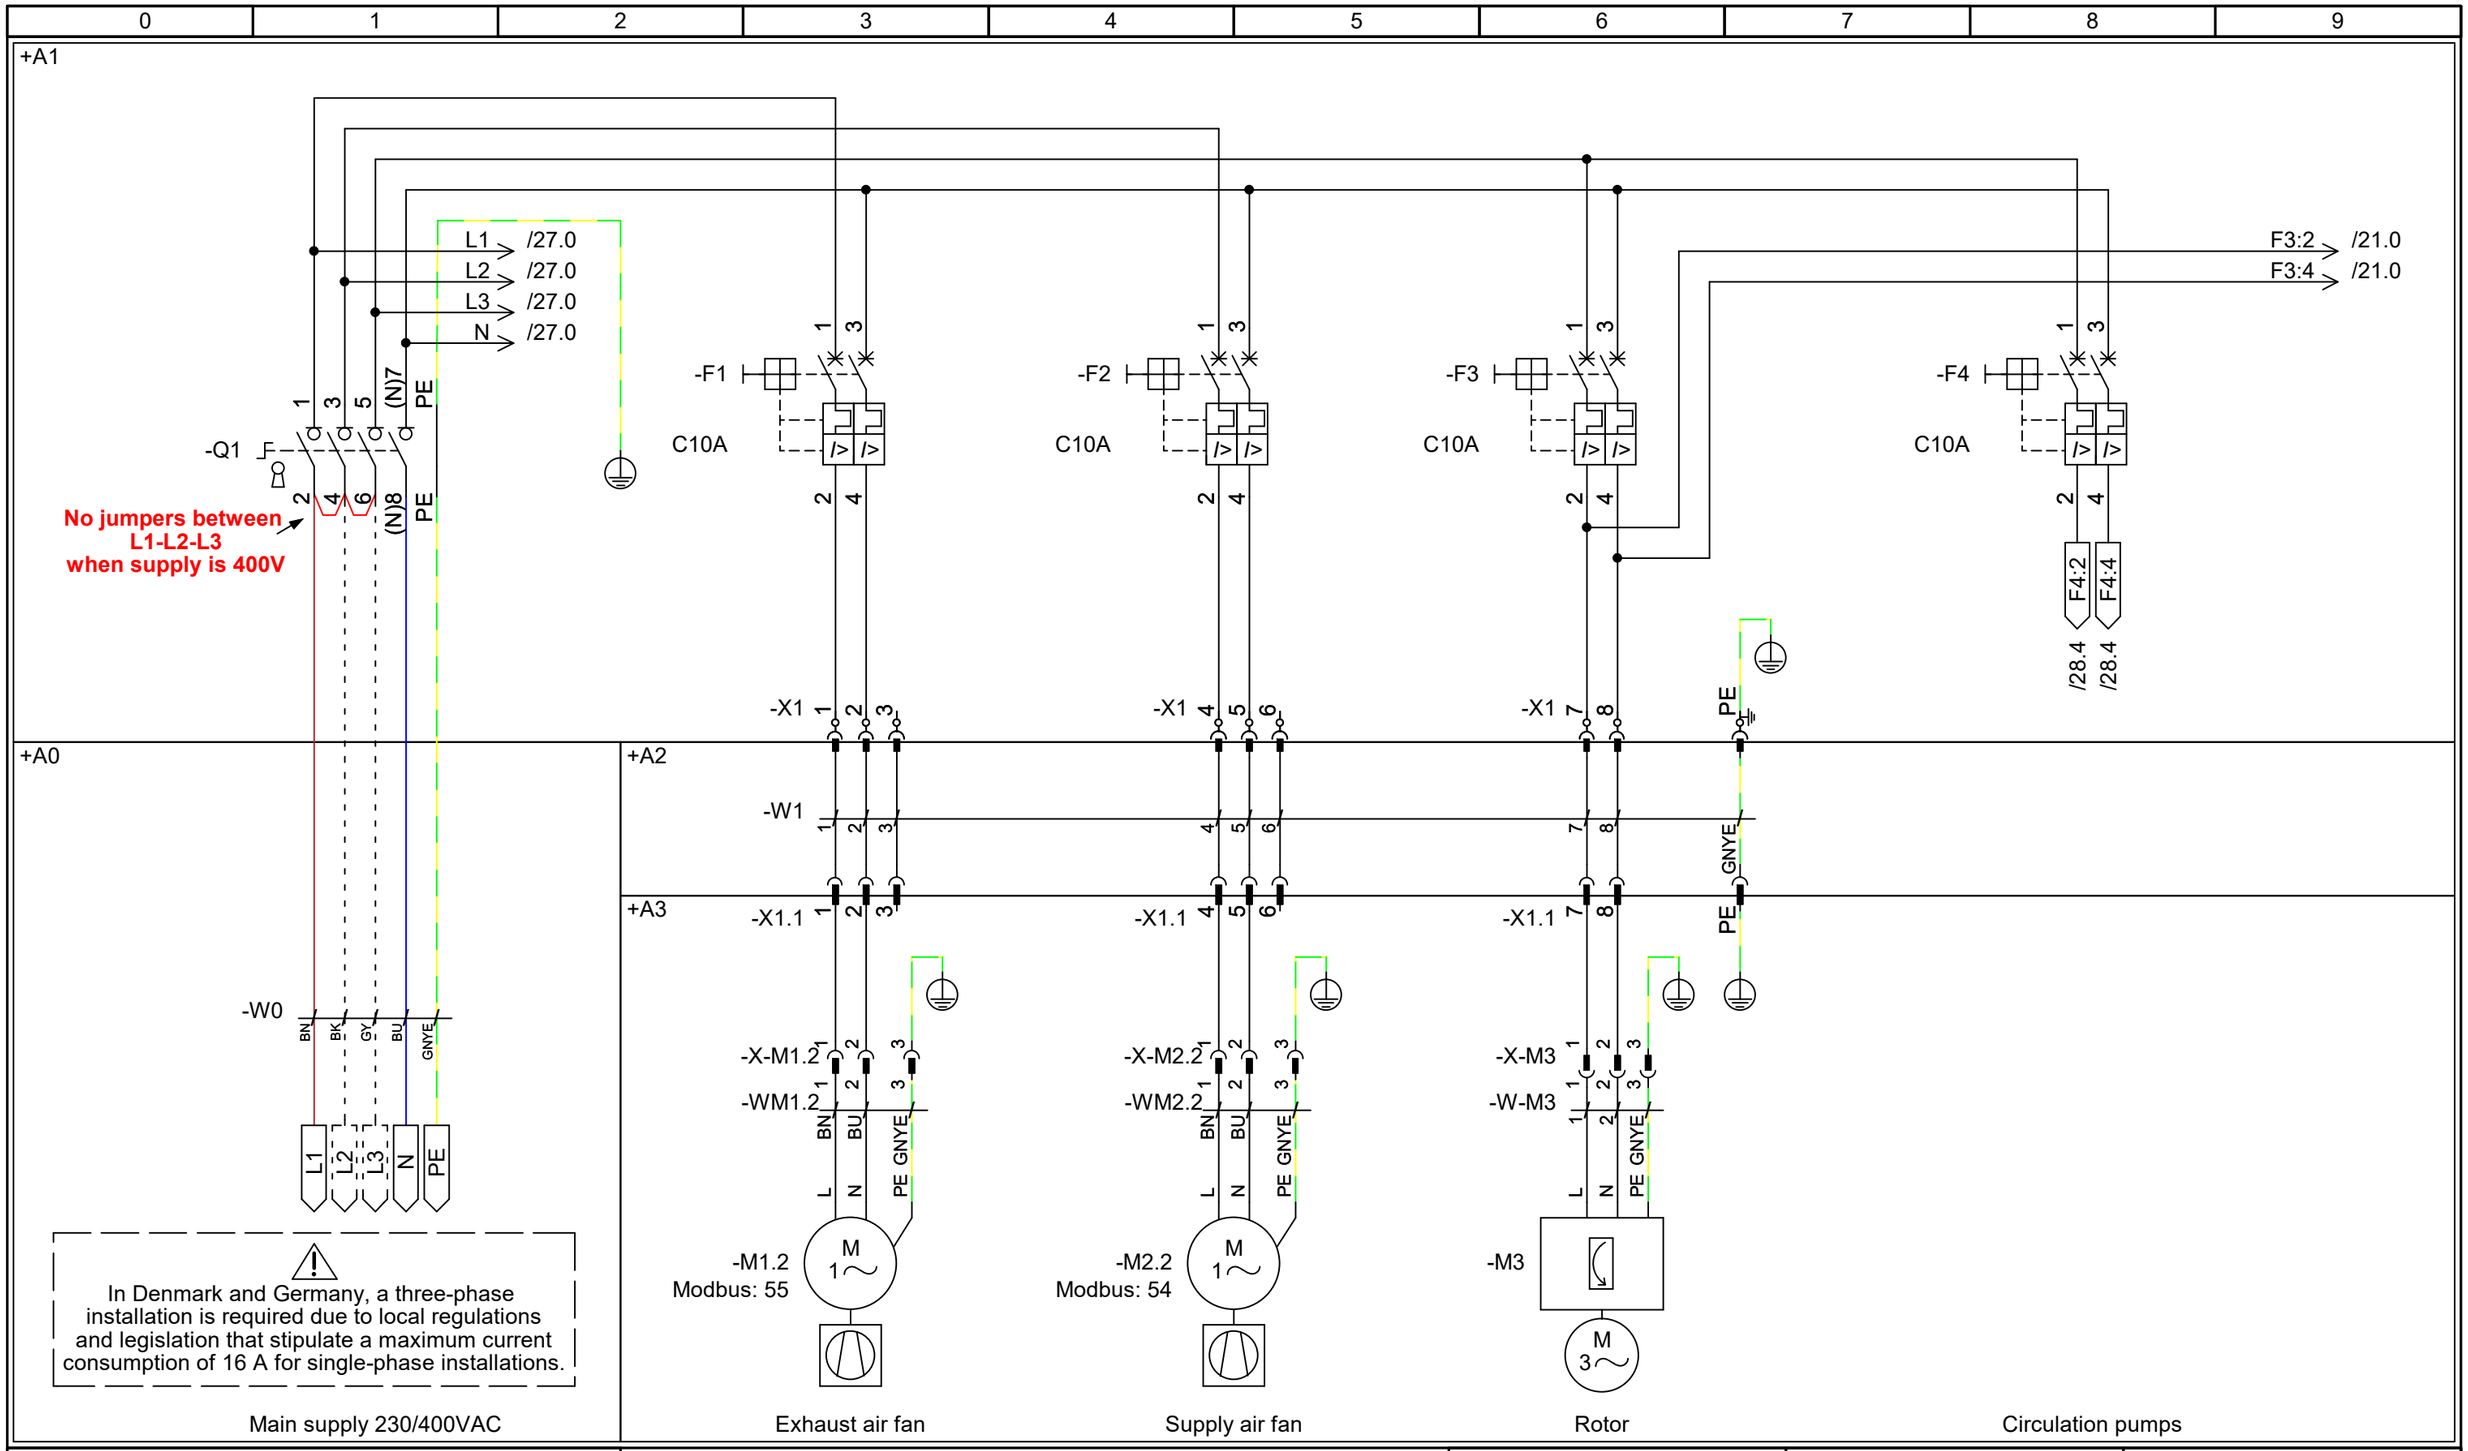

EXHAUSTO	Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 20	
		Revision date: 21-10-2025	Approved by: DKBP	Previous page: 11	
Drawing number: 2028125	Revision: C	Page Title: Main current	Replaces: B	Scale: 1:1	Next page: 21
			EC no.: -	Format: A3	Pages in total: 36

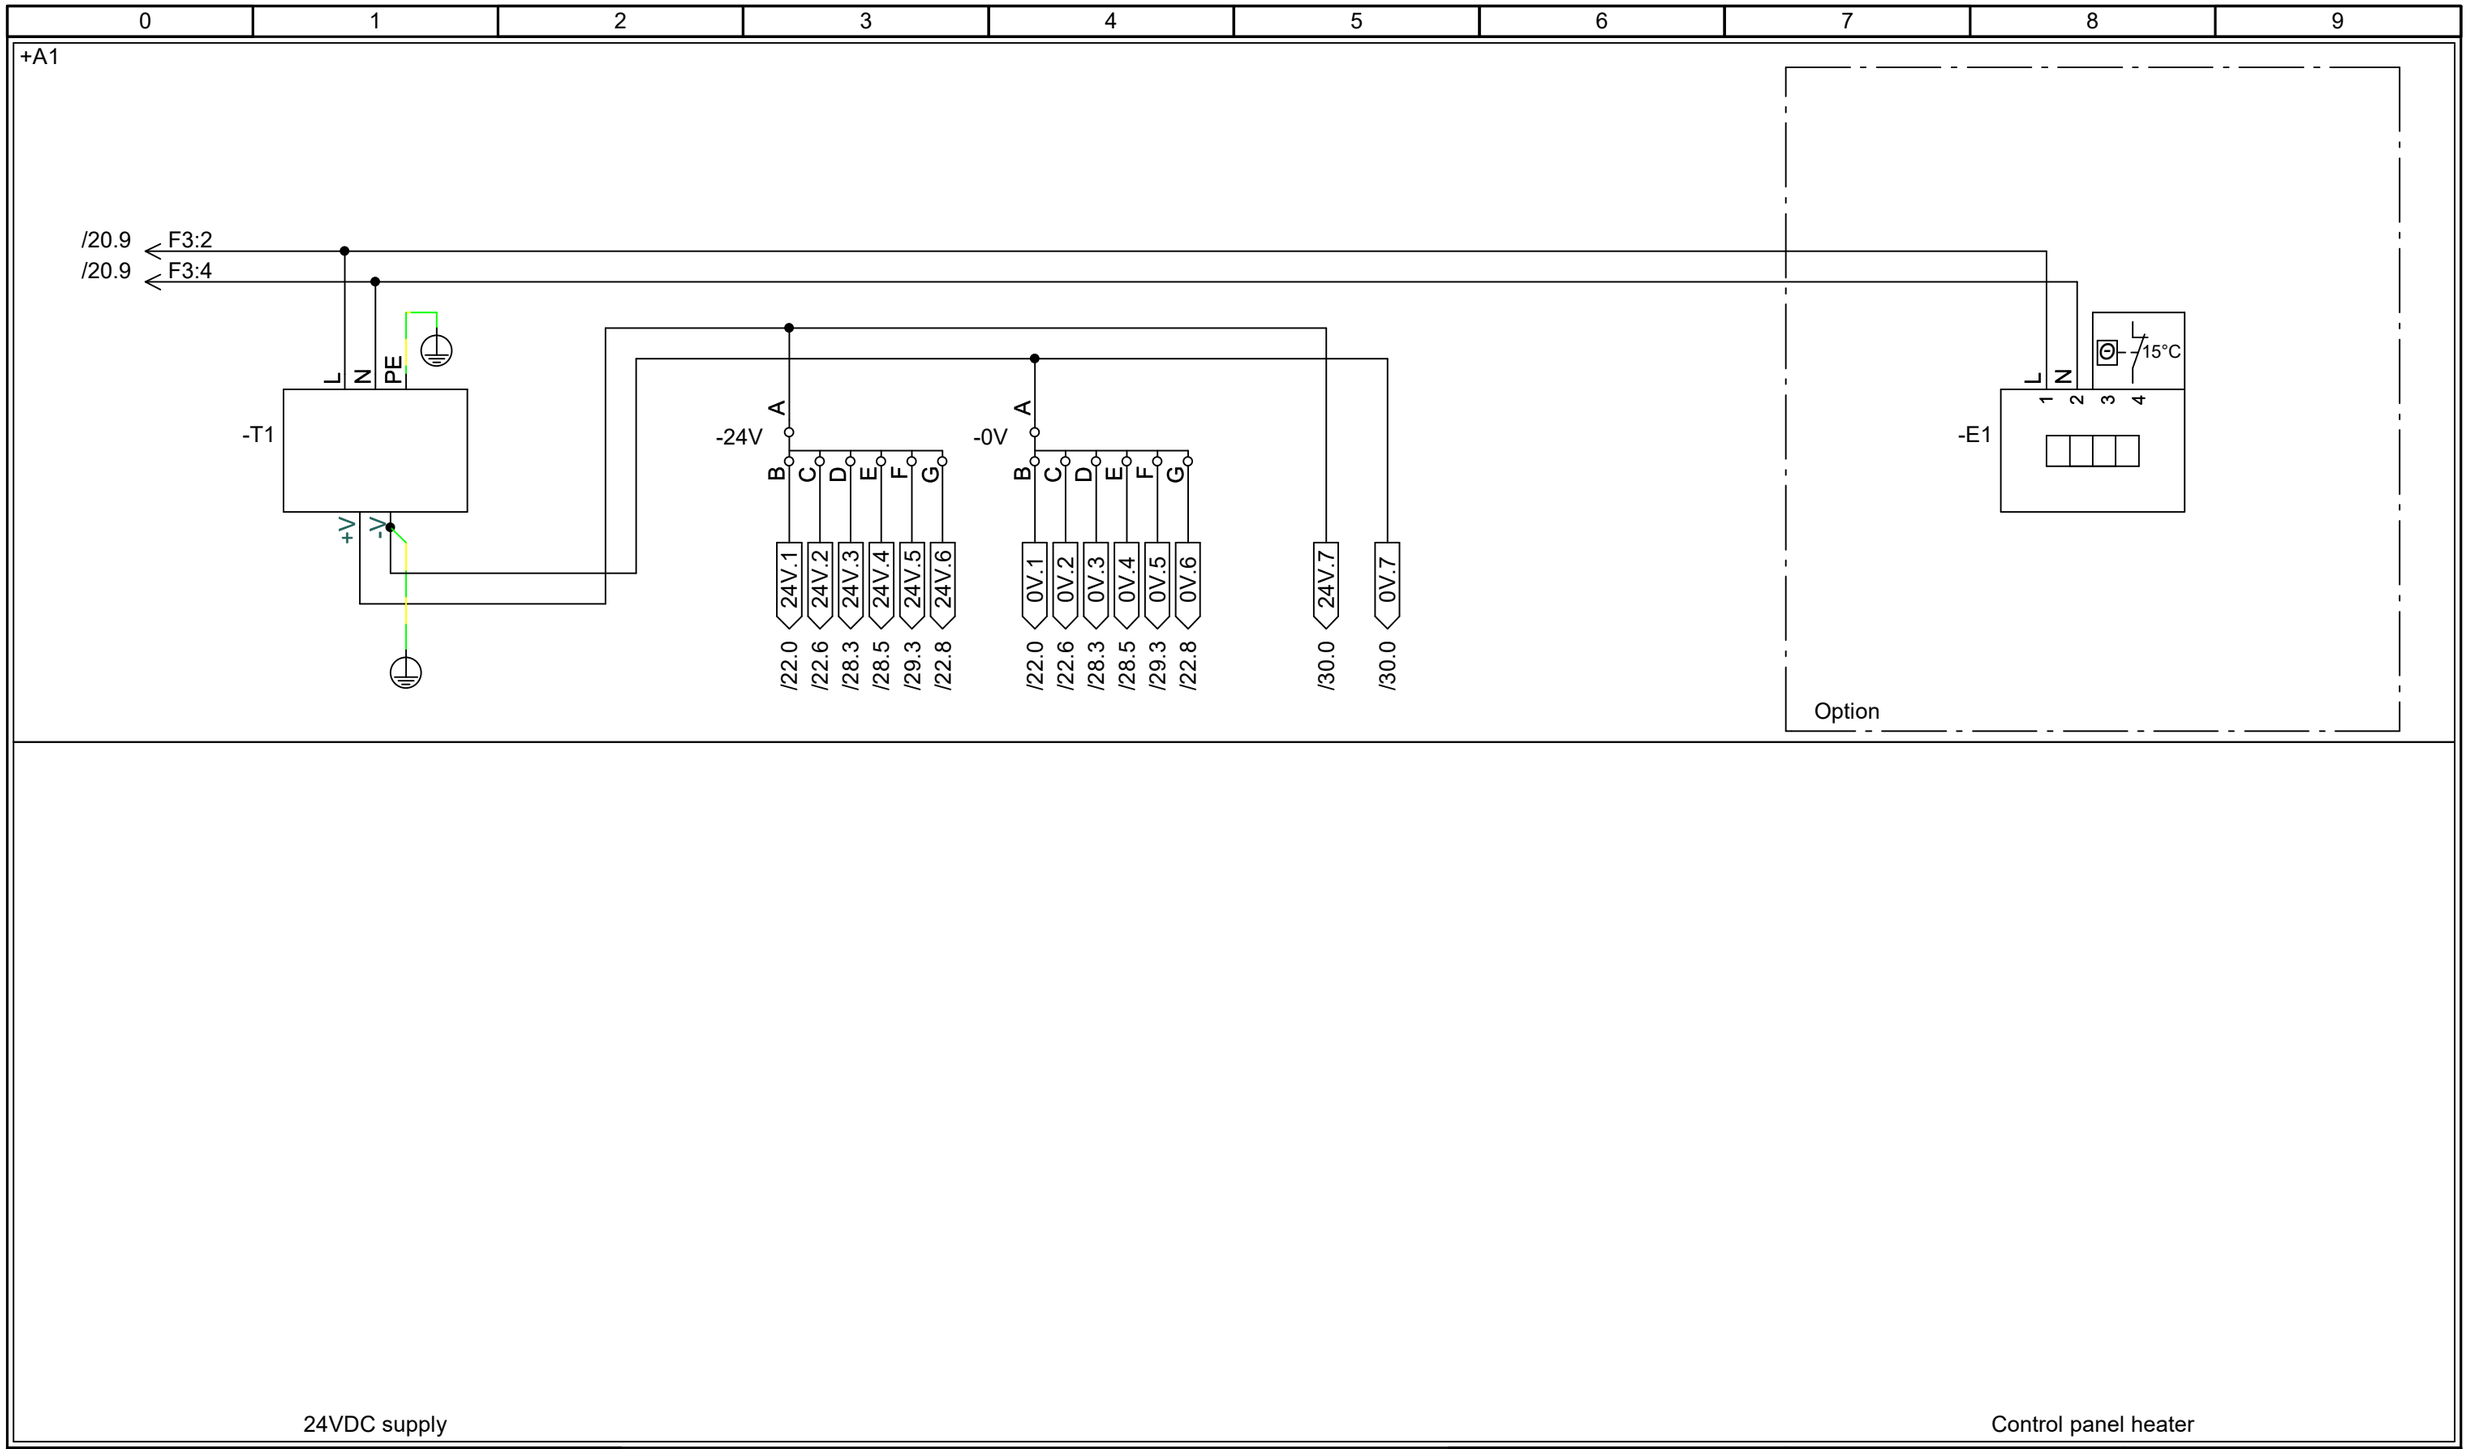

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 21	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 20	
Drawing number: 2028125	Revision: C	Page Title: Pilot current	Replaces: B	Scale: 1:1	Next page: 22	
			EC no.: -	Format: A3	Pages in total: 36	

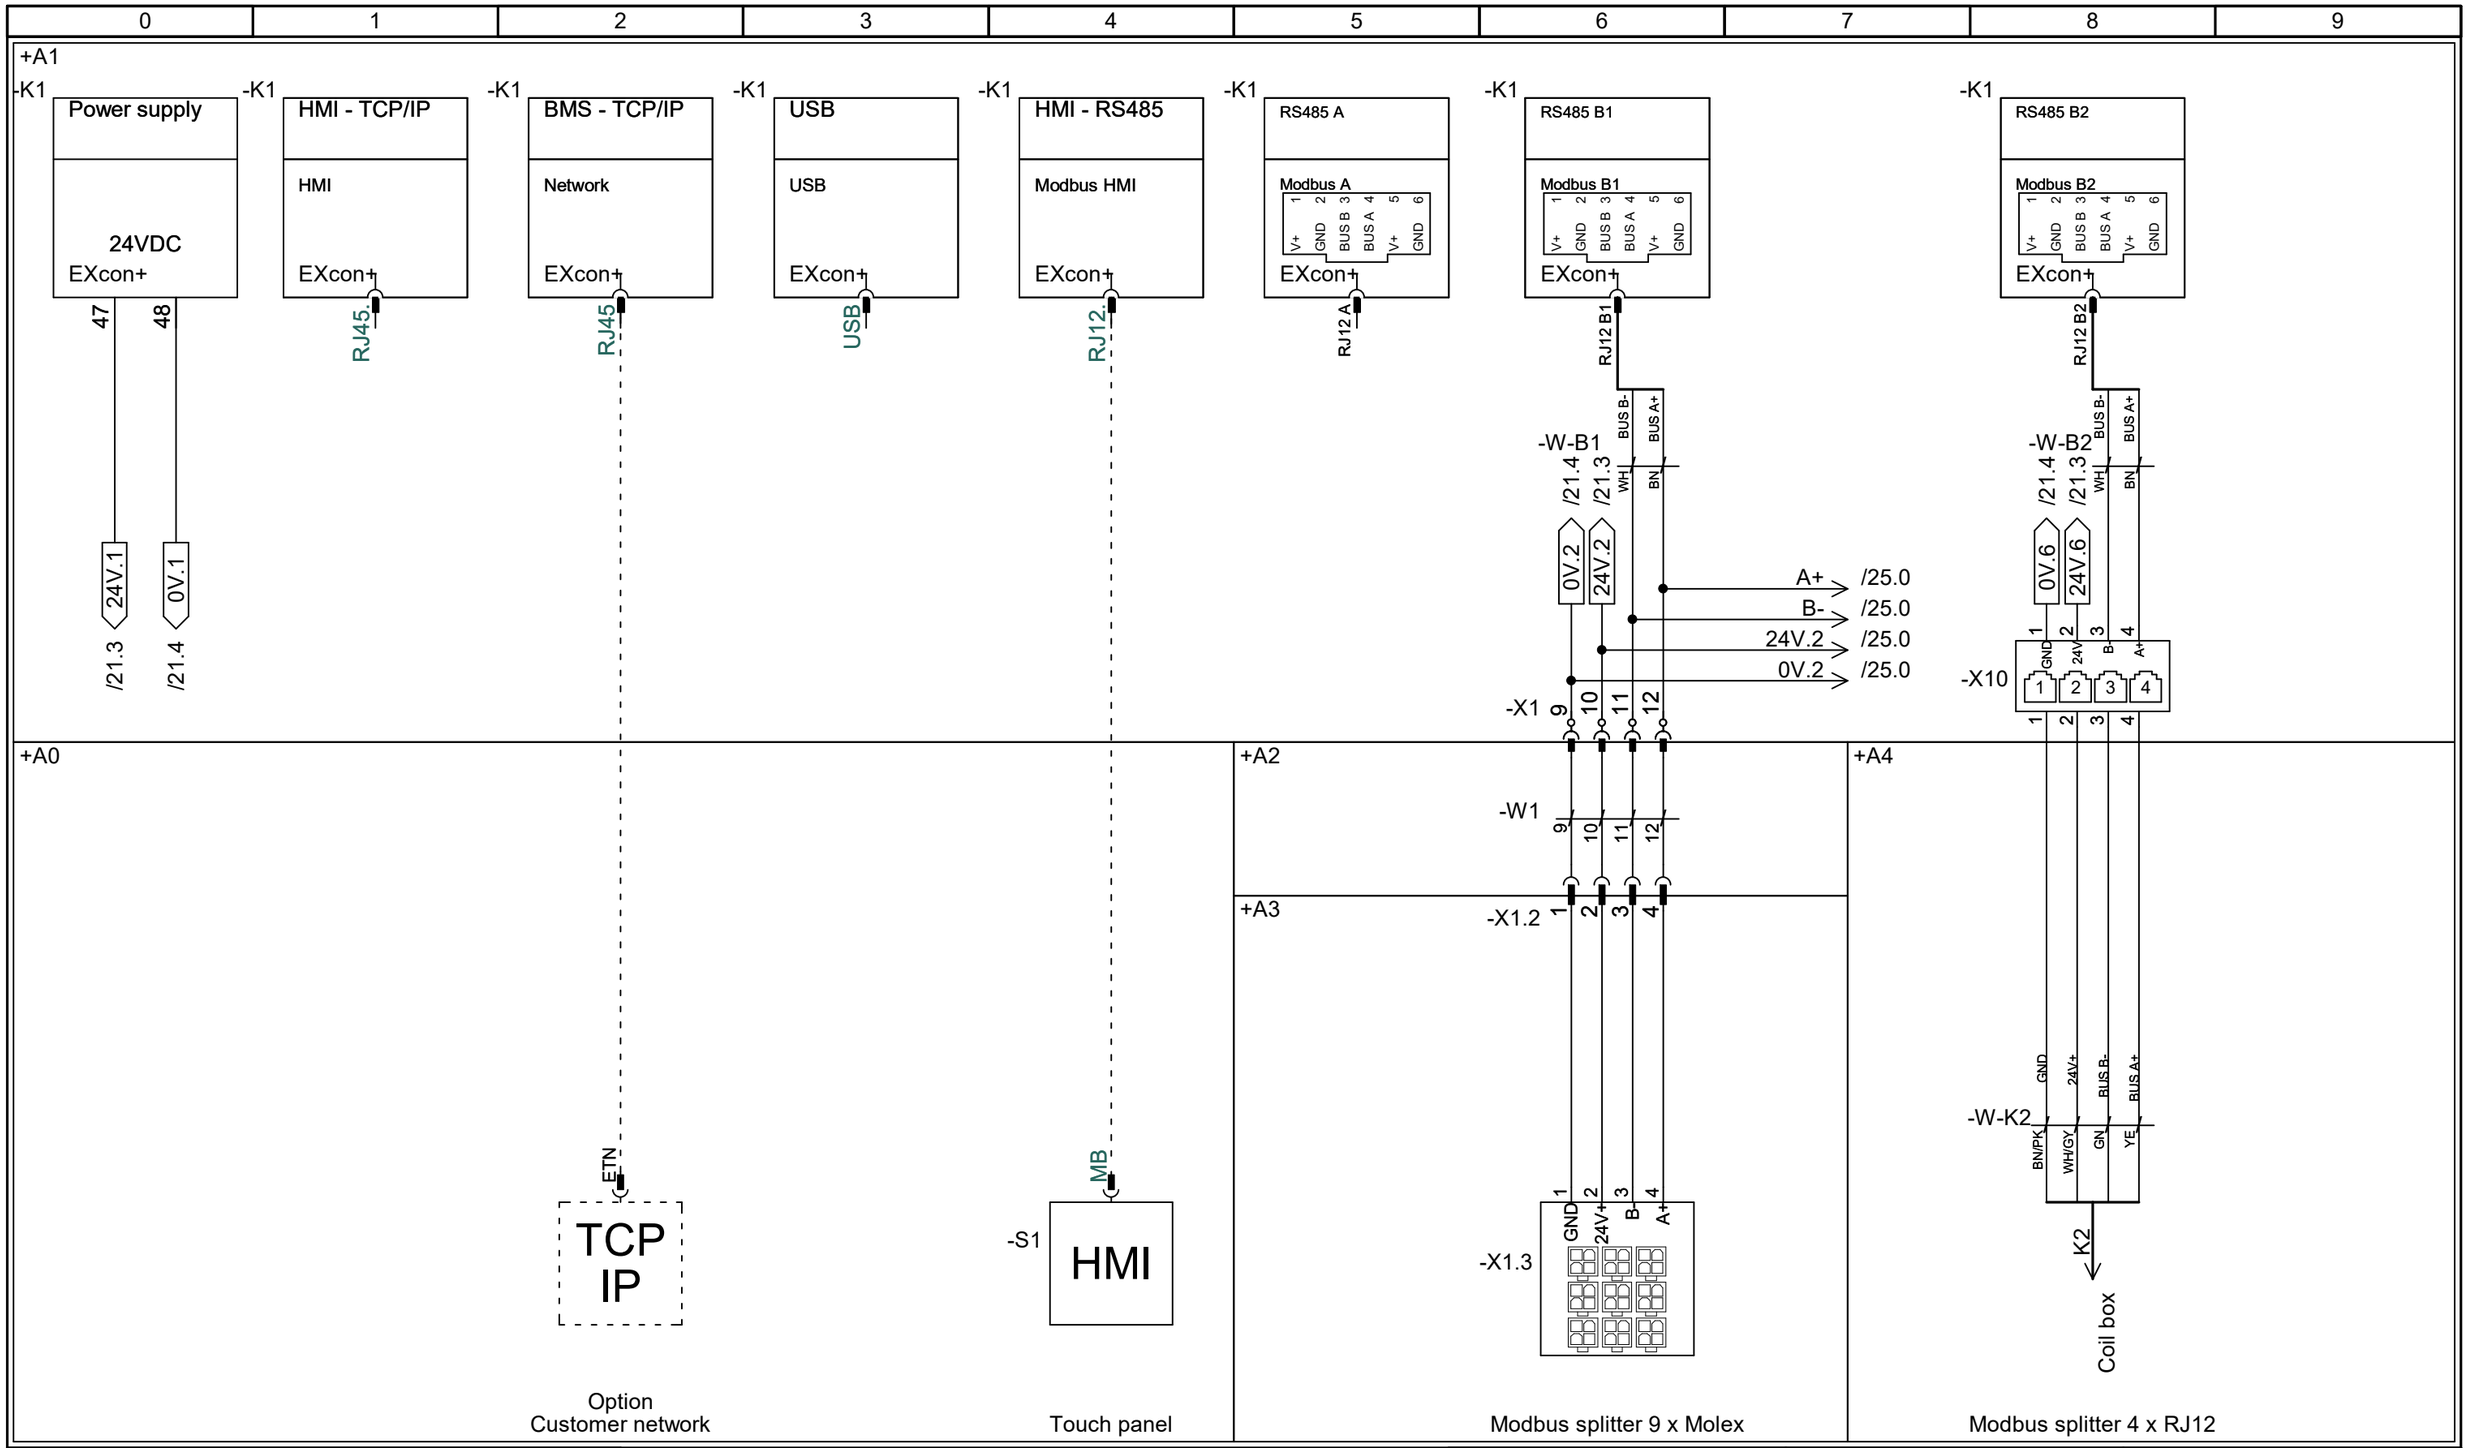

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 22	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 21	
Drawing number: 2028125	Revision: C	Page Title: Standard - Modbus connections	Replaces: B	Scale: 1:1	Next page: 23	
			EC no.: -	Format: A3	Pages in total: 36	

0	1	2	3	4	5	6	7	8	9

+A1

Rotor drive option

Counter-flow option

+A3

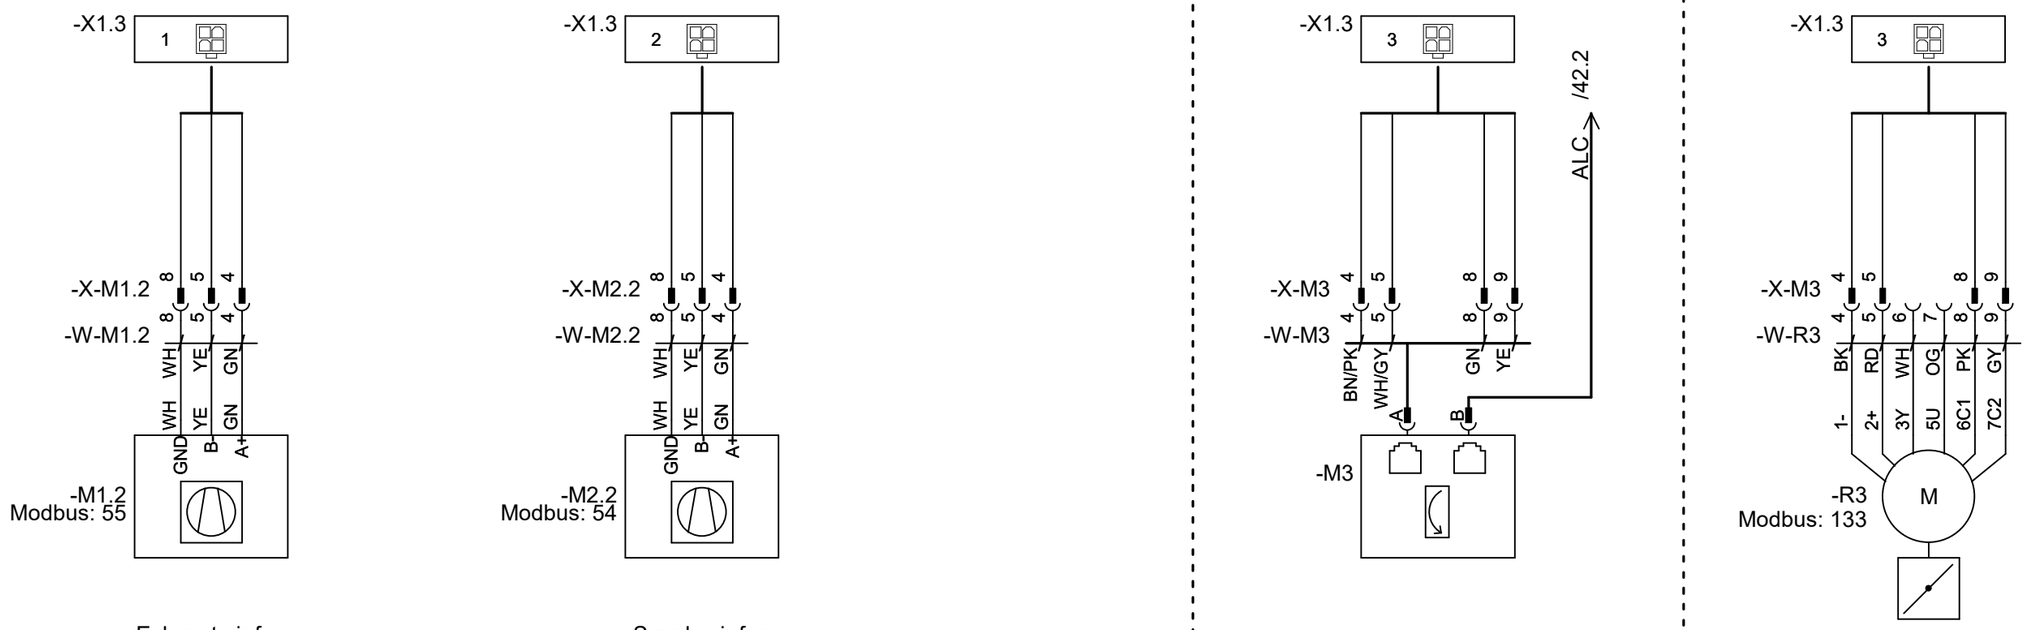

Exhaust air fan Control

Supply air fan Control

Rotor drive

Bypass damper

EXHAUSTO	Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 23		
		Revision date: 21-10-2025	Approved by: DKBP	Previous page: 22		
Drawing number: 2028125	Revision: C	Page Title: Standard - Fan & Rotor/Bypass controls	Replaces: B	Scale: 1:1	Next page: 24	
			EC no.: -	Format: A3	Pages in total: 36	

0	1	2	3	4	5	6	7	8	9

+A1

+A3

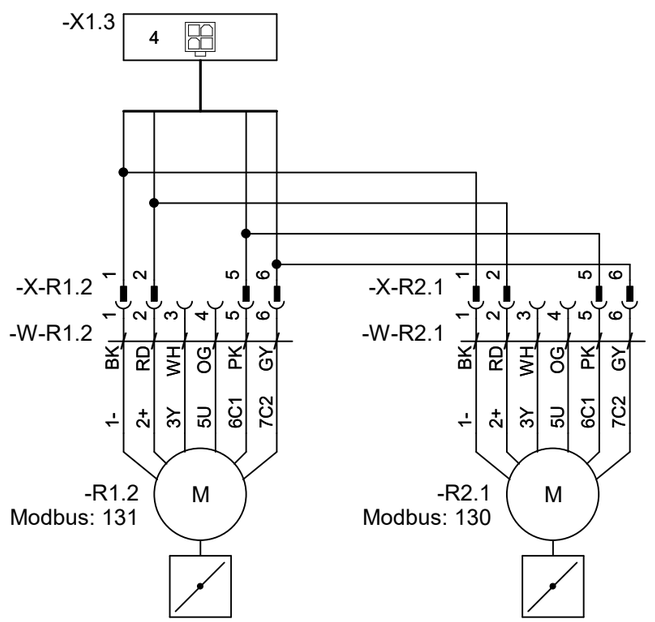

Exhaust air damper

Outdoor air damper

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: 24
			Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 23
Drawing number: 2028125	Revision: C	Page Title: Standard - Dampers	Replaces:	B	Scale:	1:1	Next page: 25
			EC no.:	-	Format:	A3	Pages in total: 36

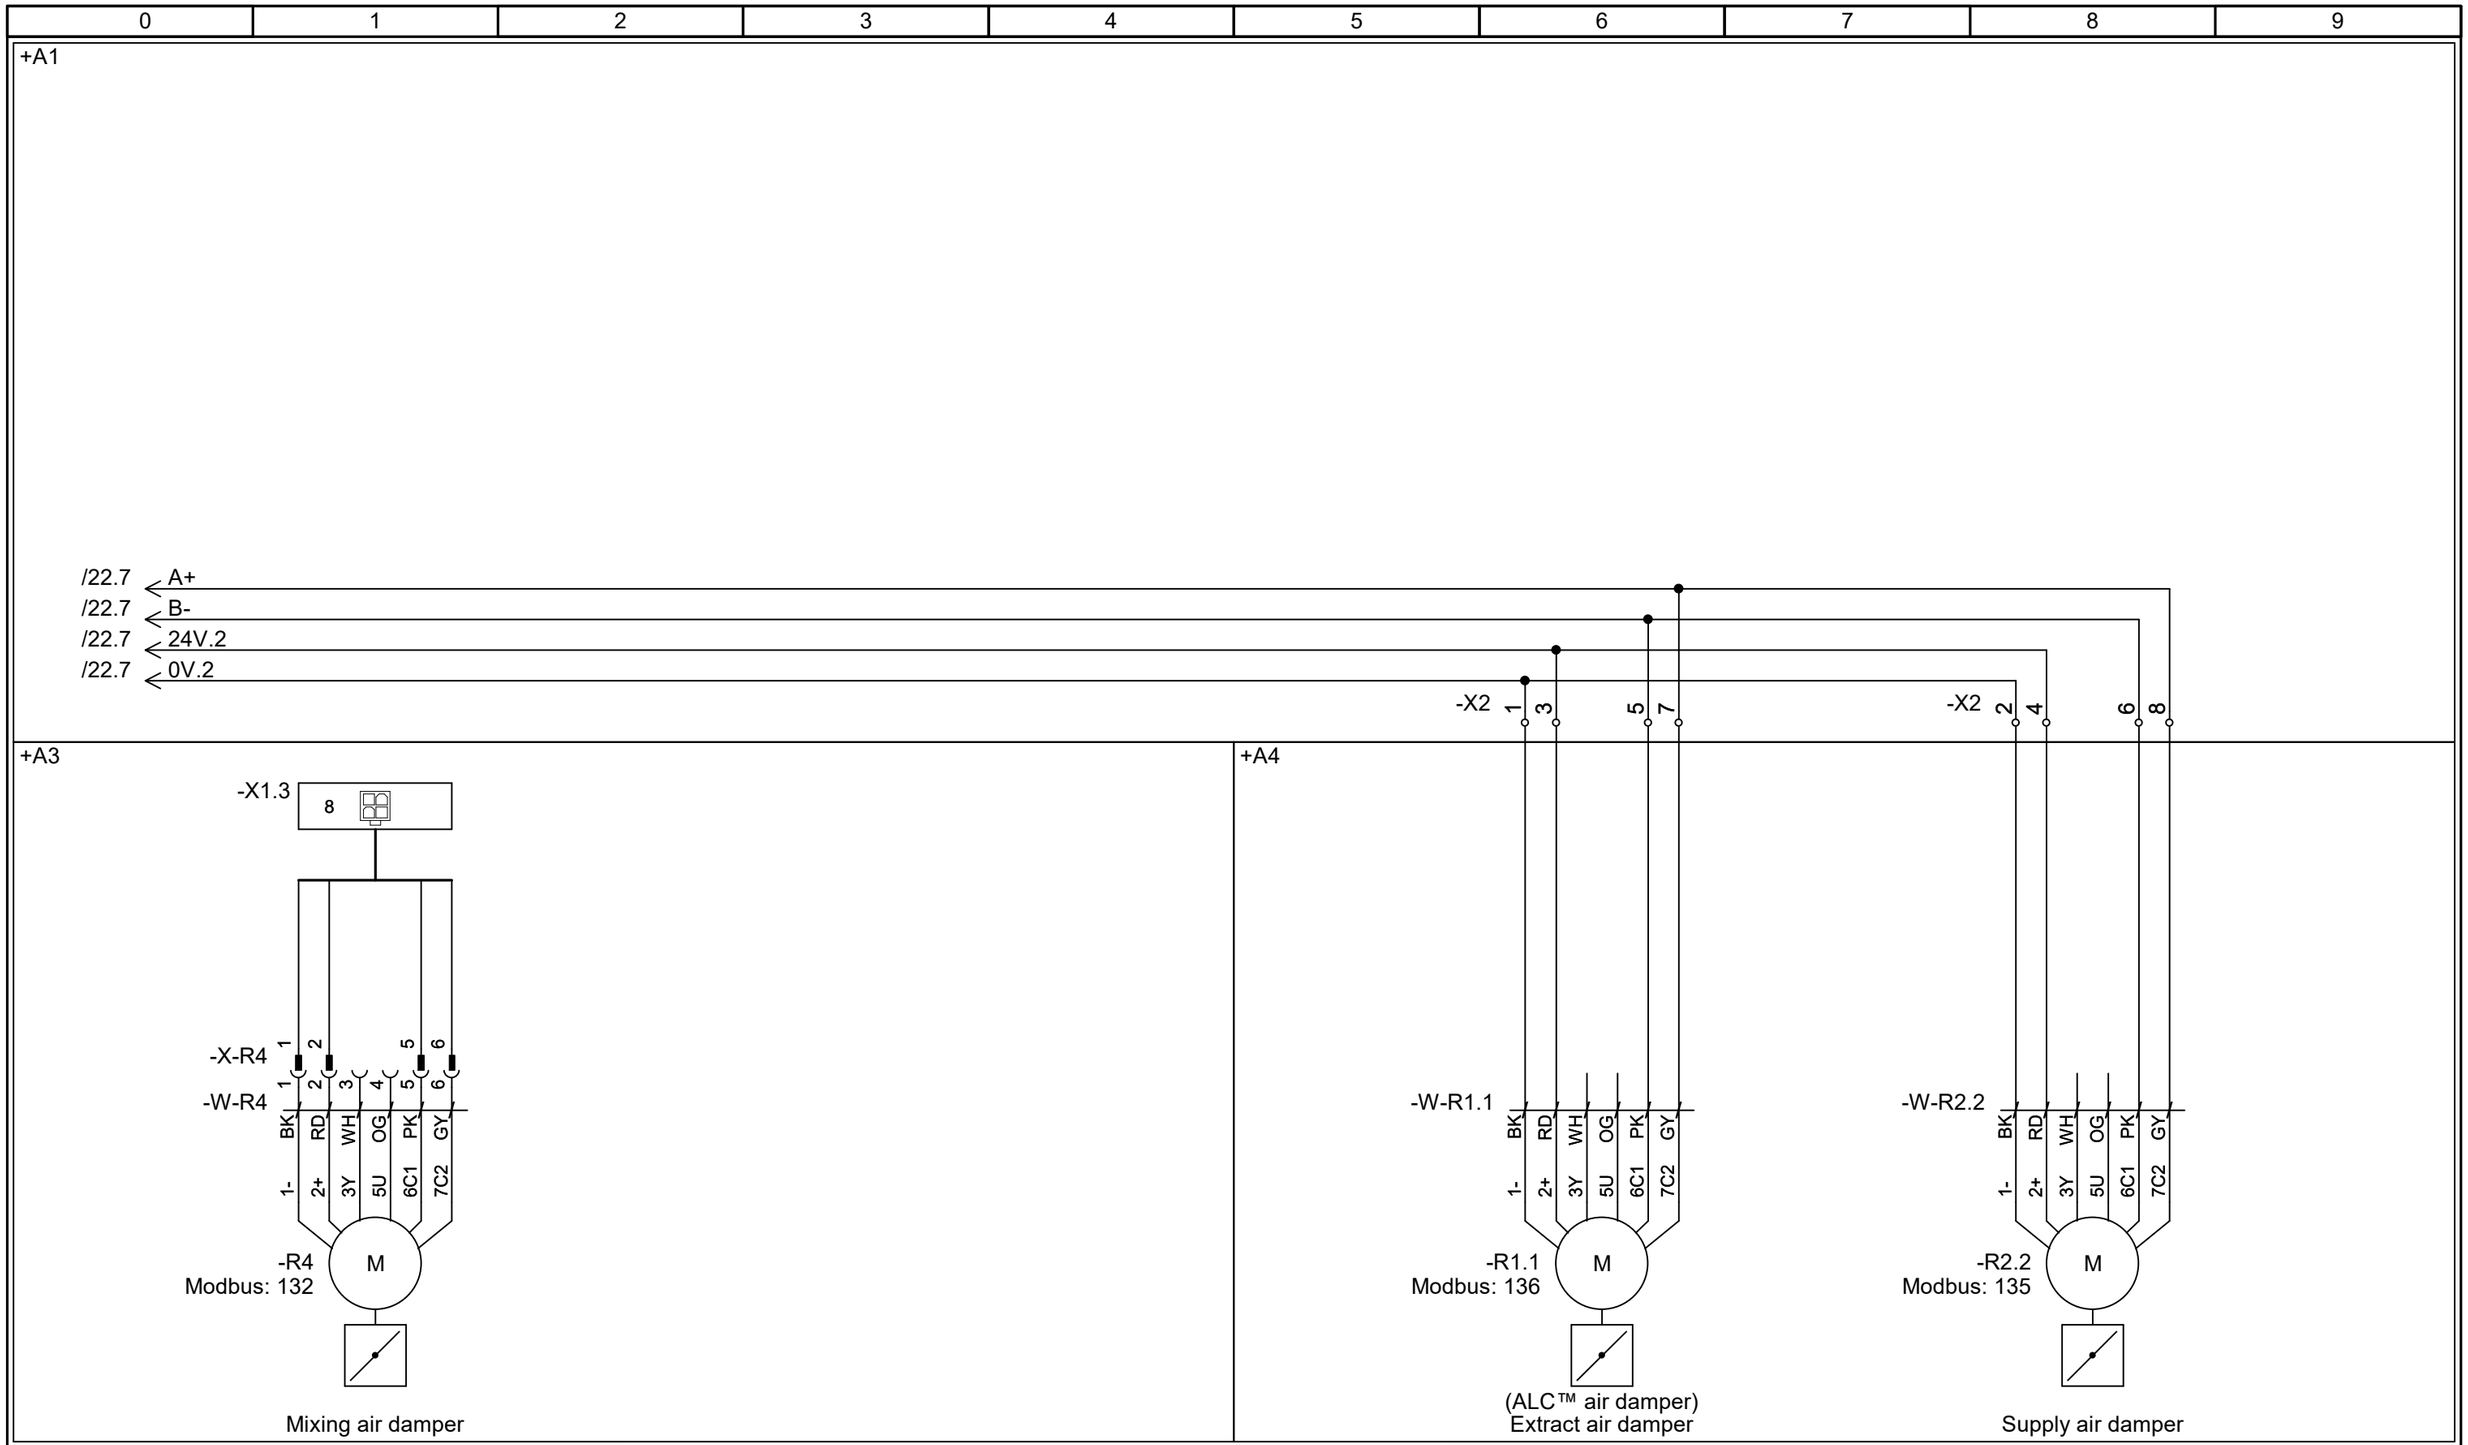

EXHAUSTO	Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 25	
		Revision date: 21-10-2025	Approved by: DKBP	Previous page: 24	
Drawing number: 2028125	Revision: C	Page Title: Options - Dampers	Replaces: B	Scale: 1:1	Next page: 26
			EC no.: -	Format: A3	Pages in total: 36

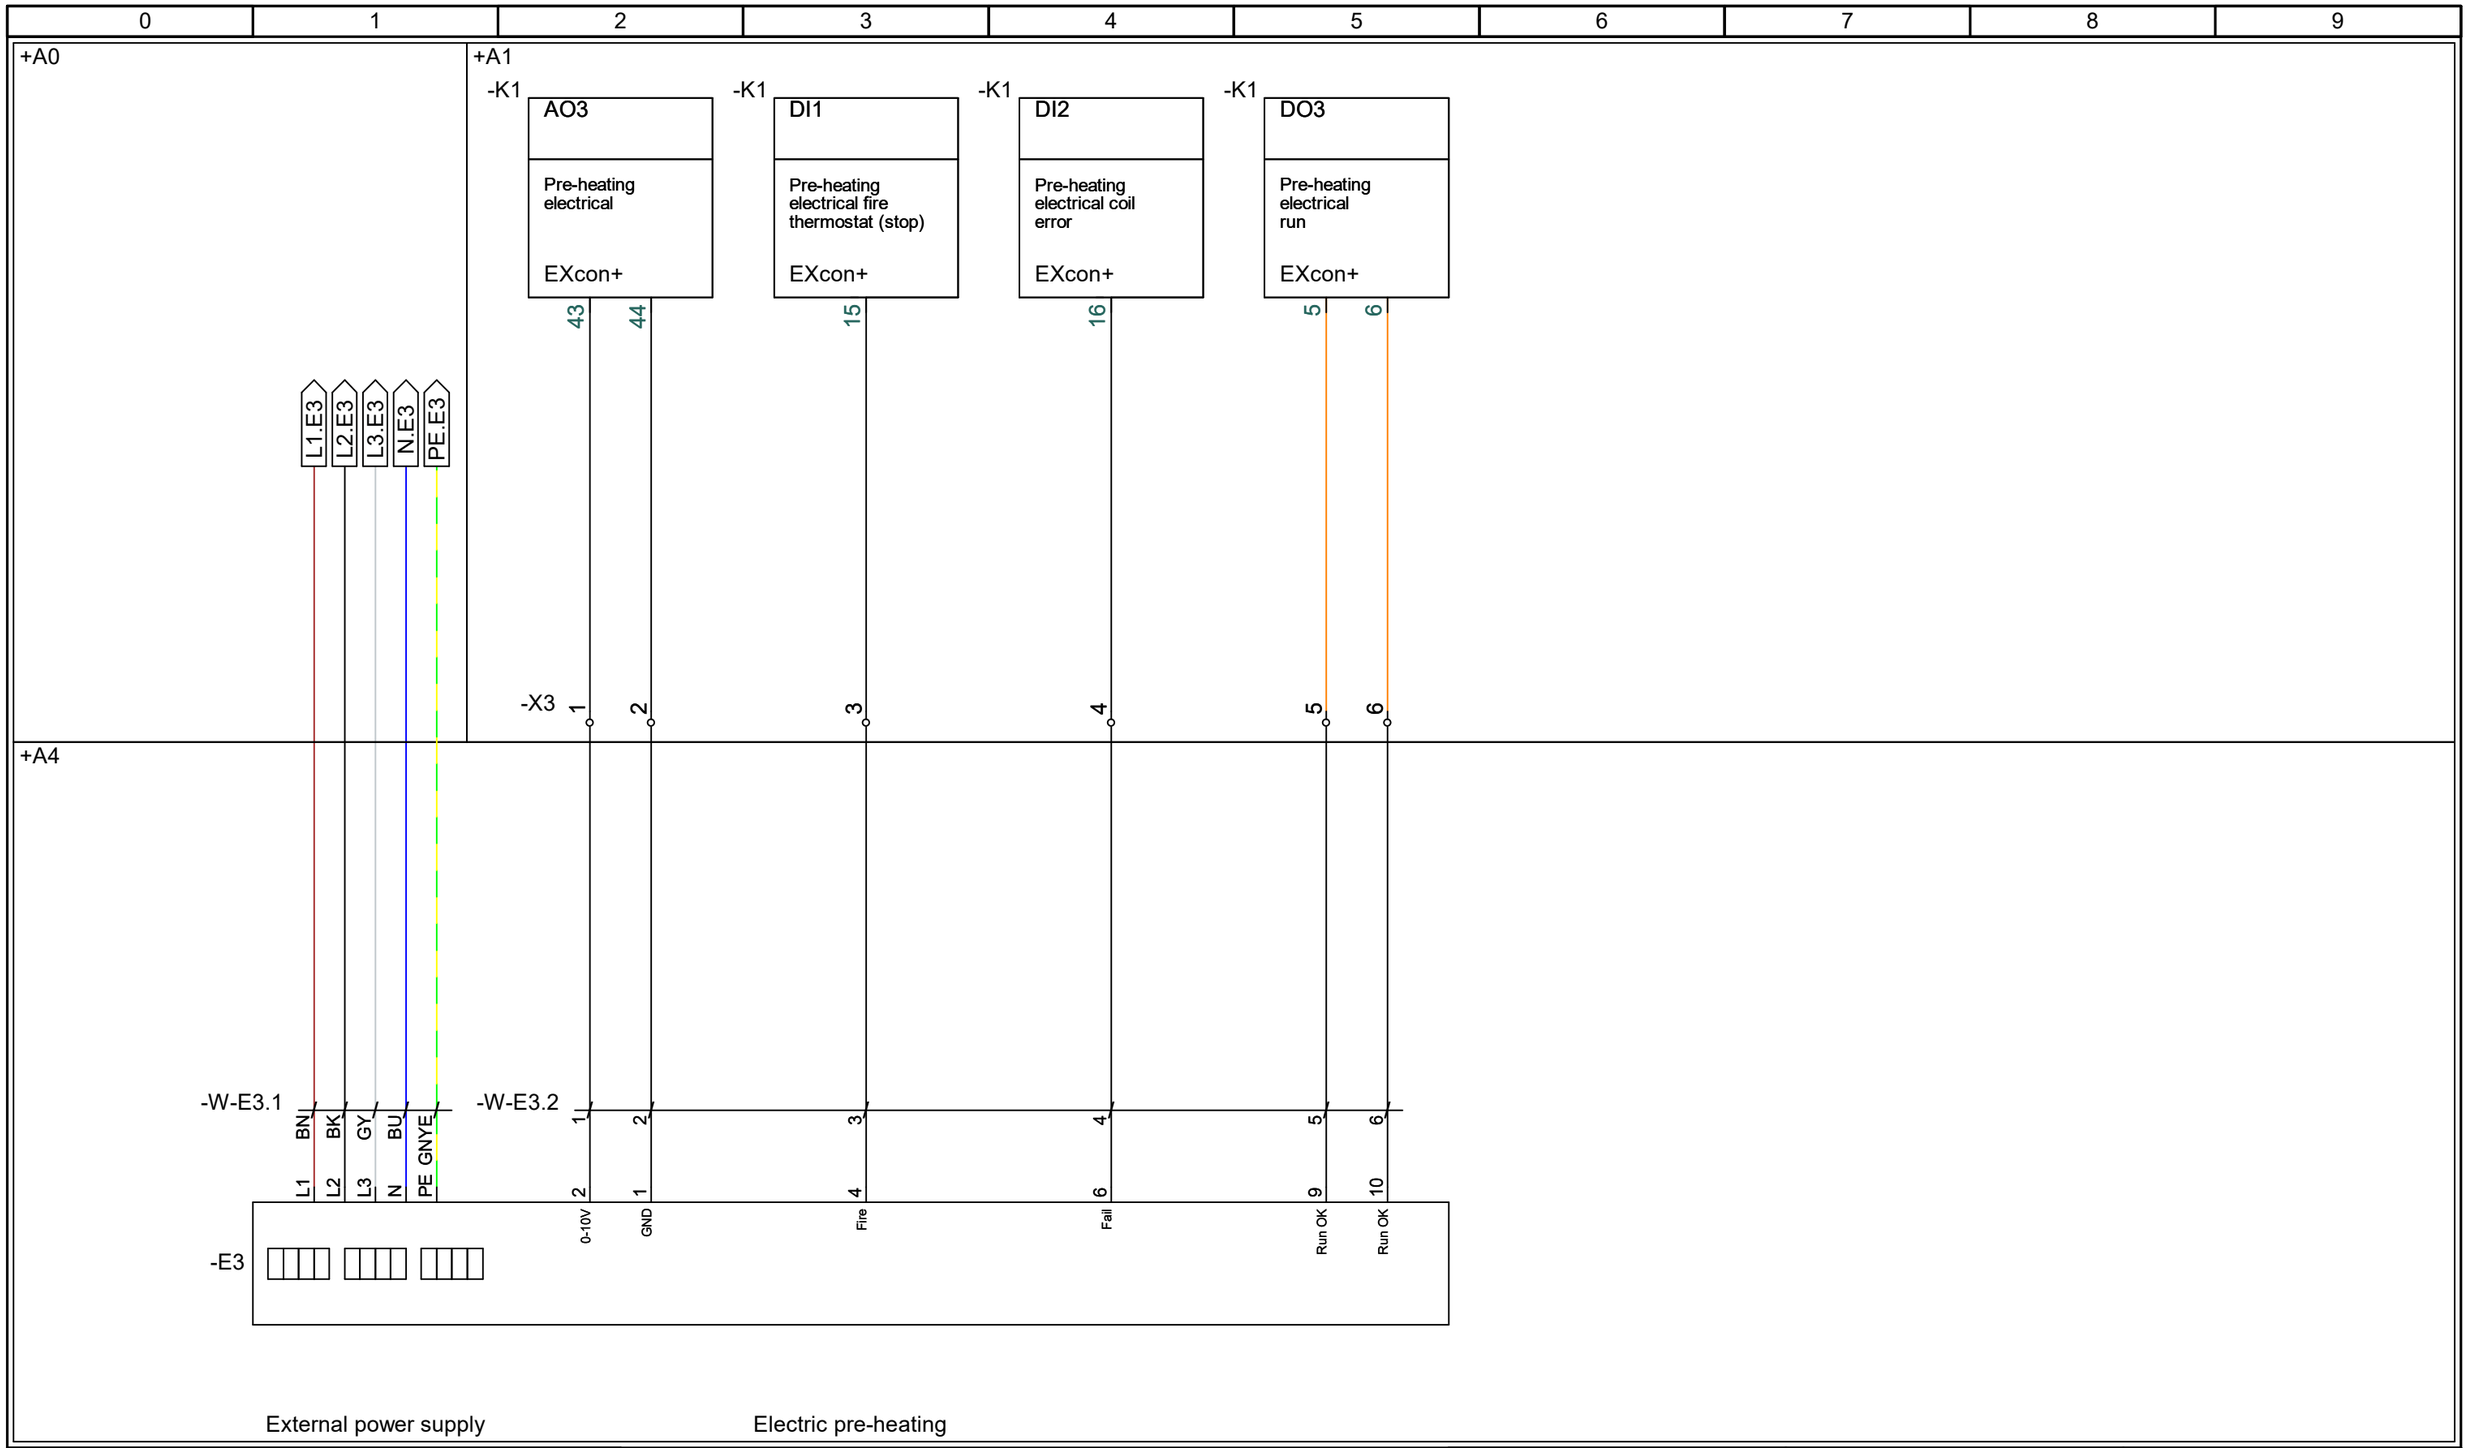

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 26	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 25	
Drawing number: 2028125	Revision: C	Page Title: Options - Pre-heating controls	Replaces: B	Scale: 1:1	Next page: 27	
			EC no.: -	Format: A3	Pages in total: 36	

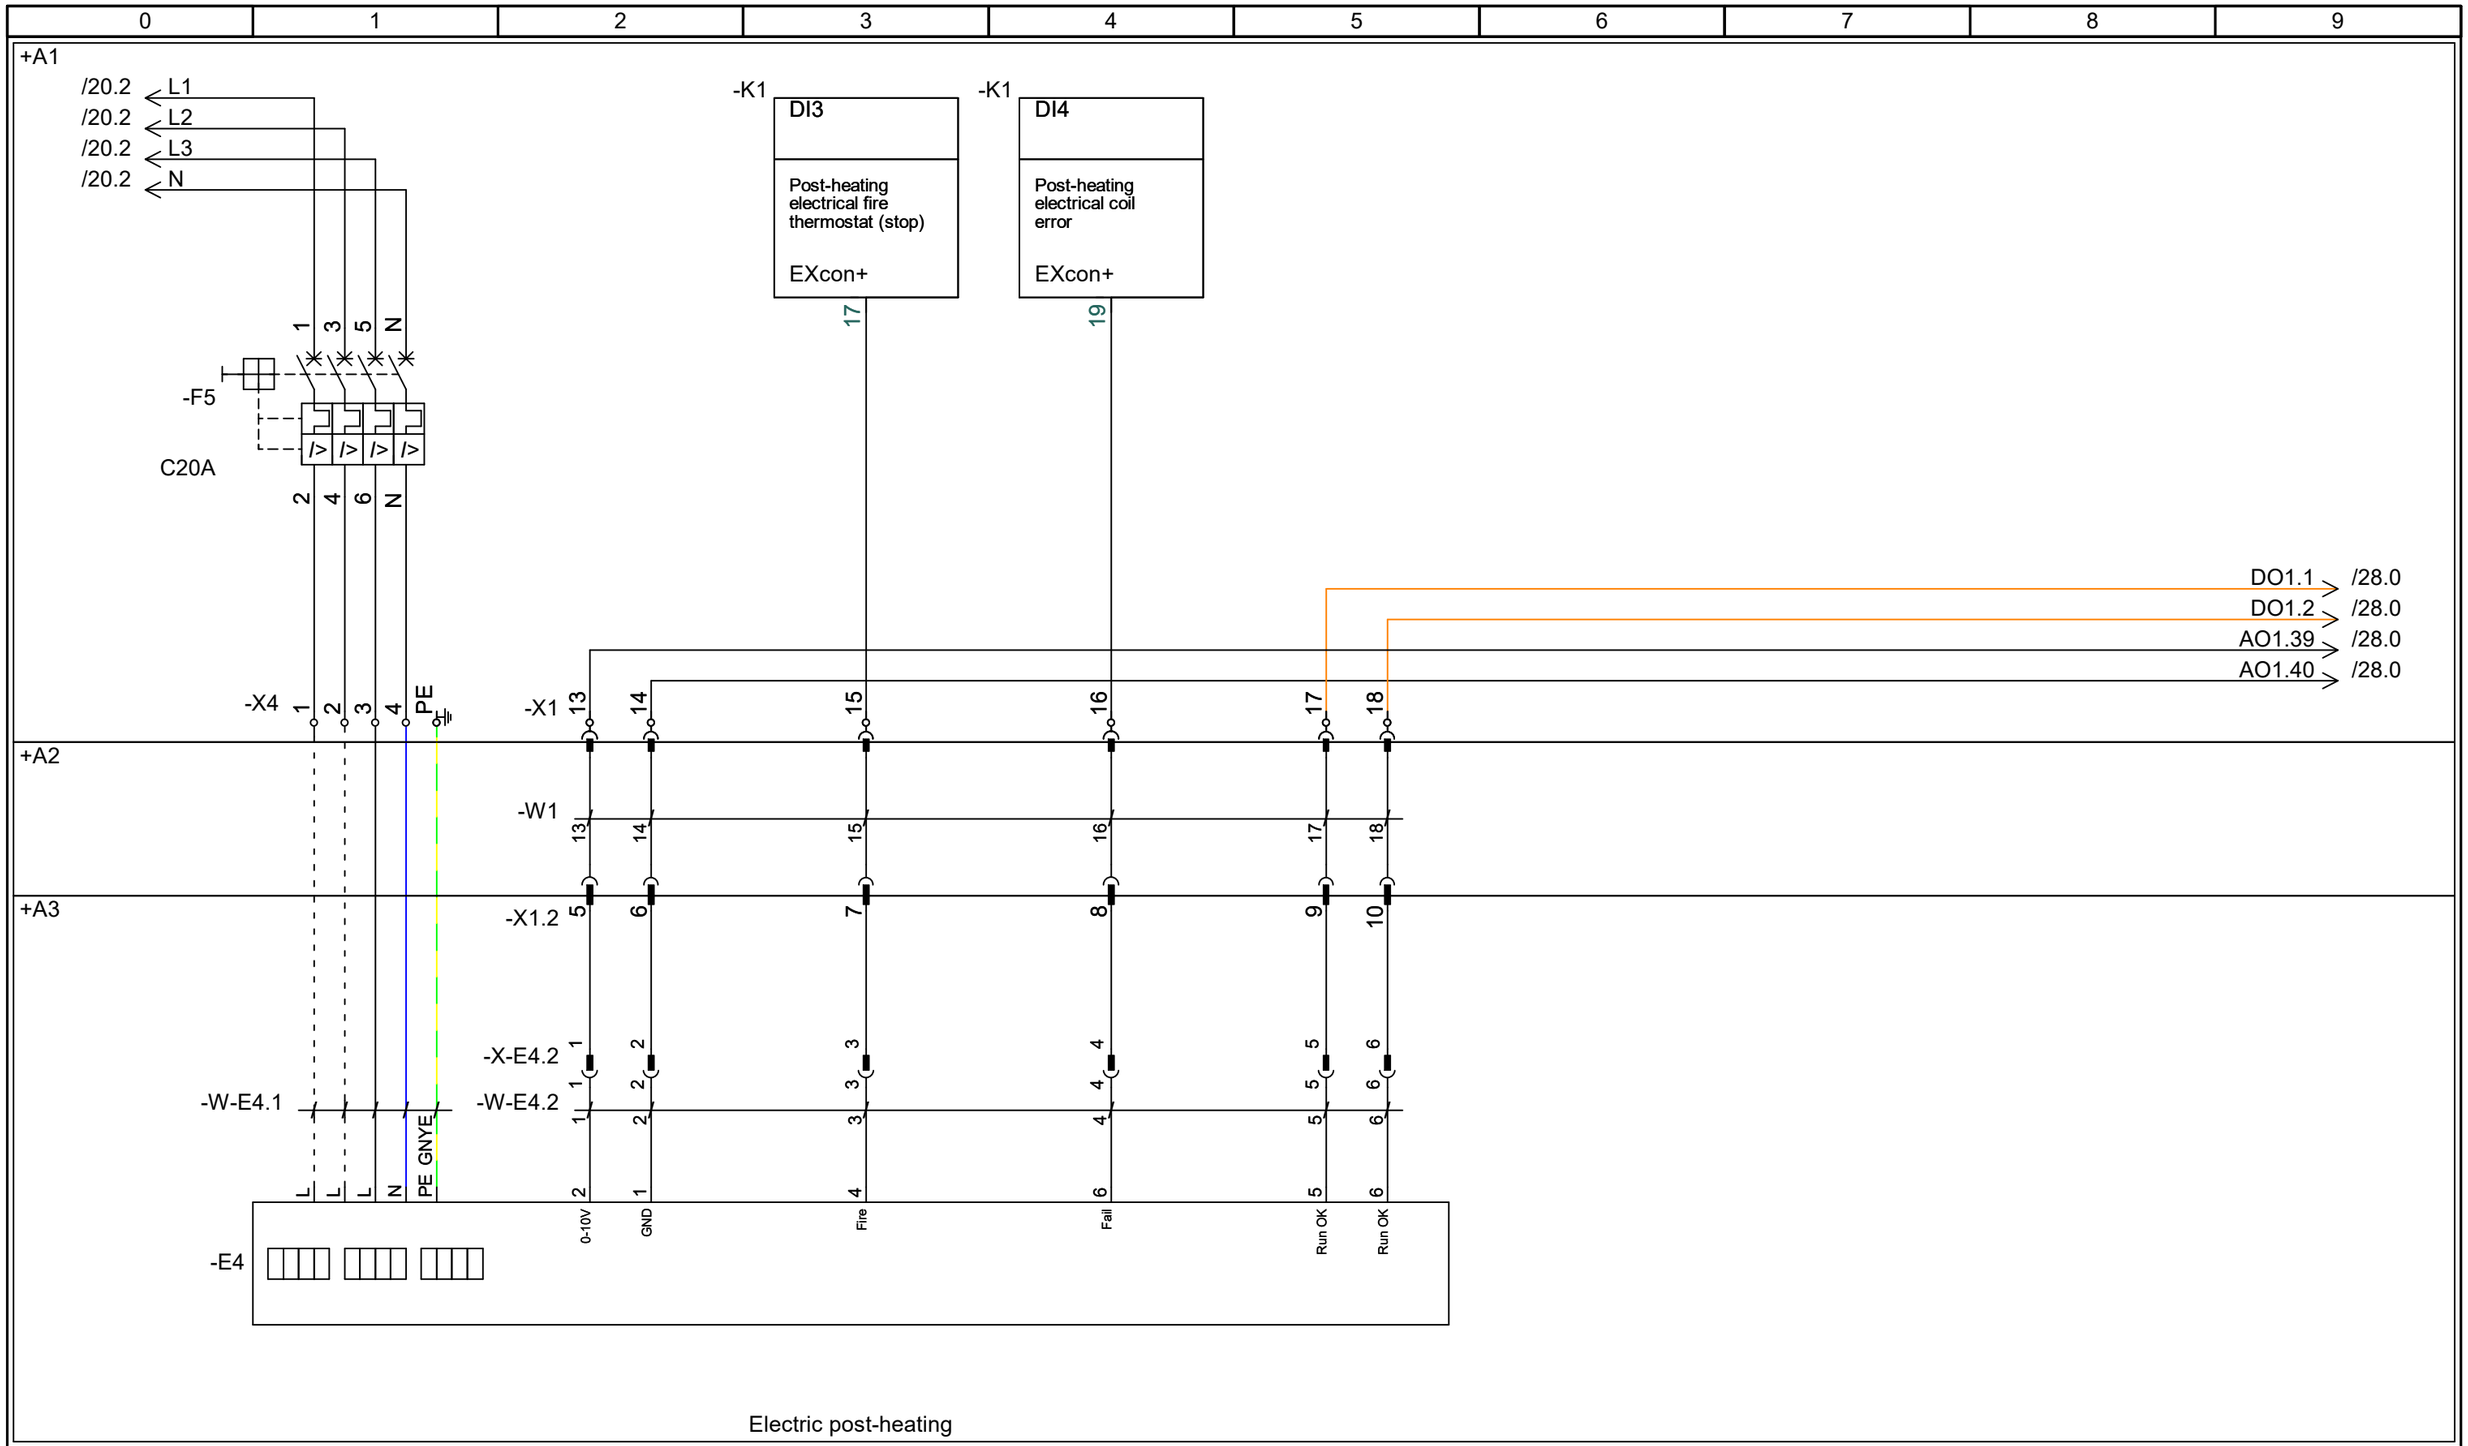

Electric post-heating

EXHAUSTO	Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 27		
		Revision date: 21-10-2025	Approved by: DKBP	Previous page: 26		
Drawing number: 2028125	Revision: C	Page Title: Options - Post-heating controls	Replaces: B	Scale: 1:1	Next page: 28	
			EC no.: -	Format: A3	Pages in total: 36	

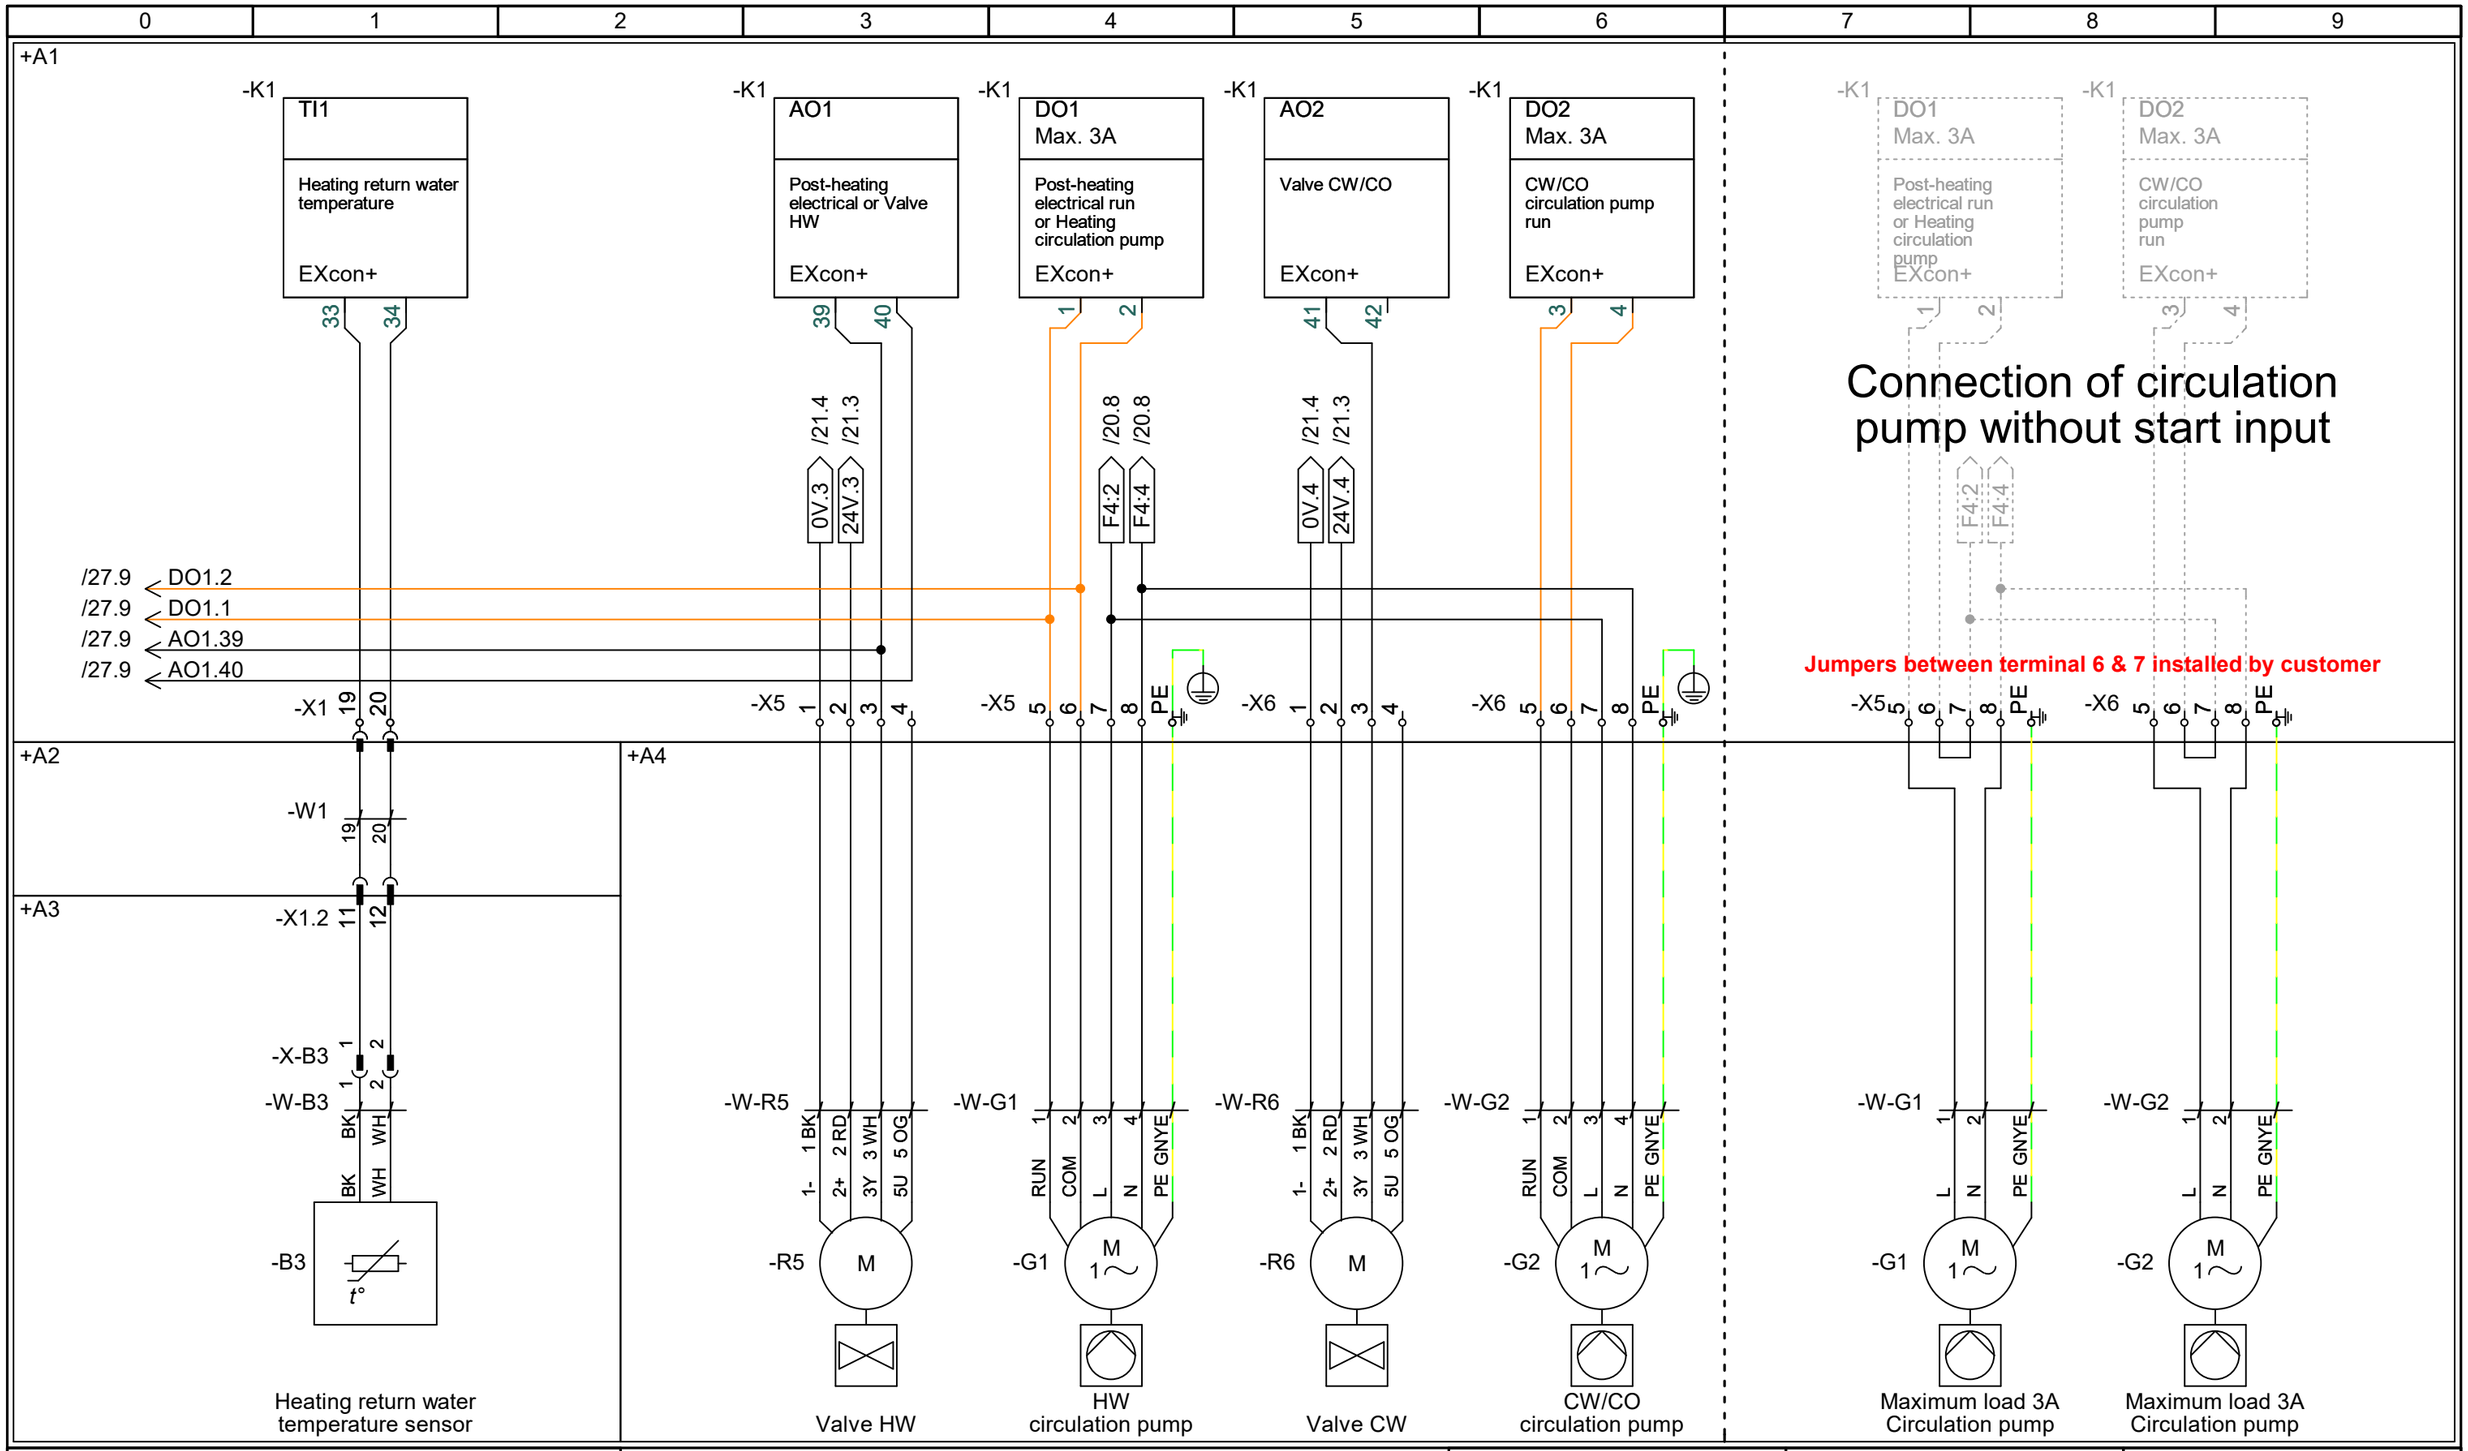

EXHAUSTO	Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: 28
		Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 27
Drawing number: 2028125	Revision: C	Replaces:	B	Scale:	1:1	Next page: 29
	Page Title: Options - HW/CW/CO controls	EC no.:	-	Format:	A3	Pages in total: 36

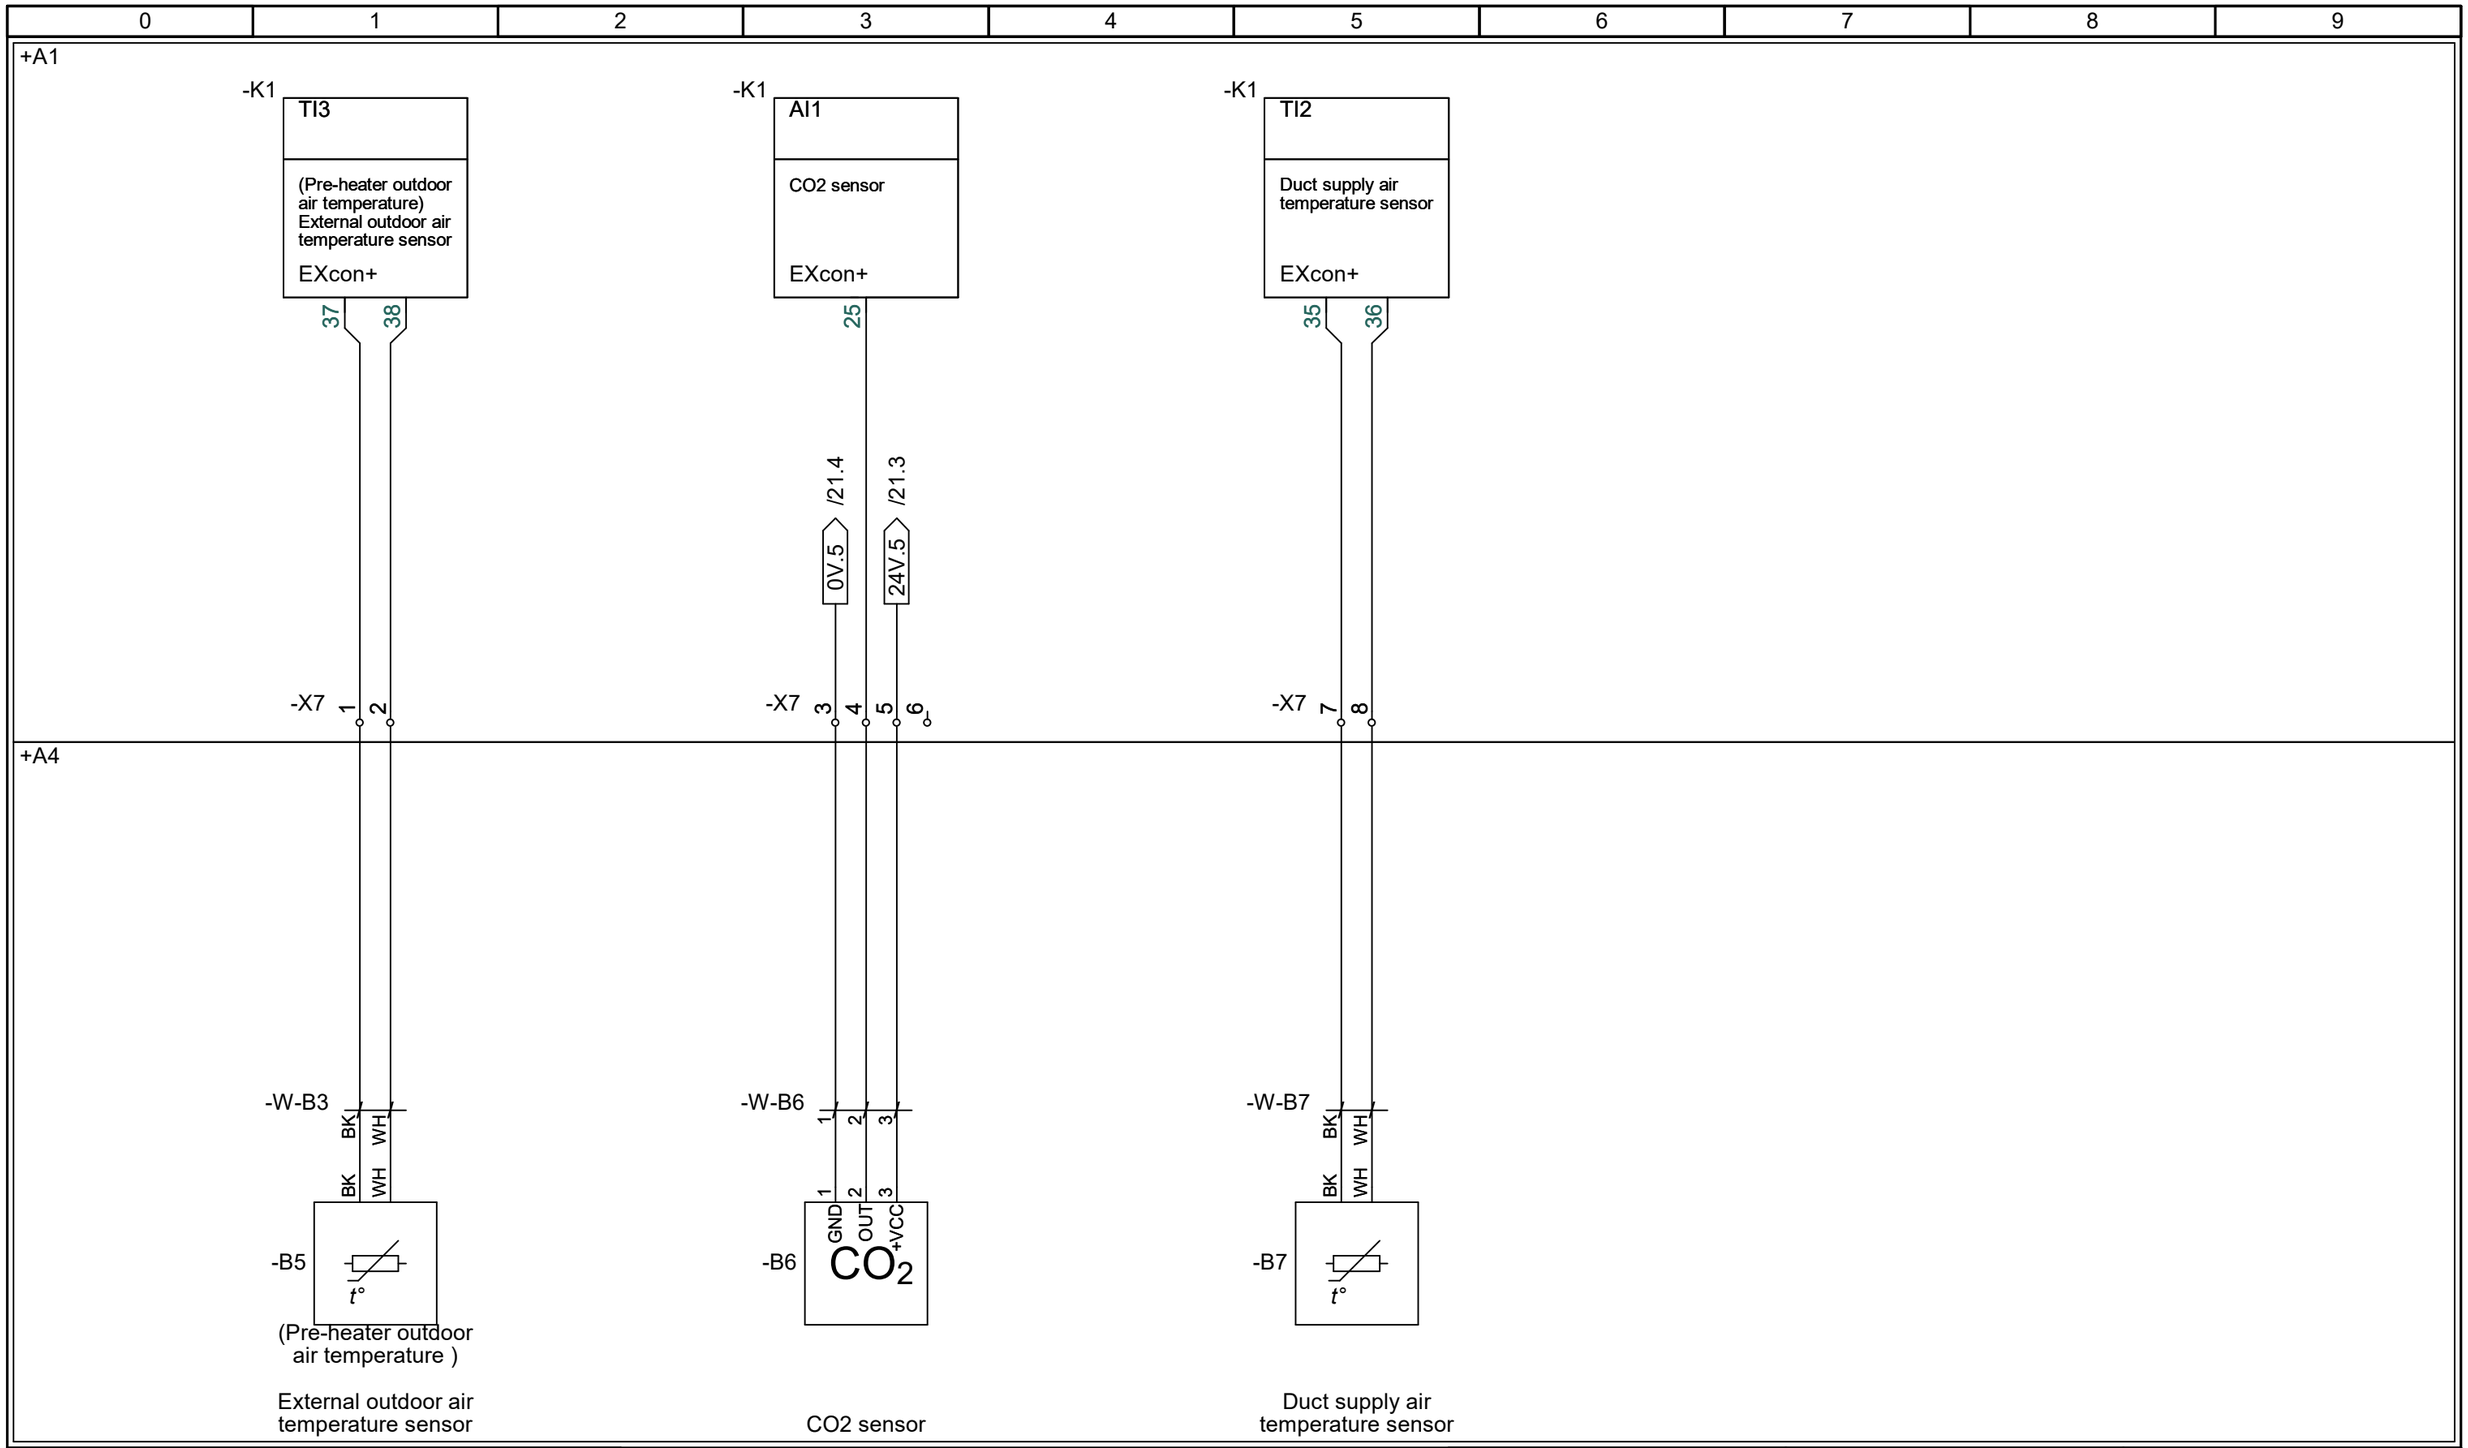

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 29	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 28	
Drawing number: 2028125	Revision: C	Page Title: Options - Temperature & CO2 sensors	Replaces: B	Scale: 1:1	Next page: 30	
			EC no.: -	Format: A3	Pages in total: 36	

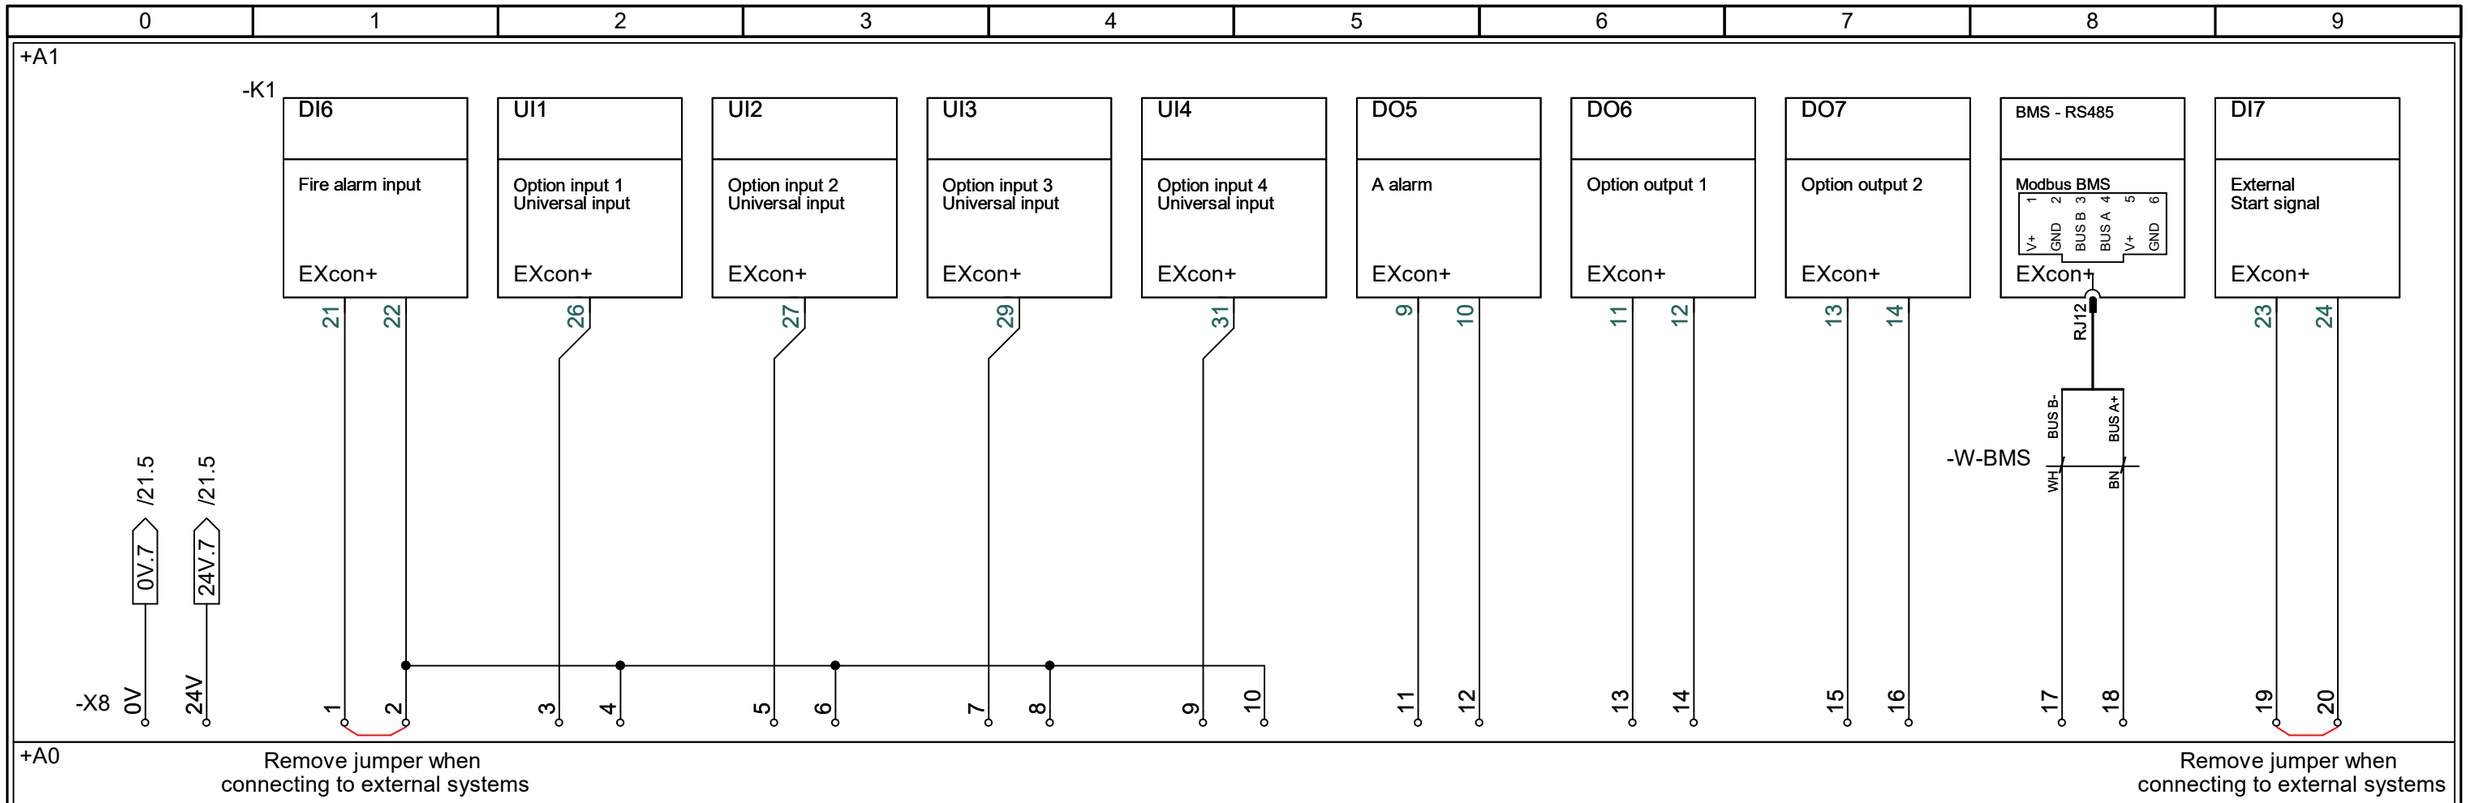

IO	Default setting	Comment
Digital input 6	Fire alarm	Mandatory
Universal input 1 - Option 1	External High Speed mode	-
Universal input 2 - Option 2	External Medium Speed mode	Can change depending on the coil configuration
Universal input 3 - Option 3	External Low Speed mode	Can change depending on the coil configuration
Universal input 4 - Option 4	External resetting of alarms	Can change depending on the coil configuration
Digital output 5	"A" alarm	Mandatory
Digital output 6 - Option 1	User relay	-
Digital output 7 - Option 2	Operating relay	-
RS485	Modbus BMS	-
Digital input 7	External Start signal	Mandatory

For further information on connecting accessories, see document 3006851

Pressure & temperature transmitters

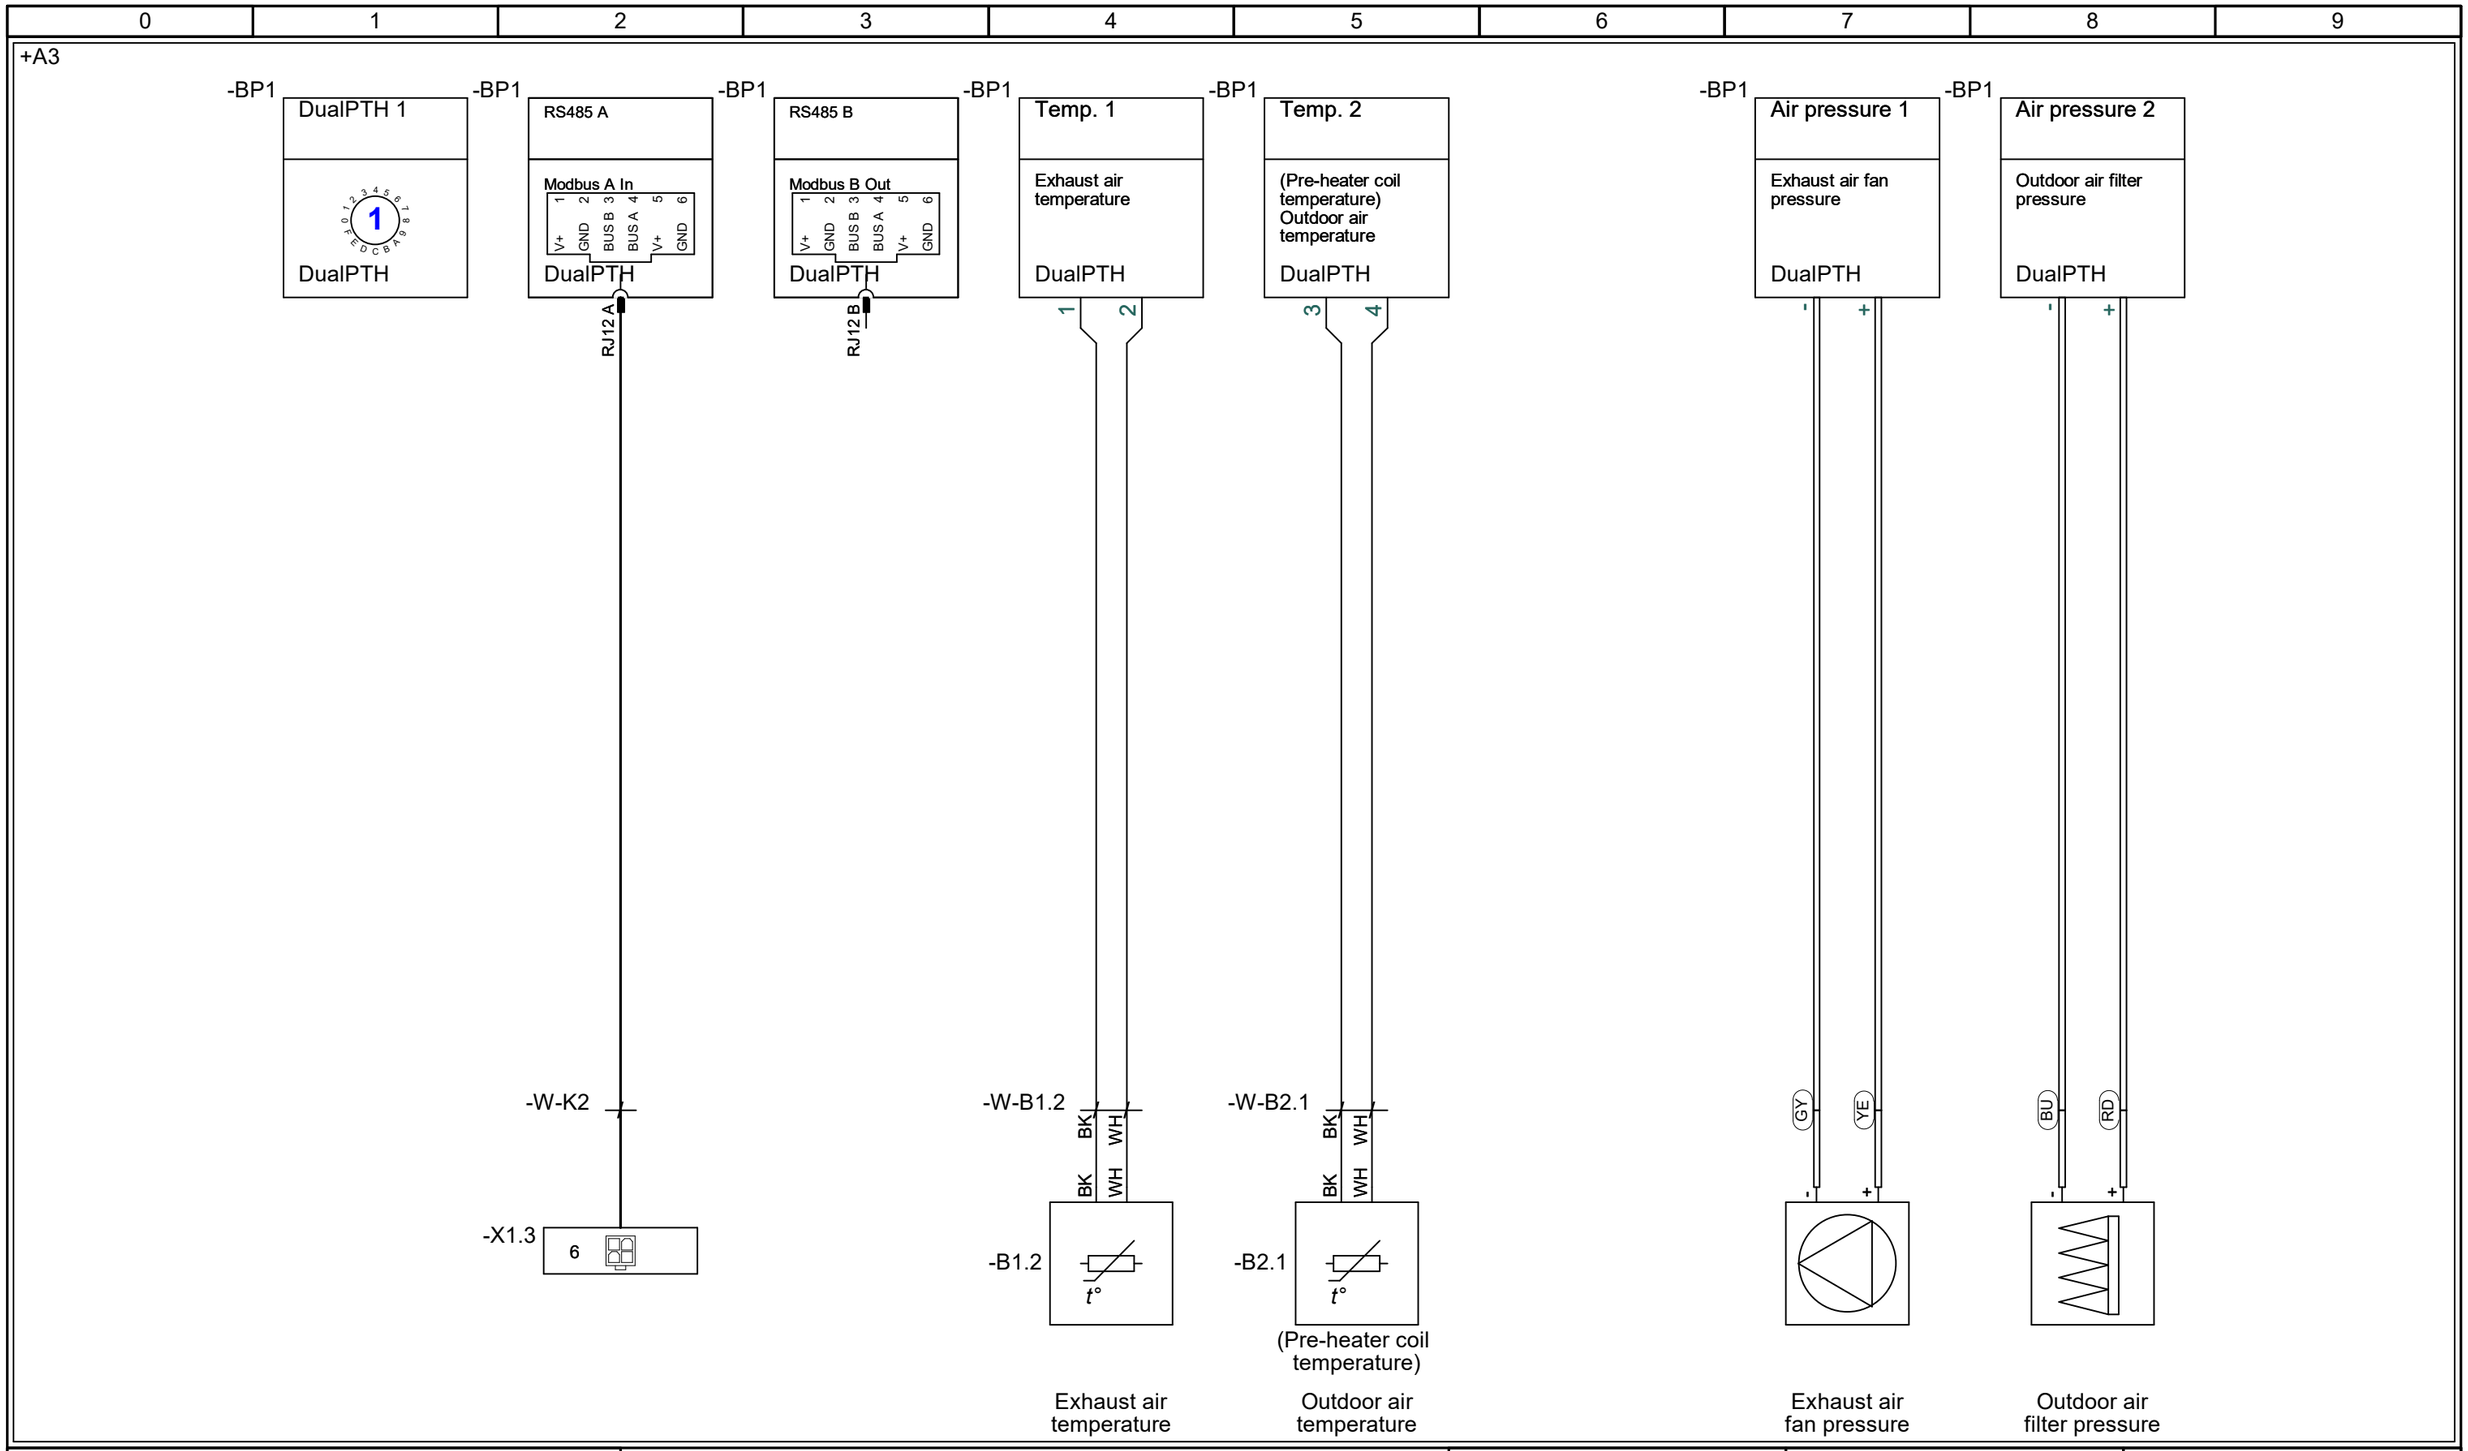

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 40	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 30	
Drawing number: 2028125	Revision: C	Page Title: Standard - Dual PTH 1	Replaces: B	Scale: 1:1	Next page: 41	
			EC no.: -	Format: A3	Pages in total: 36	

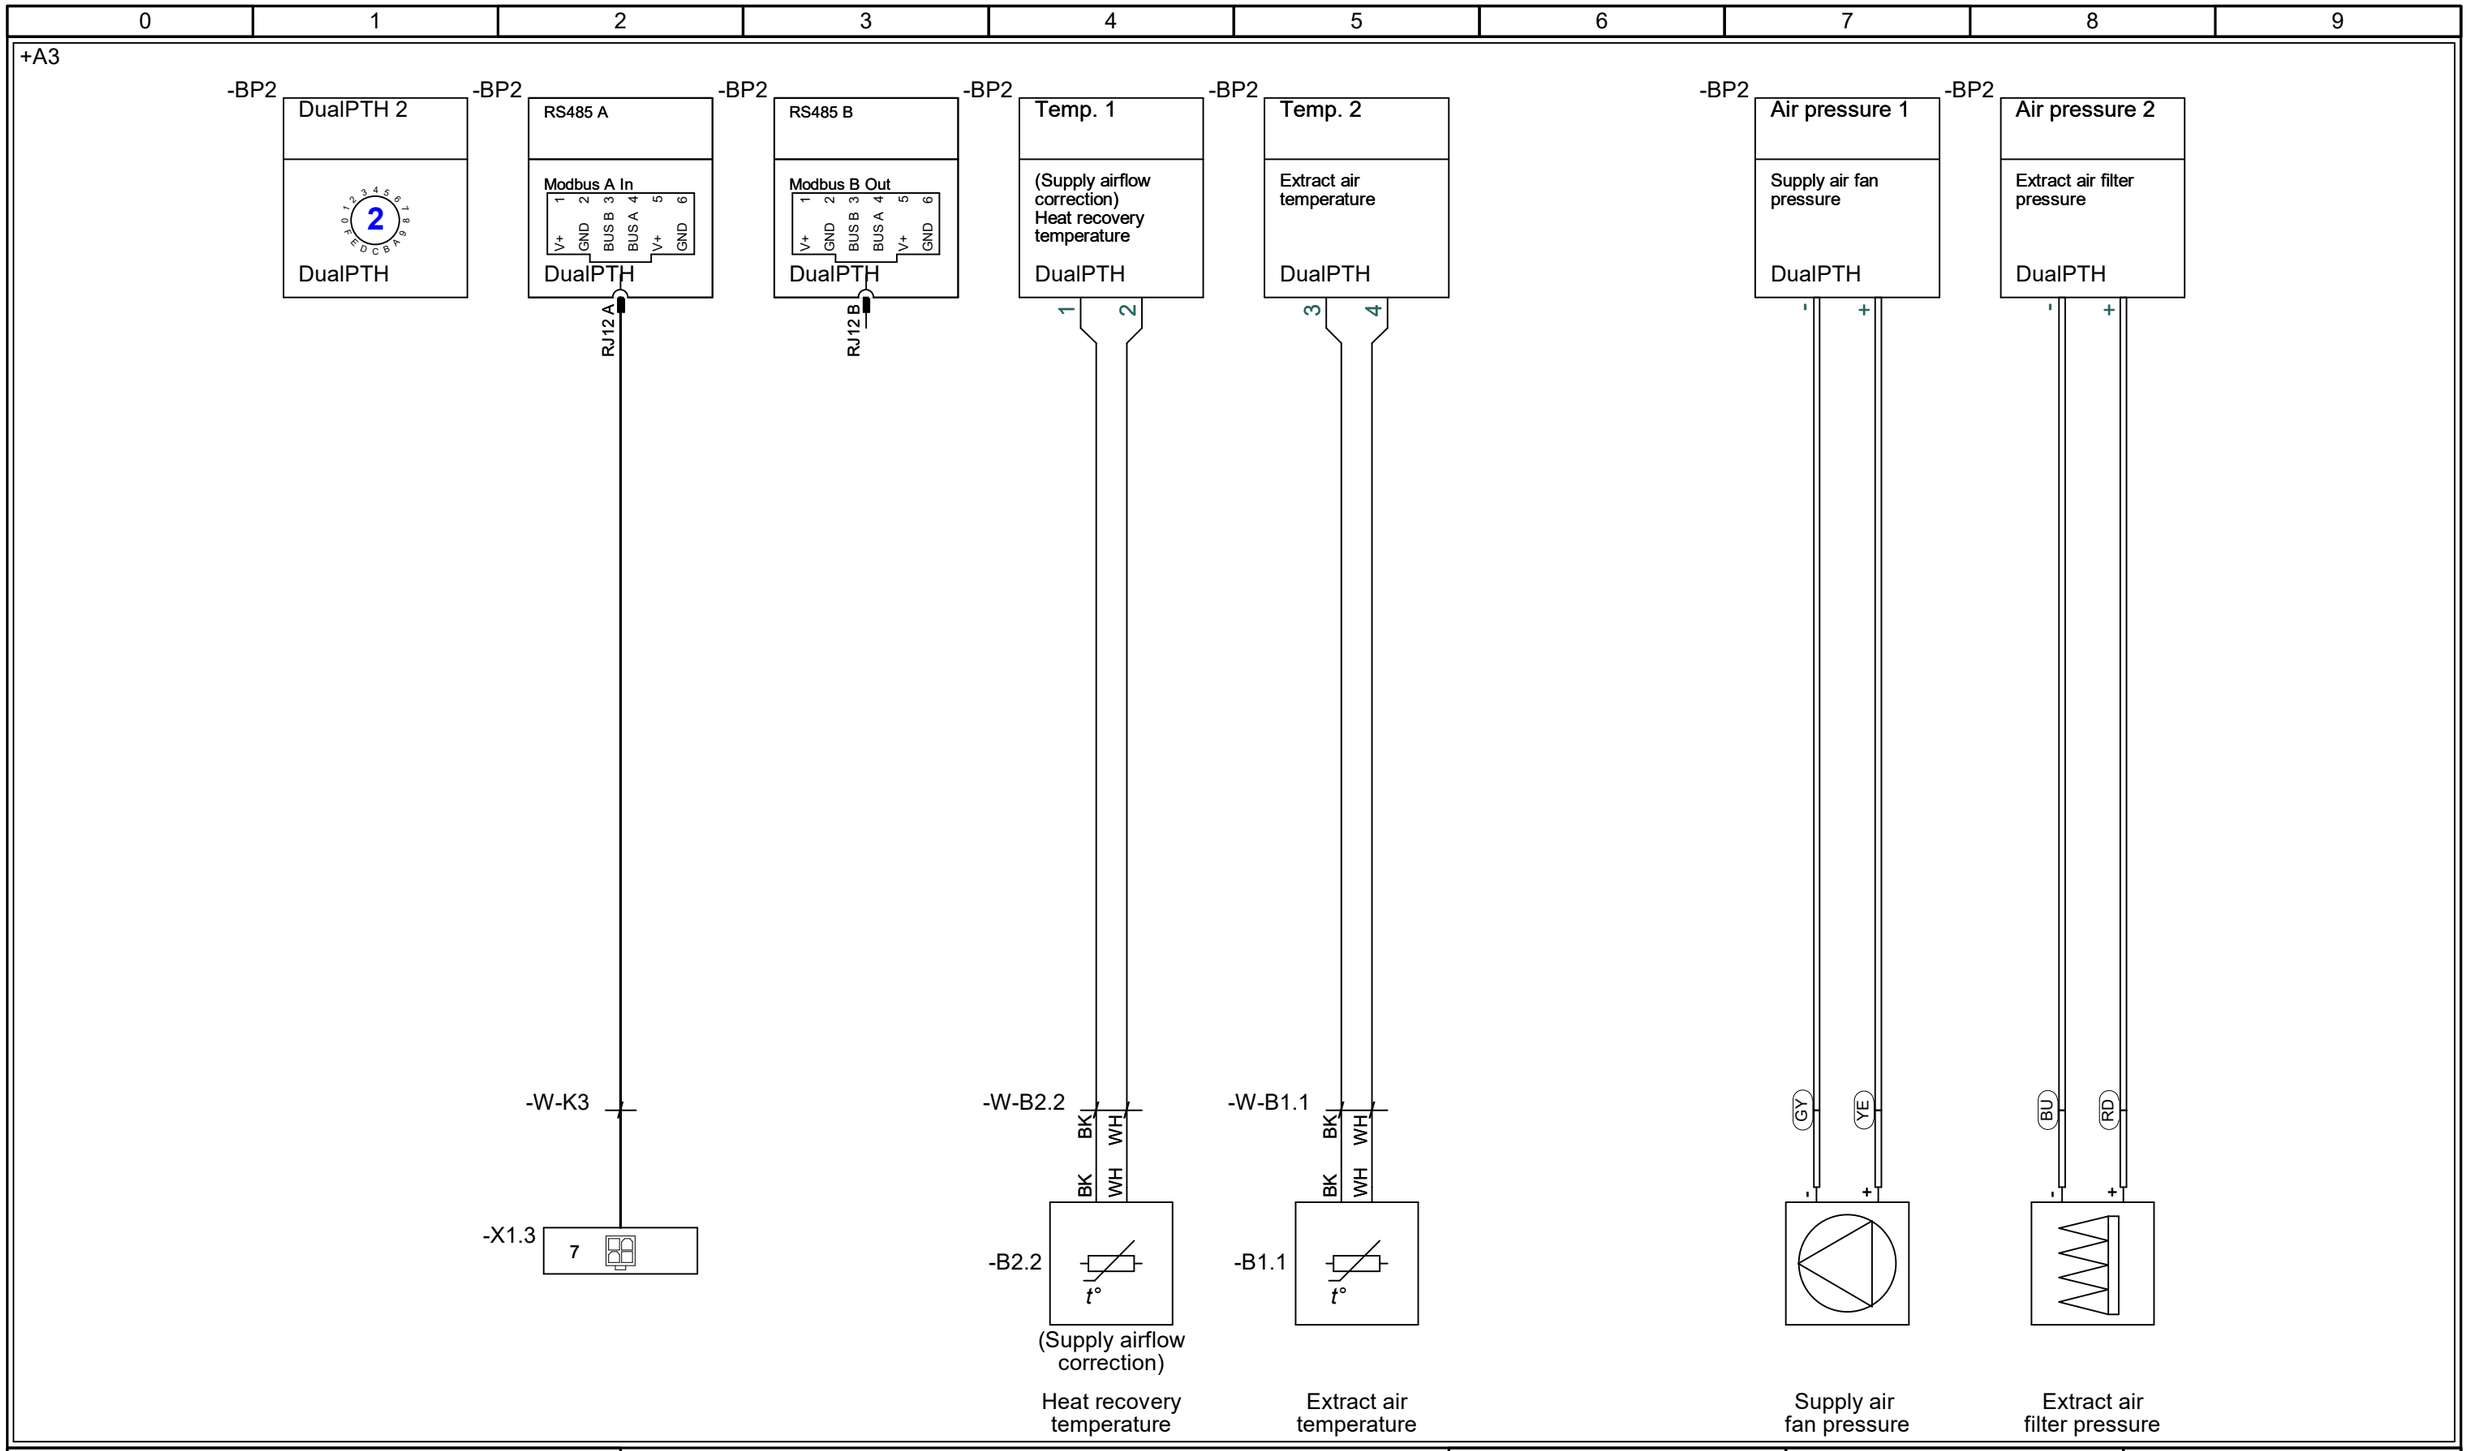

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 41
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 40
Drawing number: 2028125	Revision: C	Page Title: Standard - Dual PTH 2	Replaces: B	Scale: 1:1	Next page: 42
			EC no.: -	Format: A3	Pages in total: 36

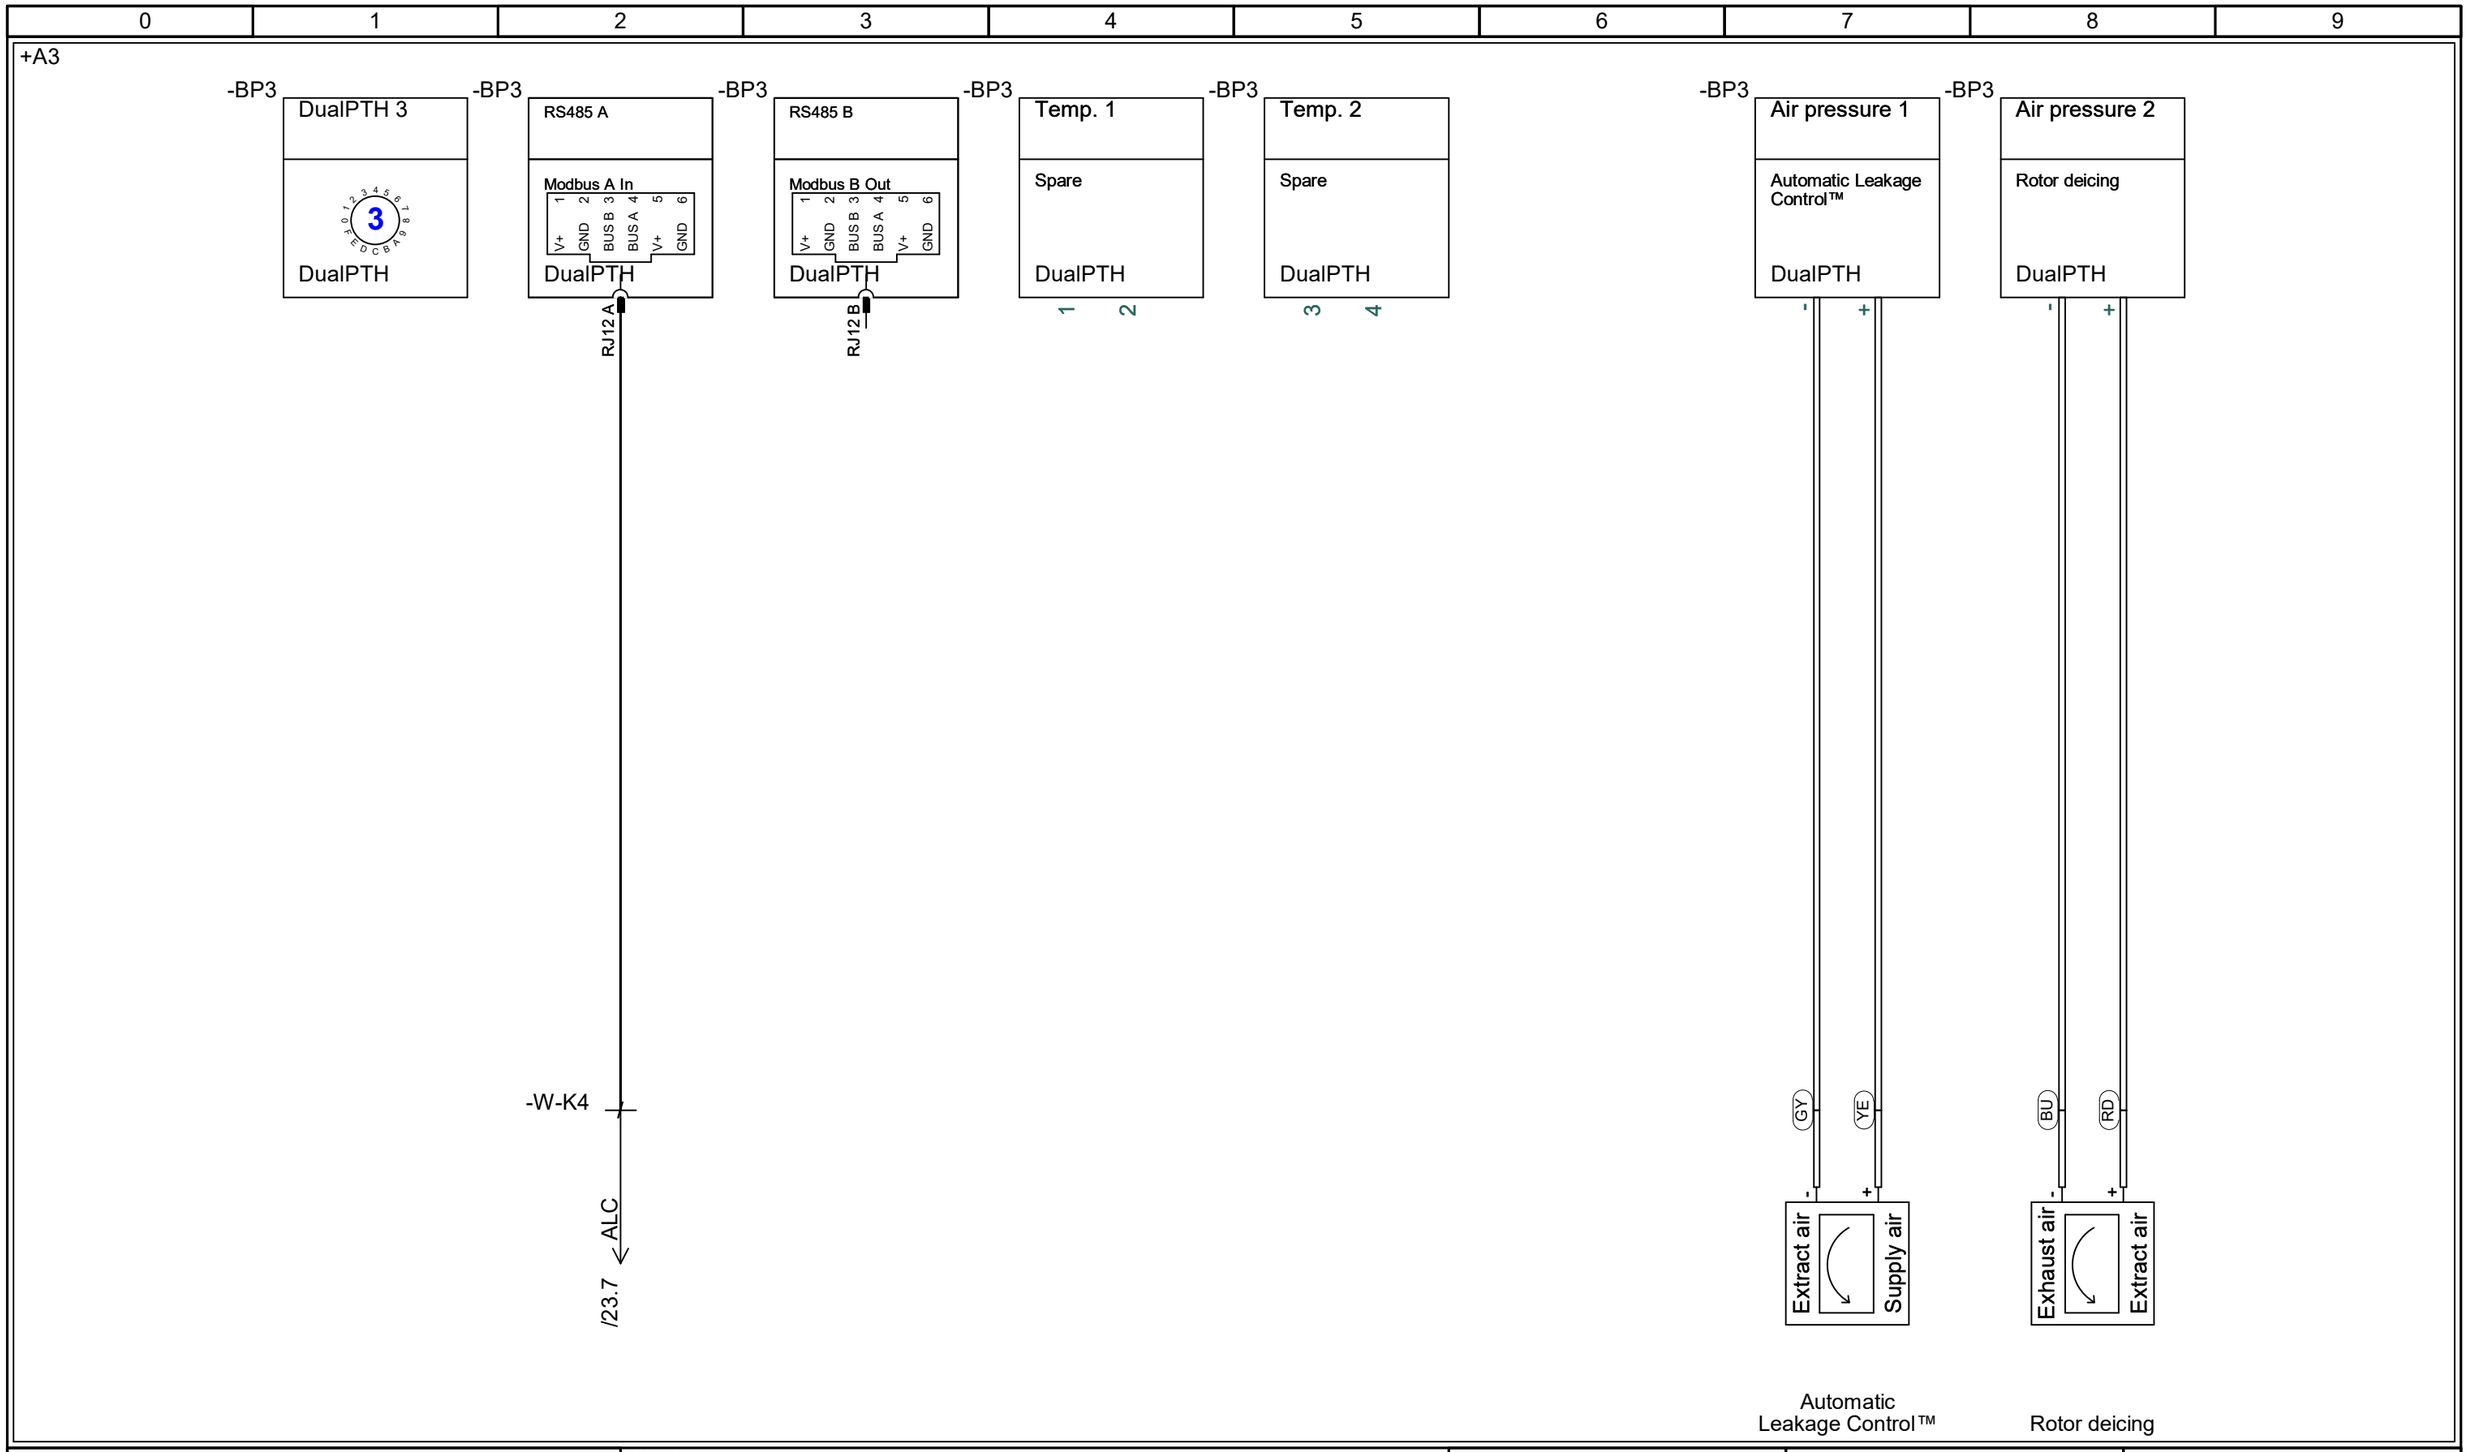

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 42	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 41	
Drawing number: 2028125	Revision: C	Page Title: Option - ALC™ - Rotor deicing	Replaces: B	Scale: 1:1	Next page: 50	
			EC no.: -	Format: A3	Pages in total: 36	

Extension modules

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: EXT
			Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 42
Drawing number: 2028125	Revision: C	Page Title: Extension modules	Replaces:	B	Scale:	1:1	Next page: 50
			EC no.:	-	Format:	A3	Pages in total: 36

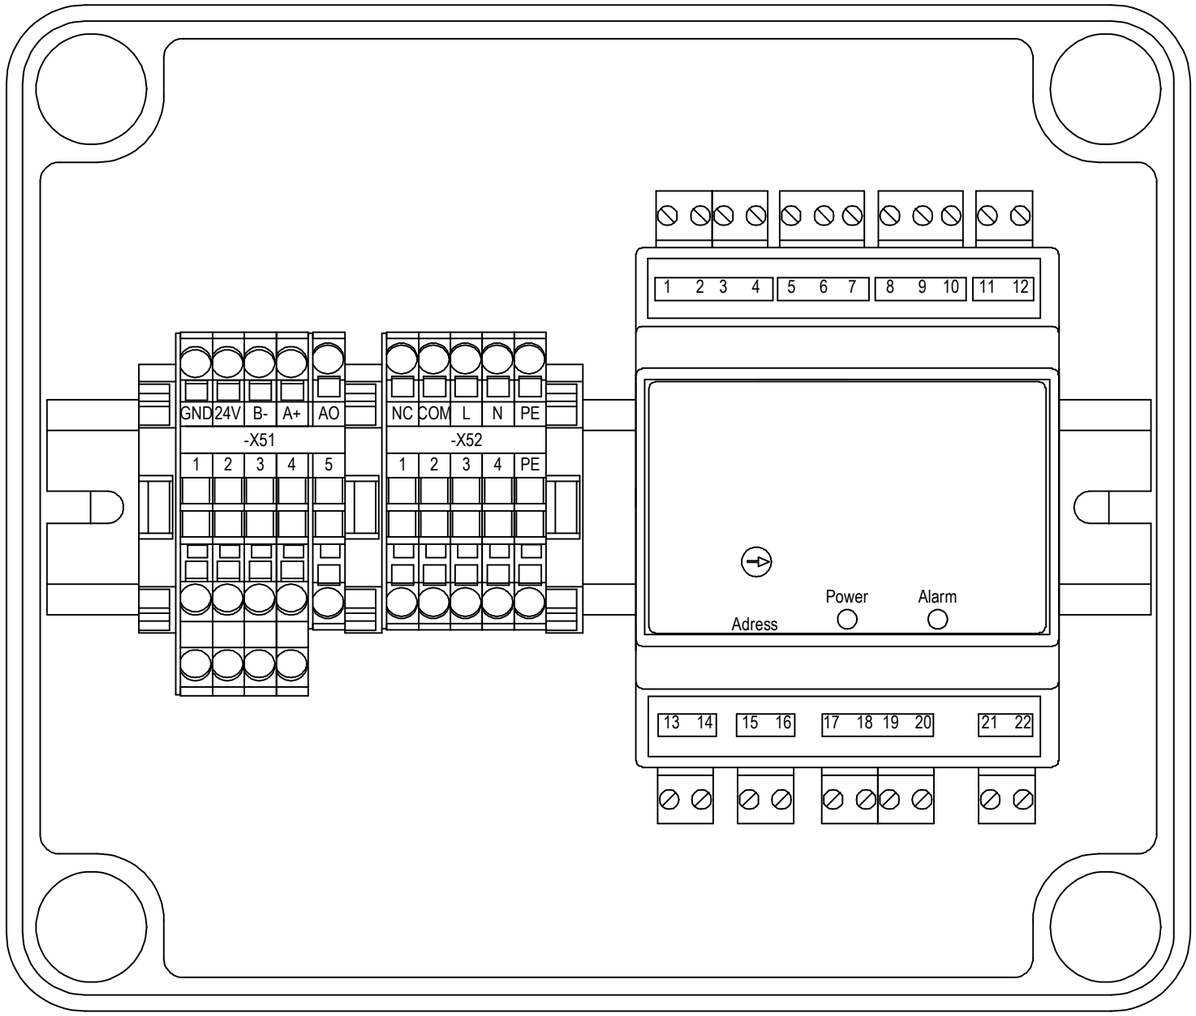

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date:	01-06-2023	Constructor:	DKTSA	Page: 50
			Revision date:	21-10-2025	Approved by:	DKBP	Previous page: 42
Drawing number: 2028125	Revision: C	Page Title: Option - Coil control box layout	Replaces:	B	Scale:	1:1	Next page: 51
			EC no.:	-	Format:	A3	Pages in total: 36

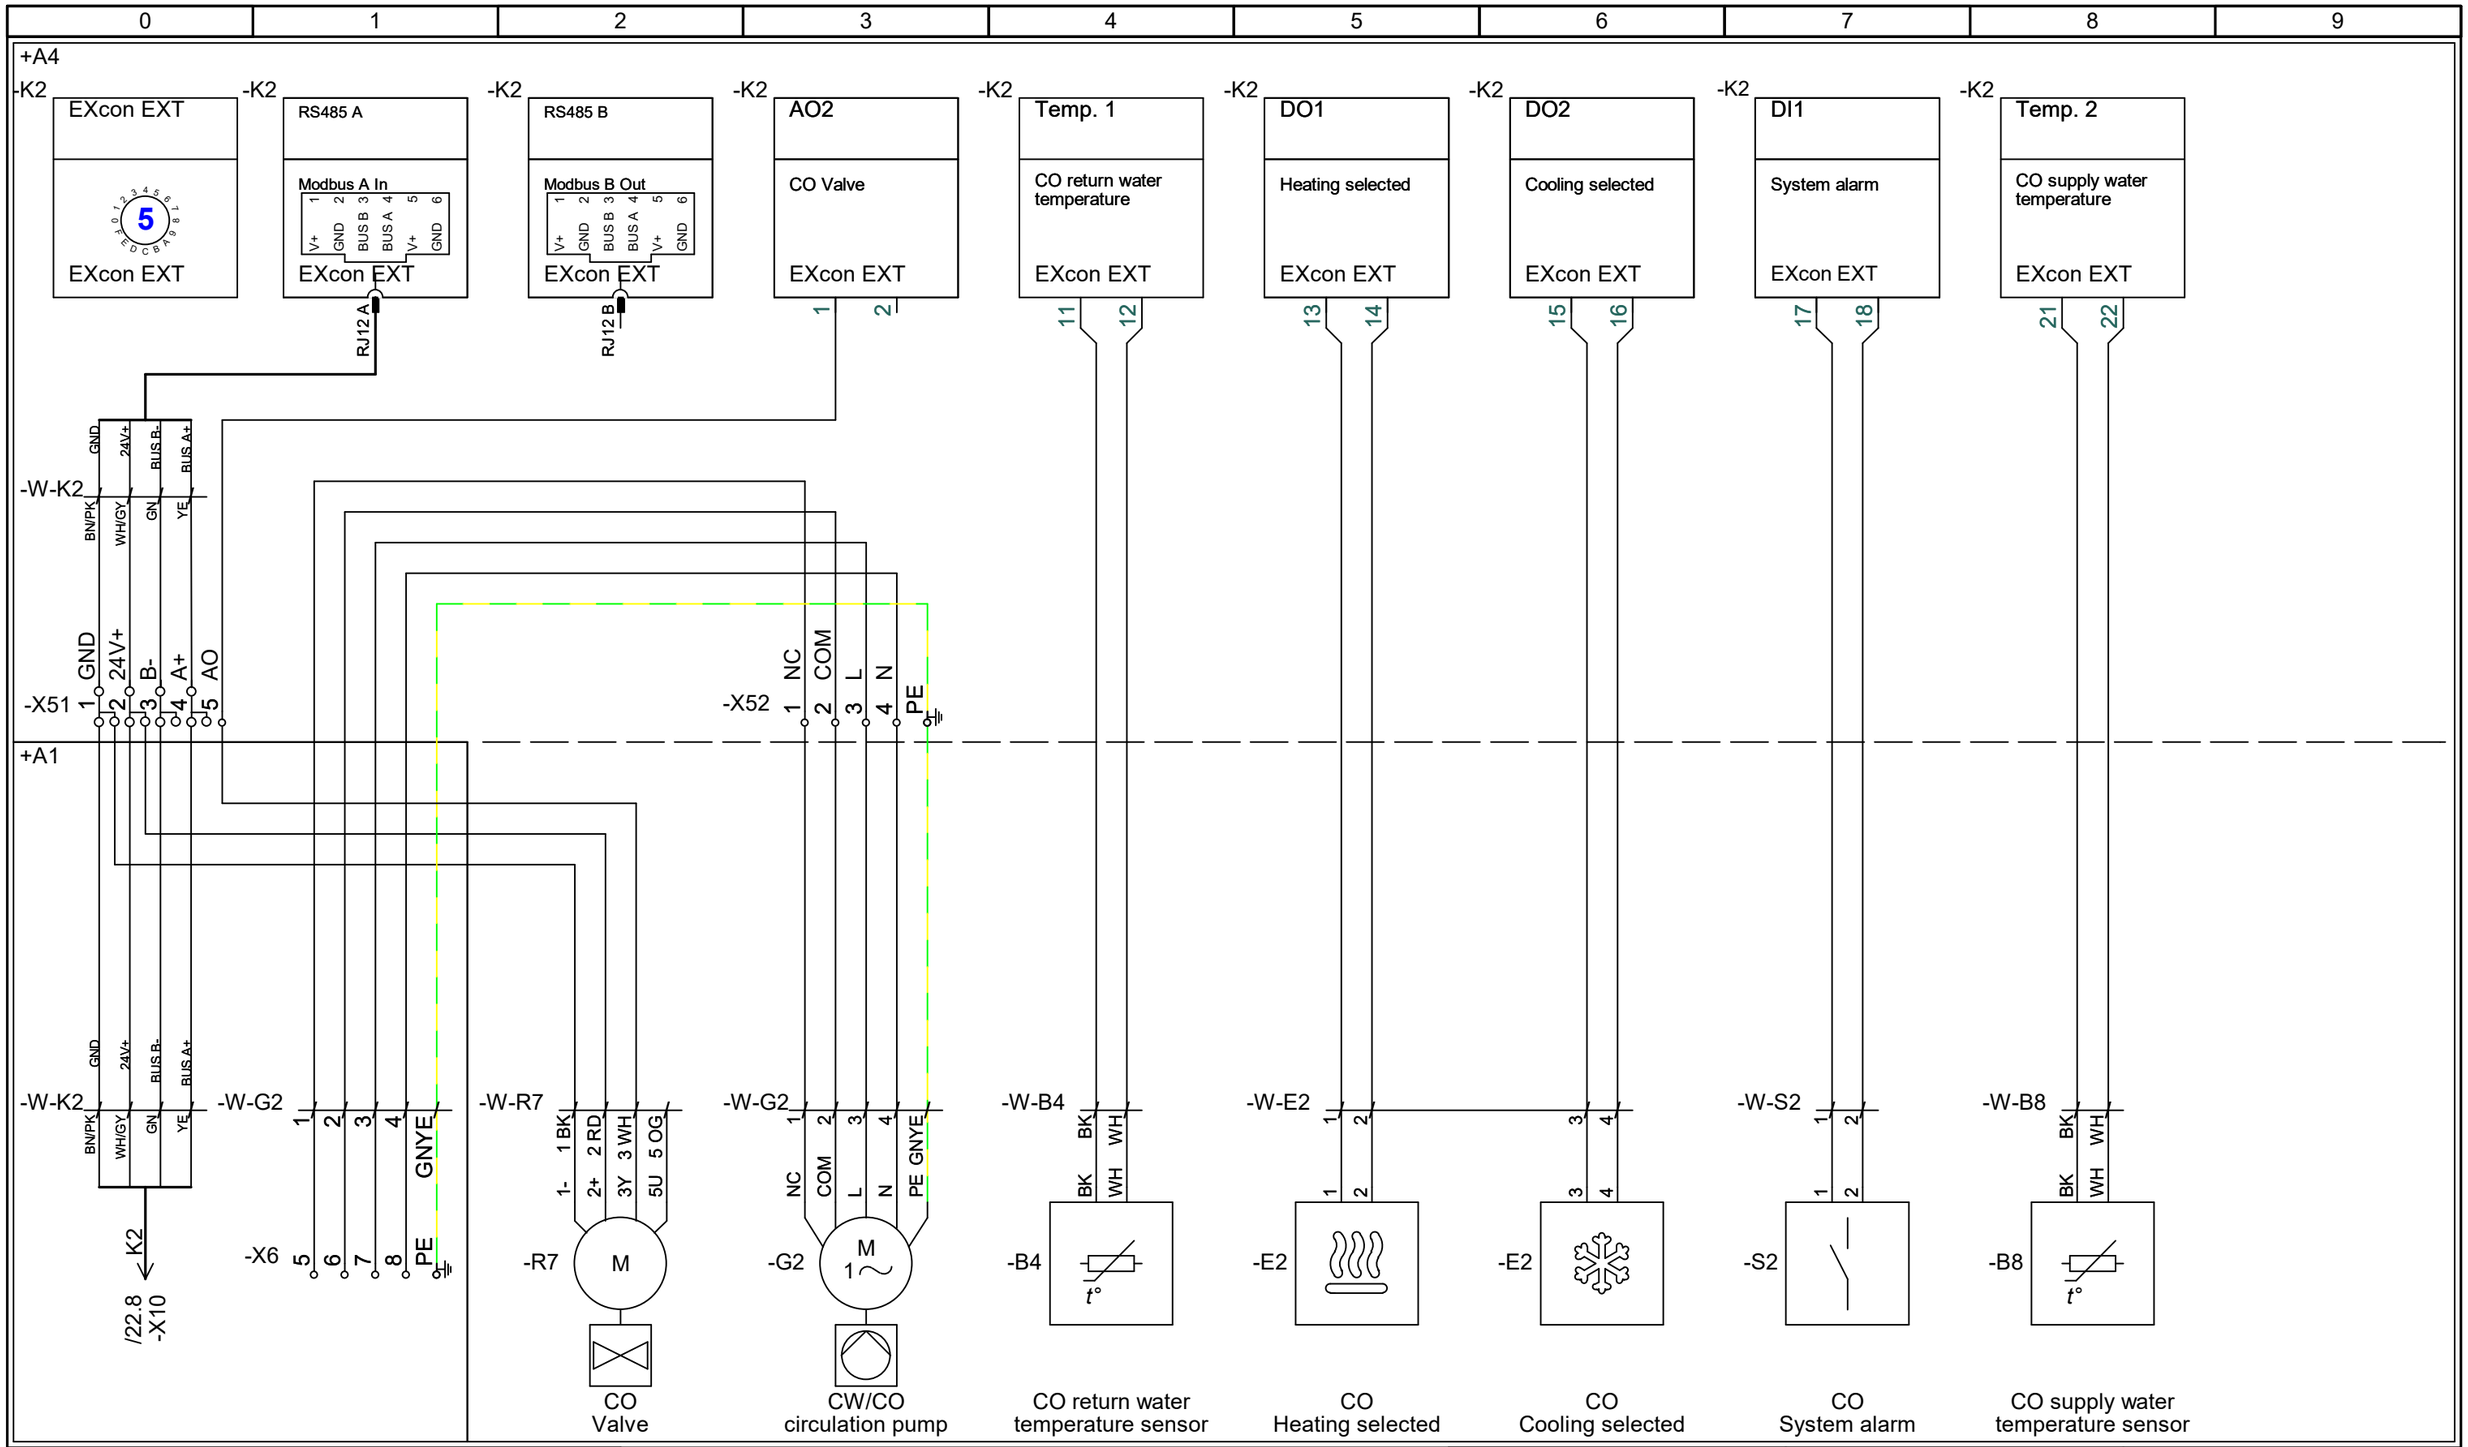

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 51	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 50	
Drawing number: 2028125	Revision: C	Page Title: Option - Combi Coil	Replaces: B	Scale: 1:1	Next page: 52	
			EC no.: -	Format: A3	Pages in total: 36	

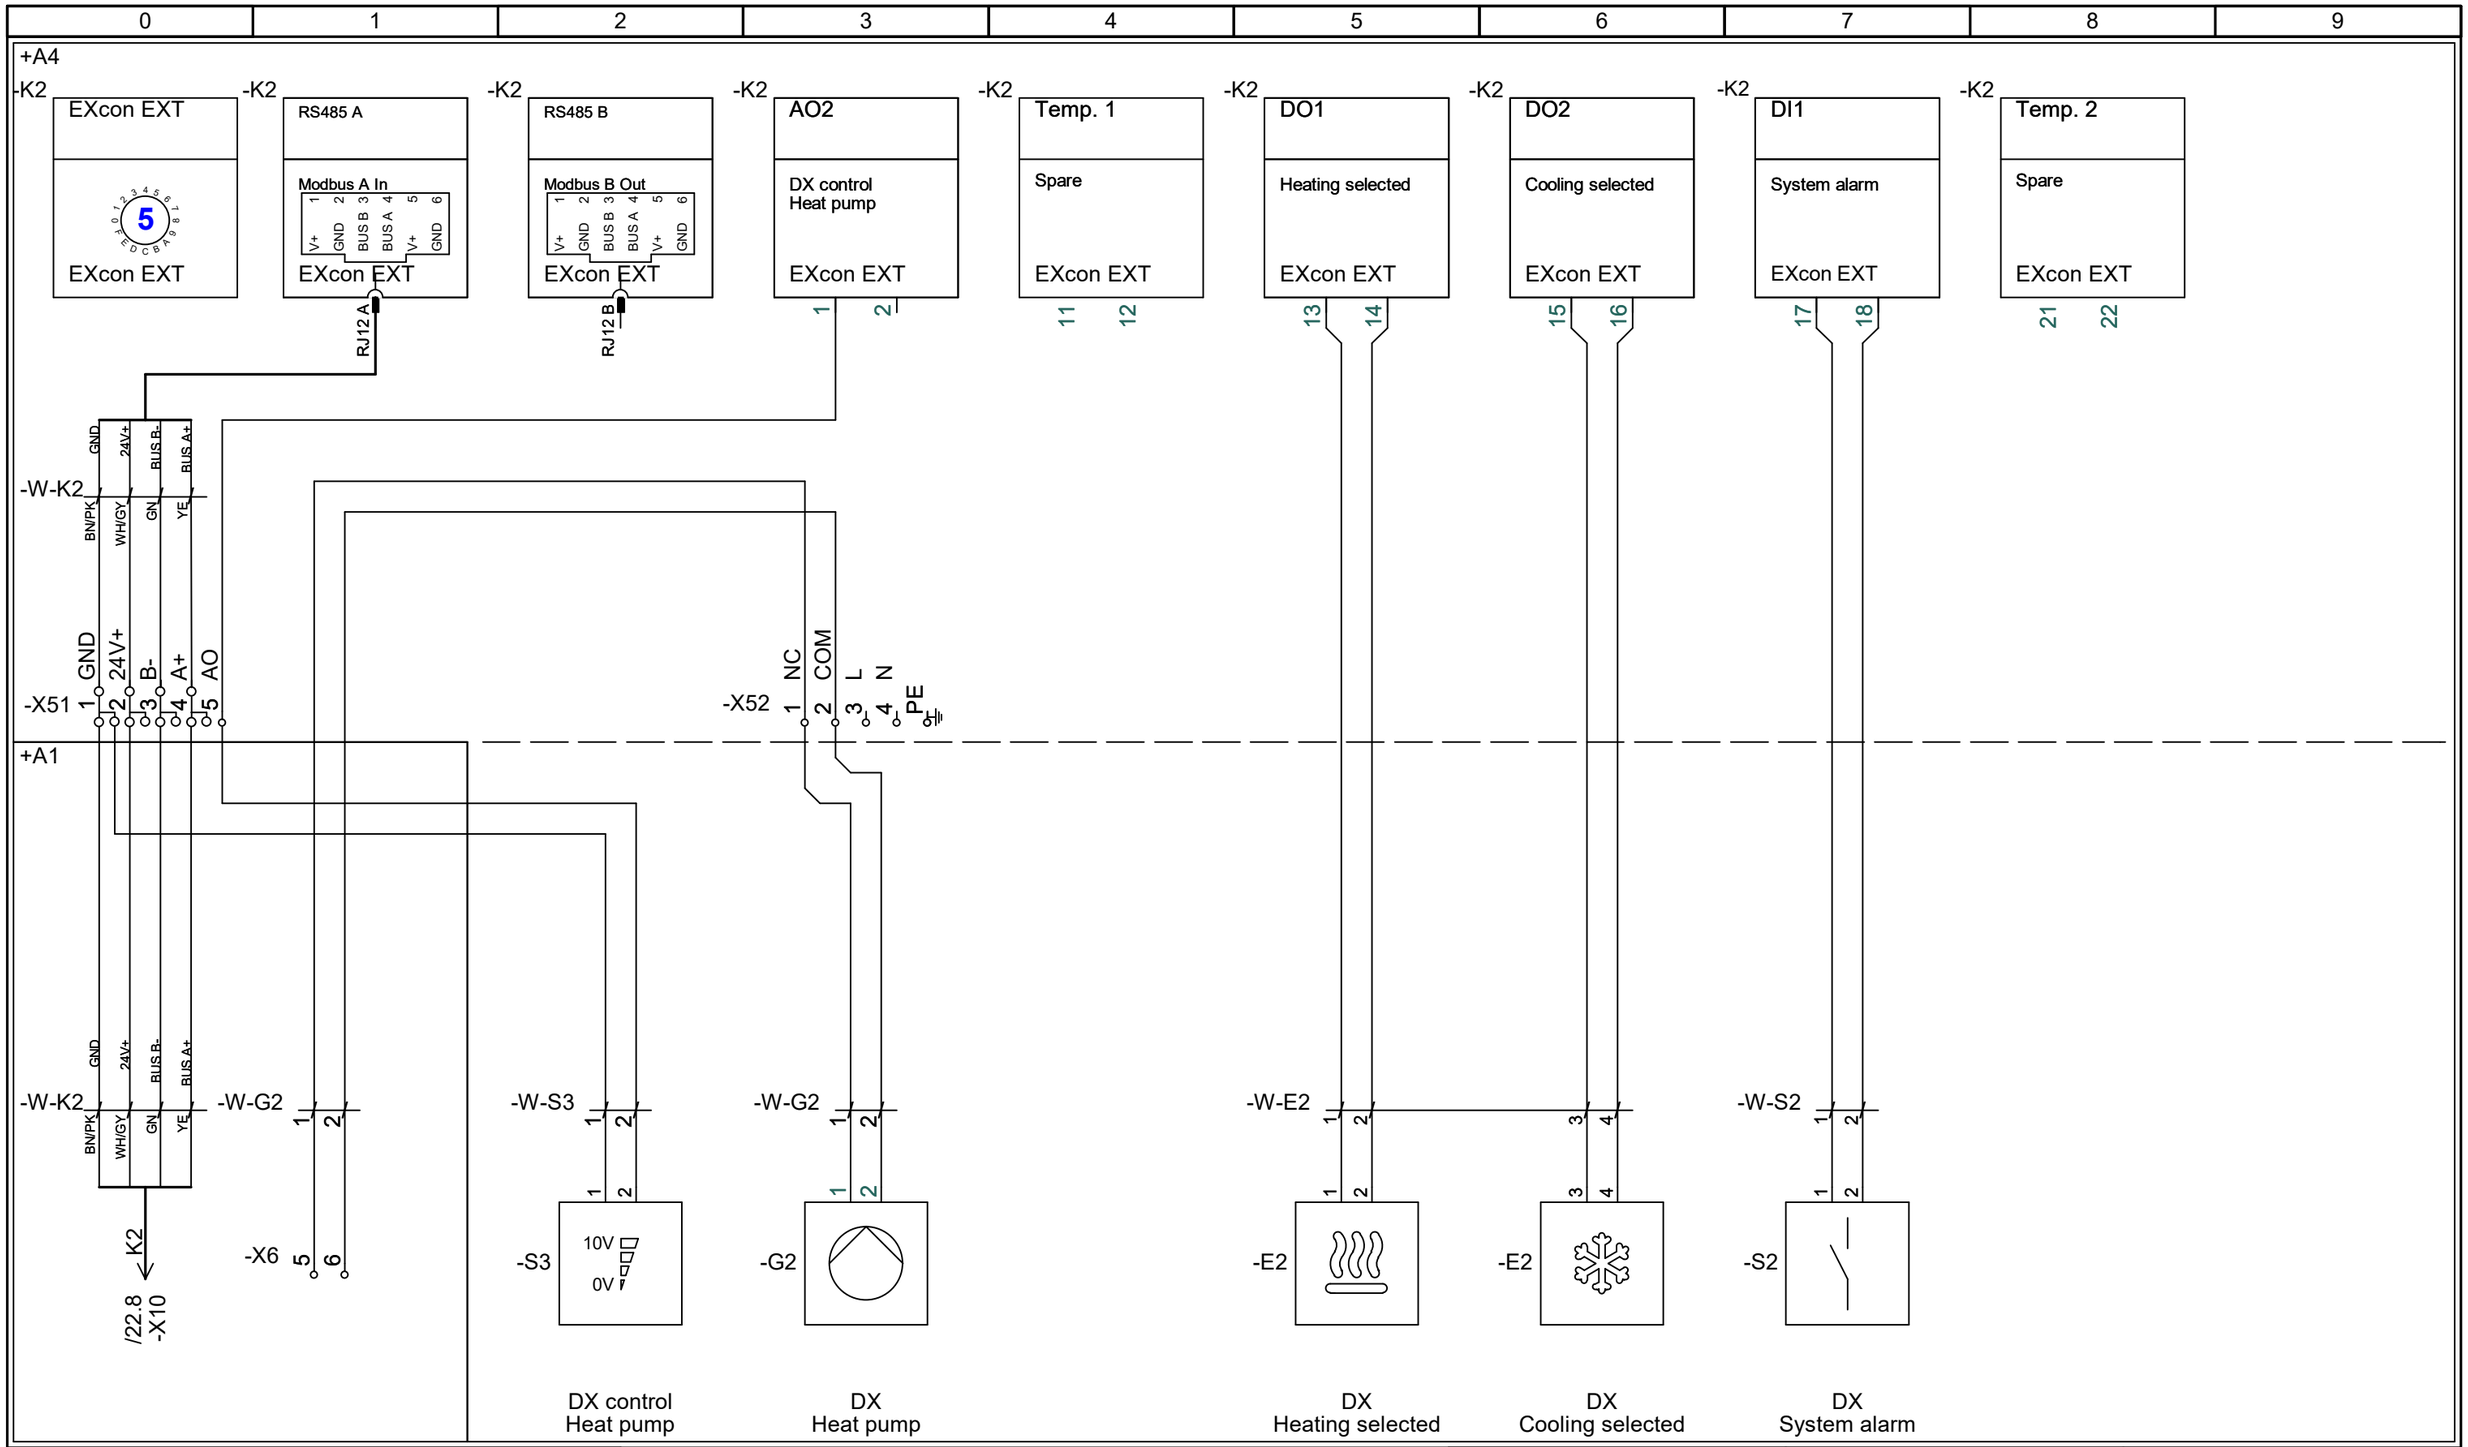

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 52	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 51	
Drawing number: 2028125	Revision: C	Page Title: Option - Direct Expansion Heat pump	Replaces: B	Scale: 1:1	Next page: 53	
			EC no.: -	Format: A3	Pages in total: 36	

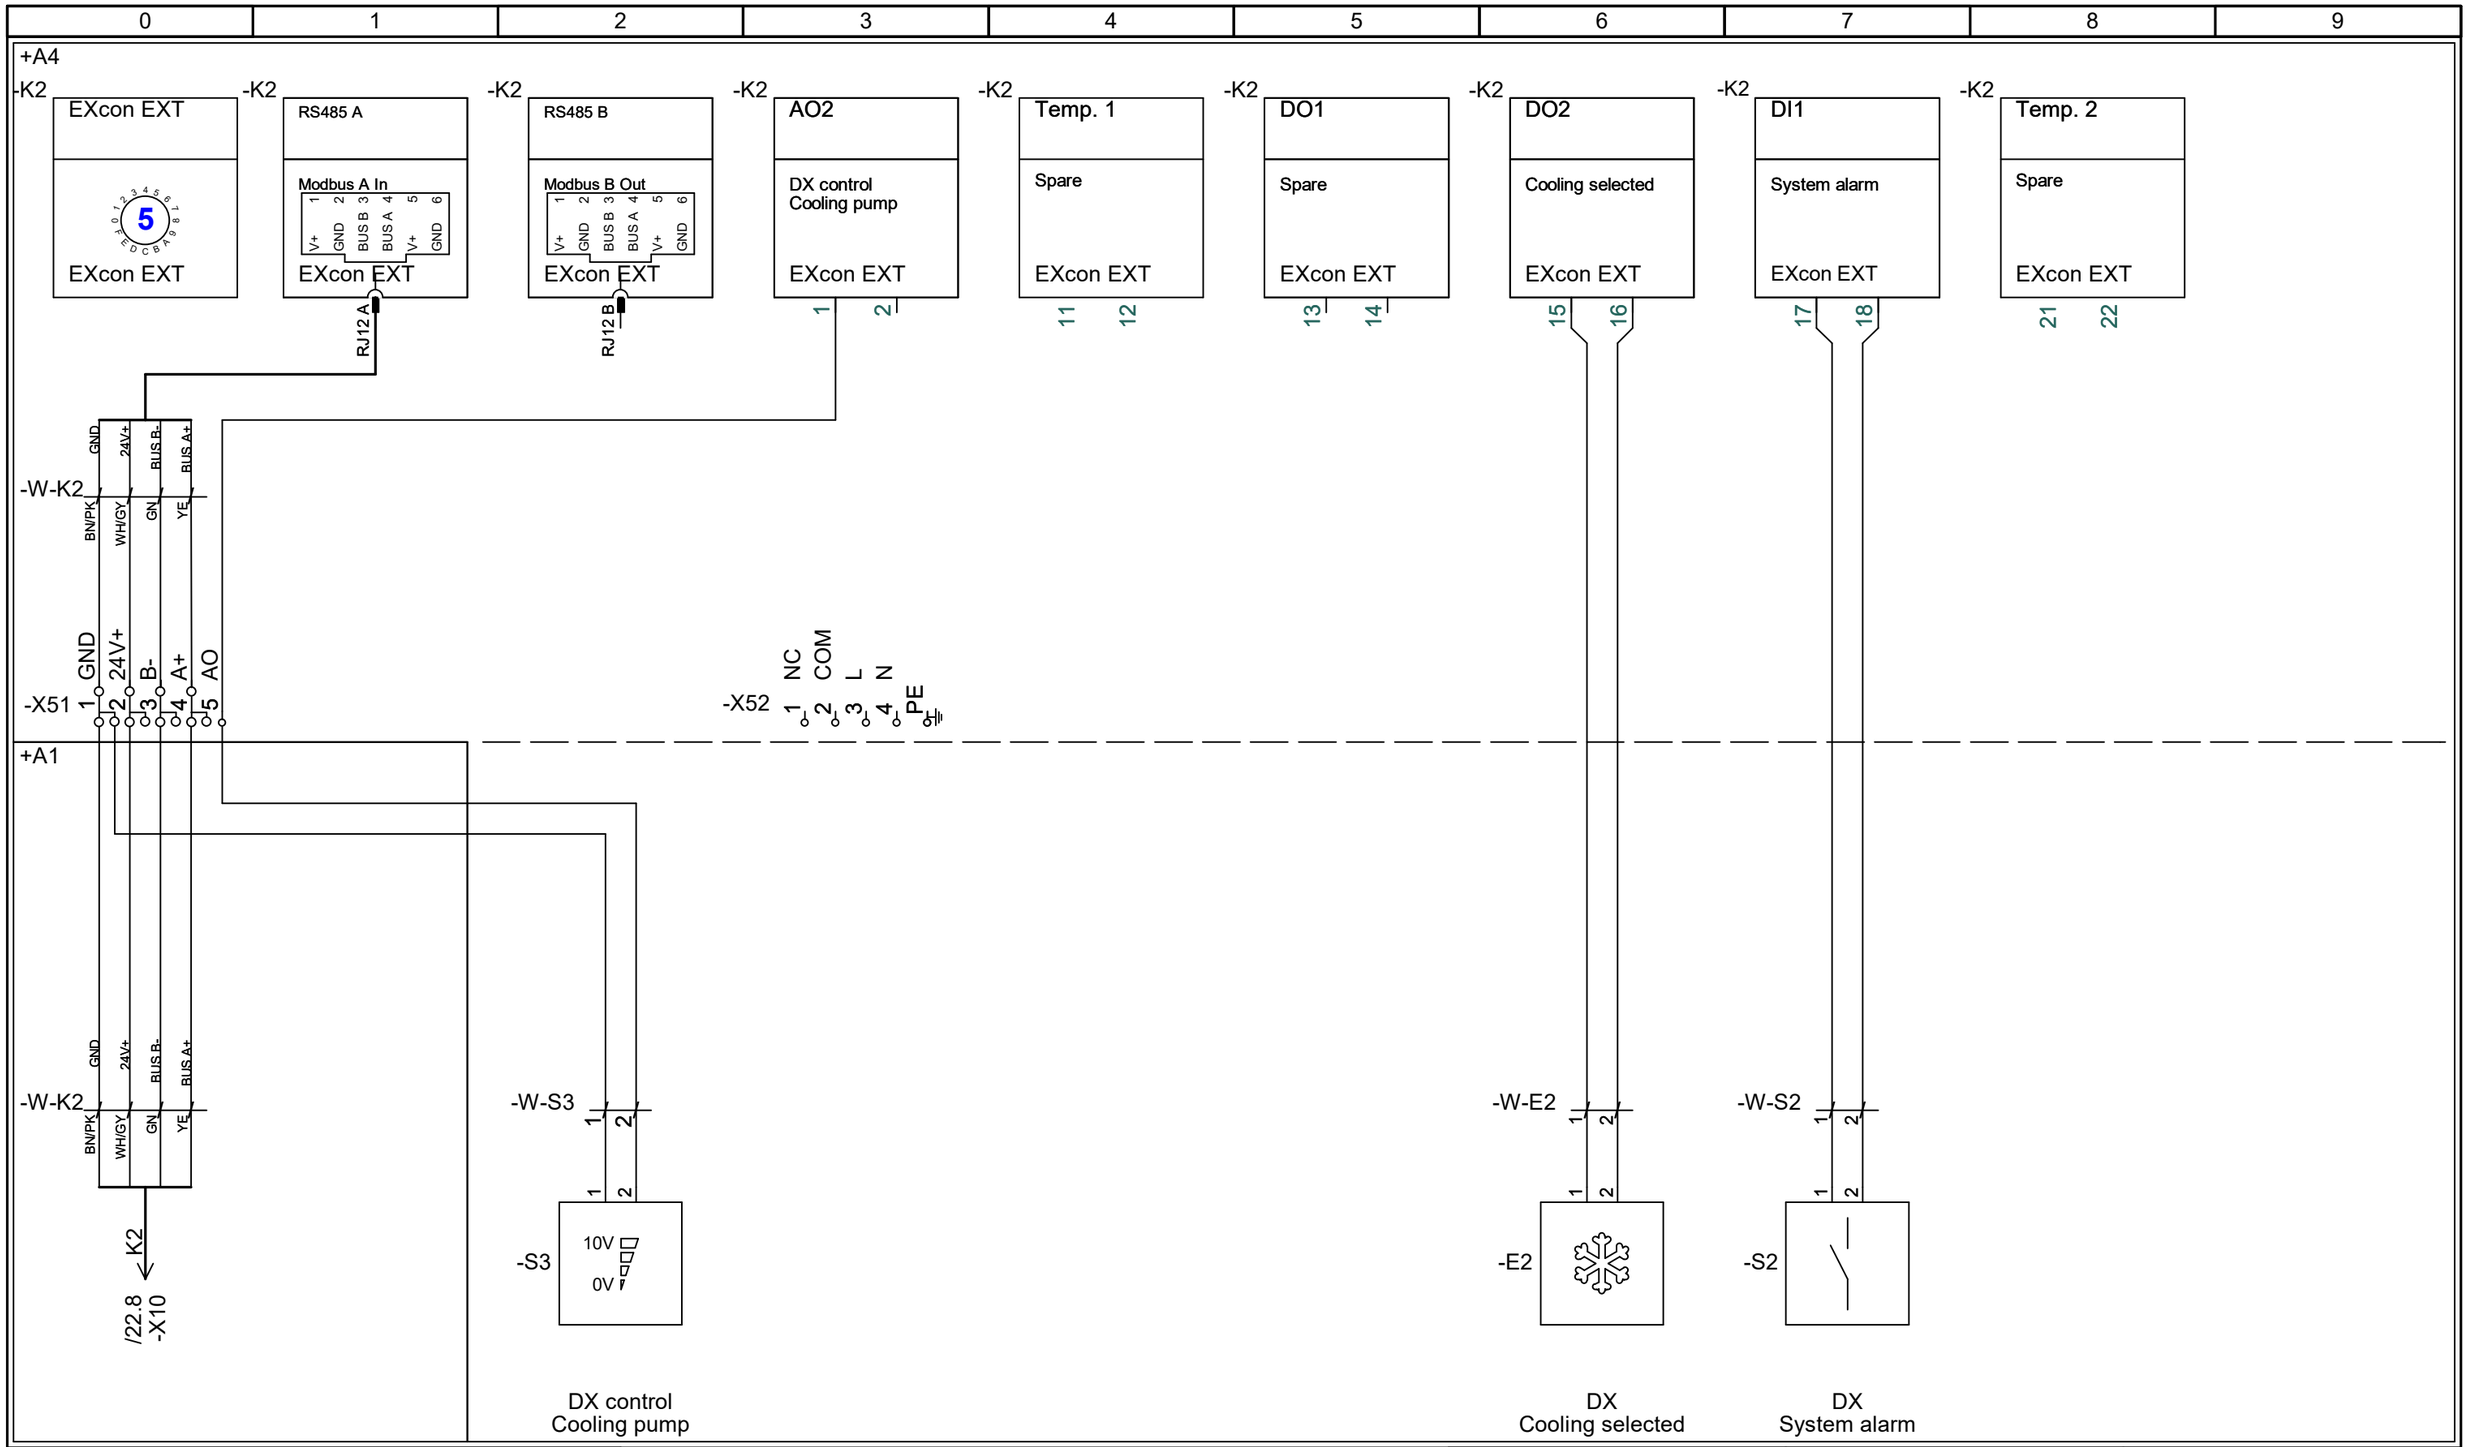

EXHAUSTO		Project: VEX1000 - Control panel (1x230V+HE)	Start date: 01-06-2023	Constructor: DKTSA	Page: 53	
			Revision date: 21-10-2025	Approved by: DKBP	Previous page: 52	
Drawing number: 2028125	Revision: C	Page Title: Option - Direct Expansion Cooling	Replaces: B	Scale: 1:1	Next page: .	
			EC no.: -	Format: A3	Pages in total: 36	