## (2) Installation of outdoor unit

RWC012A063D /A

Model SRC20,25,35,40,50,60ZSX-W SRC20,25,35ZSX-WA R32 REFRIGERANT USED

• This installation manual deals with an outdoor unit installation only. For an indoor unit installation, refer to page 52

#### **SAFETY PRECAUTIONS**

tion work in order to protect yourself.

The precautionary items mentioned below are distinguished into two levels, AWARNING and AWARNING and AWARNING and AWARNING and AWARNING and AWARNING and Indicates a potentially hazardous situation which, if not avoided, can result in serious consequences such as death or severe injury.

CAUTION Indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in personal indicates a potentially hazardous situation which, if not avoided, can result in serious contains the operating methods as well as the maintenance methods of this equipment to the user in capture to explain the operating methods as well as the maintenance methods of this equipment to the user in capture to explain the operating methods as well as the maintenance methods of this equipment to the user in capture to explain the operating methods as well as the maintenance methods of this equipment to the user in capture to explain the operating methods as well as the maintenance methods of the user in capture to explain the

jury or property damage

Both mention the important items to protect your health and safety. Therefore, strictly follow them by any means

• Before installation, read the "SAFETY PRECAUTIONS" carefully and strictly follow it during the installa- • Be sure to confirm no operation problem on the equipment after completing the installation. If unusual noise can be heard during the test run, consult the dealer

#### **⚠ WARNING**

Be sure to use only for residential purpose.

If this unit is installed in inferior environment such as machine shop, vehicle (like ship), warehouse, etc., it can malfunction.

led, it can ination.

Installation must be carried out by the qualified installer completely in accordance with the installation manual.

Installation by an unqualified person or incorrect installation can cause serious troubles such as water leak, electric shock, fire and personal injury.

Be sure to wear protective goggles and gloves while performing installation work. Improper safety measures can result in personal injury.

Use the original accessories and the specified components for the installation.
Using parts other than those prescribed may cause water leak, electric shock, fire and personal injury.
Do not install the unit near the location where leakage of flammable gases can occur.

If leaked gases accumulate around the unit, it can cause fire resulting in property damage and per-

When installing the unit in small rooms, make sure that refrigerant density does not exceed the limit (Reference: ISO5149) in the event of leakage.

If refrigerant density exceeds the limit, consult the dealer and install the ventilation system.

Otherwise lack of oxygen can occur resulting in serious accident.

Install the unit in a location where unit will remain stable, horizontal and free of any vibration transmission.

Unsuitable installation location can cause the unit to fall resulting in material damage and personal injury.

Unsuitable installation location can cause the unit to fall resulting in material damage and personal injury.

Do not run the unit with removed panels or protections.

Touching rotating equipment, hot surfaces or high voltage parts can cause personal injury due to entrapment, burn or electric shock.

This unit is designed specifically for R32.

Using any other refrigerant can cause unit failure and personal injury.

Do not vent R32 into atmosphere.

R32 is a fluorinated greenhouse gas with a Global Warming Potential (GWP) = 675.

Make sure that no air enters the refrigerant circuit when the unit is installed and removed.

and removed.

and removed.

If air enters the refrigerant circuit, the pressure in the refrigerant circuit will become too high, which can cause burst and personal injury.

Be sure to use the prescribed pipes, flare nuts and tools for R32 or R410A.

Using existing parts (for R22 or R407C) can cause refrigerant circuit burst resulting in unit failure and personal injury.

Be sure to connect both liquid and gas connecting pipes properly before operating the connecses.

erating the compressor

Do not open the liquid and gas service valves before completing piping work, and evacuation.

If the compressor is operated when connecting pipes are not connected and service valves are open, air can be sucked into the refrigerant circuit which can cause anomalous high pressure resulting in

burst or personal injury.

Be sure to tighten the flare nuts to specified torque using the torque wrench.

Tightening flare nuts with excess torque can cause burst and refrigerant leakage after a long period.

During pump down work, be sure to stop the compressor before closing service valves and removing connecting pipes. If the connecting pipes are removed when the compressor is in operation and service valves are open, air can be sucked into the refrigerant circuit which can cause anomalous high pressure resulting in burst or personal injury.

Ing in burst or personal injury.

In the event of refrigerant leakage during installation, be sure to ventilate the working area properly.

If the refrigerant comes into contact with naked flames, poisonous gases will be produced.

Electrical work must be carried out by the qualified electrician, strictly in accordance with national or regional electricity regulations.

Incorrect installation can cause electric shock, fire or personal injury.

Make sure that earth leakage breaker and circuit breaker of appropriate caracities are installed.

pacities are installed.

Circuit breaker should be able to disconnect all poles under over current. Absence of appropriate breakers can cause electric shock, personal injury or property damage.

Be sure to switch off the power source in the event of installation, mainte-

nance or service.

nance or service.
If the power source is not switched off, there is a risk of electric shock, unit failure or personal injury.
Be sure to tighten the cables securely in terminal block and relieve the cables properly to prevent overloading the terminal blocks.
Loose connections or cable mountings can cause anomalous heat production or fire.
Do not process, splice or modify the power cable, or share the socket with other power plugs.
Improper power cable or power plug can cause fire or electric shock due to poor connection, insufficient insulation or overcurrent.

ficient insulation or over-current Do not perform any change in protective device or its setup condition yourself.

Changing protective device specifications can cause electric shock, fire or burst.

Be sure to clamp the cables properly so that they do not touch any internal

component of the unit.

If cables touch any internal component, it can cause overheating and fire.

Be sure to install service cover properly.

Improper installation can cause electric shock or fire due to intrusion of dust or water.

Be sure to use the prescribed power and connecting cables for electrical work.

Be sure to use the prescribed power and connecting cables for electrical work. Using improper cables can cause electric leak or fire.

This appliance must be connected to main power source by means of a circuit breaker or switch with a contact separation of at least 3 mm. Improper electrical work can cause unit failure or personal injury.

Be sure to connect the power source cable with power source properly. Improper connection can cause intrusion of dust or water resulting in electric shock or fire.

## **⚠** CAUTION

Take care when carrying the unit by hand.
If the unit weight is more than 20kg, it must be carried by two or more persons.
Do not carry the unit by the plastic straps. Always use the carry handle.
Do not install the outdoor unit in a location where insects and small animals

can inhabit. Insects and small animals can enter the electrical parts and cause damage resulting in fire or per-

If the outdoor unit is installed at height, make sure that there is enough space for installation, maintenance and service.

Insufficient space can result in personal injury due to falling from the height.

Do not install the unit near the location where neighbours are bothered by • noise or air generating from the unit.

noise of air generating from the unit.

It can affect surrounding environment and cause a claim.

Do not install in the locations where unit is directly exposed to corrosive gases (like sulphide gas, chloride gas), sea breeze or salty atmosphere.

It can cause corrosin of heat exchanger and damage to plastic parts.

Do not install the unit close to the equipment that generates electromagnetic

waves and/or high-harmonic waves.

Equipment such as inverters, standby generators, medical high frequency equipment and telecommunication equipment can affect the system, and cause malfunctions and breakdowns.

The system can also affect medical equipment and telecommunication equipment, and obstruct its • function or cause jamming

- Do not install the unit in the locations where:
- There are heat sources nearby.
  There is any obstacle which can prevent smooth air circulation from inlet and outlet side of the unit.
- Unit is directly exposed to oil mist and steam such as kitchen.
- Chemical substances like ammonia (organic fertilizer), calcium chloride (snow melting agent) and acid (sulfurous acid etc.), which can harm the unit, will generate or accumulate.
- Drain water cannot be discharged properly.
   TV set or radio receiver is placed within 1m.
   Height above sea level is more than 1000m.

I height above sea level is into that in town.

It can cause performance degradation, corrosion and damage of components, unit malfunction and fire.

Dispose of all packing materials properly.

Packing materials contain nails and wood which can cause personal injury.

Keep the polybag away from children to avoid the risk of suffocation.

Do not put anything on the outdoor unit.

Object may fall causing property damage or personal injury.

Do not touch the aluminum fin of the outdoor unit.

Aluminium fin temperature is high during heating operation. Touching fin can cause burn.

Do not touch any refrigerant pipe with your hands when the system is in operation.

During operation the refrigerant pipes become extremely hot or extremely cold depending on the operating condition. Touching pipes can cause personal injury like burn (hot/cold).

Install isolator or disconnect switch on the power source wiring in accordance with the local codes and regulations.

The isolator should be locked in OFF state in accordance with EN60204-1.

### 1. ACCESSORIES AND TOOLS

Standard accessories (Supplied with outdoor unit)	Q'ty	Locally procured parts	Tools for installation work		
(1) Drain grommet	4	(a) Anchor bolt (M10-M12) × 4 pcs.	Phillips head driver	Spanner wrench	Vacuum pump*
I <del>                                    </del>	H	(b) Putty	Knife	Torque wrench [14.0-62.0 N•m (1.4-6.2 kgf•m)]	Gauge manifold *
(2) Drain elbow	1	(c) Electrical tape	Saw	Wrench key (Hexagon) [4 mm]	Charge hose *
*Not included for SRC20, 25, or 35ZSX-WA.		(d) Connecting pipe	Tape measure	Flaring tool set *	Vacuum pump adapter*
		(e) Connecting cable	Tape measure	Flatting tool set	(Anti-reverse flow type)
		(f) Power cable	Pipe cutter	Flare adjustment gauge	Gas leak detector *
(g) Clamp and screw (for finishing work)				*Designed specifically for R32 or R410A	

## 2. OUTDOOR UNIT INSTALLATION

## Note as a unit designed for R32

- Note as a unit designed for R32

  Do not use any refrigerant other than R32. R32 will rise to pressure about 1.6 times higher than that of a conventional refrigerant. A cylinder containing R32 has a light blue indication mark on the top.

  Do not use a charge cylinder. The use of a charge cylinder will cause the refrigerant composition to change, which results in performance degradation.

  In charging refrigerant, always take it out from a cylinder in the liquid phase.

  All indoor units must be models designed exclusively for R32. Check connectable indoor unit models in
- a catalog, etc. (A wrong indoor unit, if connected into the system, will impair proper system operation)

#### 1. Haulage

- Always carry or move the unit with two or more persons. The right hand side of the unit as viewed from the front (outlet side) is heavier.

A person carrying the right hand side must take care of this fact. A person carrying the left hand side must hold the handle provided on the front panel of the unit with his right hand and the corner column section of the unit with his left hand.



#### **⚠** CAUTION

When a unit is hauled, take care of its gravity center position which is shifted towards right hand side. If the unit is not hauled properly, it can go off balance and fall resulting in serious injury.

#### 2. Selecting the installation location

- Select the suitable installation location where:

   Unit will be stable, horizontal and free of any vibration transmission.
- There is no obstacle which can prevent smooth air circulation from inlet and outlet side of the unit. There is enough space for service and maintenance of unit. Neighbours are not bothered by noise or air generating from the unit.

- Outlet air of the unit does not blow directly to animals or plants.
- Drain water can be discharged properly.

  There is no risk of flammable gas leakage.

  There are no other heat sources nearby.

- Unit is not directly exposed to oil mist and steam.

  Chemical substances like ammonia (organic fertilizer), calcium chloride (snow melting agent) and acid (sulfurous acid etc.), which can harm the unit, will not generate or accumulate.

  Unit is not directly exposed to corrosive gases (like sulphide gas, chloride gas), sea breeze or salty at-
- mosphere.
- No TV set or radio receiver is placed within 1 m.
- Unit is not affected by electromagnetic waves and/or high-harmonic waves generated by other equip-
- Strong wind does not blow against the unit outlet.
- Heavy snowfalls do not occur (If installed, provide proper protection to avoid snow accumulation).

#### NOTE

If the unit is installed in the area where there is a possibility of strong wind or snow accumulation, the following measures are required.

## (1) Location of strong wind

· Place the unit with its outlet side facing the wall.


the outlet gets perpendicular to the wind direc-






- · Install the unit on the base so that the bottom is higher than snow cover surface.

  Install the unit under eaves or provide the roof on



#### 3. Installation space

There must be 1 m or larger space between the unit and the wall in at least 1 of the 4 sides. Walls surrounding the unit from 4 sides is not acceptable. The wall height on the outlet side should be 1200 mm or less. Refer to the following figure and table for details.



					()
Size	Example installation	I	II	III	IV
	L1	Open	280	280	180
	L2	100	75	Open	Open
	L3	100	80	80	80
	L4	250	Open	250	Open

### NOTE

When more than one unit are installed side by side, provide a 250mm or wider interval between them as a service space

#### **⚠** CAUTION

When more than one unit are installed in parallel directions, provide sufficient inlet space so that shortcircuiting may not occur.

## 4. Drain piping work (If necessary)

Carry out drain piping work by using a drain elbow and a drain grommet supplied separately as accessories if condensed water needs to be drained out.

(1) Install drain elbow and drain grommet.(2) Seal around the drain elbow and drain grommet with putty or adequate caulking material.

<SRC20/25/35/40/50/60ZSX-W>



Do not put a grommet on this hole. This is a supplementary drain hole to discharge drain water, when a large amount of it is gathered.

#### **↑** CAUTION

Do not use drain elbow and drain grommet if there is a possibility to have several consecutive days of sub zero temperature. (There is a risk of drain water freezing inside and blocking the drain.)


## <SRC20/25/35ZSX-WA



Do not block the drain holes when installing the outdoor unit.

## 5. Installation

- · Install the unit on a flat level base.
- While installing the unit, keep space and fix the unit's legs with 4 anchor bolts as shown in the figure below. The protrusion of an anchor bolt from the foundation surface must be kept within 15mm.




## **⚠** CAUTION

- Install the unit properly so that it does not fall over during earthquake, strong wind, etc.
   Make sure that unit is installed on a flat level base. Installing unit on uneven base may result in unit

### 3. PREPARATION FOR WORK


## 1. Removing service cover

rew. Slide service cover downwards and remove it



## 2. Removing terminal cover

move the screw and take out terminal cover




## 4. CONNECTING PIPING WORK

#### 1. Restrictions on unit installation

Abide by the following restrictions on unit installation.
Improper installation can cause compressor failure or perfo

	Dimensional restrictions	
	Model SRC20/25/35	Model SRC40/50/60
Connecting pipe length (L)	25m or less	30m or less
Elevation difference between indoor and outdoor units (H)*	15m or less	20m or less
* Outdoor unit in stallation		!! !-



er than the indoor unit installation position.

## 2. Preparation of connecting pipe

2.1 Selecting connecting pipe
Select connecting pipe according to the following table.

	Model SRC20/25/35	Model SRC40/50/60
Gas pipe	φ9.52	φ12.7
Liquid pipe	φ6.35	φ6.35

- Pipe wall thickness must be greater than or equal to 0.8mm.
  Pipe material must be O-type (Phosphorus deoxidized seamless copper pipe ICS 23.040.15, ICS 77.150.30).

## NOTE


If it is required to reuse the existing connecting pipe system, refer to 5. UTILIZATION OF EXISTING

- 2.2 Cutting connecting pipe
  (1) Cut the connecting pipe to the required length with pipe cutter.
  (2) Hold the pipe downward and remove the burrs. Make sure that no foreign material enters the pipe.
  (3) Cover the connecting pipe ends with the tape.

#### 3. Piping work


Check that both liquid and gas service valves are fully closed.

Carry out the piping work with service valves fully closed



#### 3.1 Flaring pipe

- 3.1 Flaring pipe (1) Take out flare nuts from the service valves of outdoor unit and engage them onto connecting pipes. (2) Flare the pipes according to table and figure shown below. Flare dimensions for R32 are different from those for conventional refrigerant. Although it is recommended to use the flaring tools designed specifically for R32 or R410A, conventional flaring tools can also be used by adjusting the dimension B with a flare adjustment gauge.






Copper pipe	B [Rigid (clutch) type]		
outer diameter	R32 or R410A	Conventional	
φ6.35			
φ9.52	0-0.5	1.0-1.5	
φ12.7			

### 3.2 Connecting pipes

(1) Connect pipes on both liquid and gas sides.
(2) Tighten nuts to specified torque shown in the table below

Service valve size (mm)	Tightening torque (N·m)	
φ6.35 (1/4")	14-18	
φ9.52 (3/8")	34-42	
φ12.7 (1/2")	49-61	



#### Do not hold the valve cap area with a spann

#### **⚠** CAUTION

- Do not apply refrigerating machine oil to the flared surface. It can cause refrigerant leakage
- Do not apply excess torque to the flared nuts. The flared nuts may crack resulting in refrigerant leakage.

#### 4. Evacuation

- (1) Connect vacuum pump to gauge manifold. Connect charge hose of gauge manifold to service port of outdoor unit.

- of outdoor unit.

  (2) Run the vacuum pump for at least one hour after the vacuum gauge shows -0.1MPa (-76cm Hg),

  (3) Confirm that the vacuum gauge indicator does not rise even if the system is left for 15 minutes or more. Vacuum gauge indicator will rise if the system has moisture left inside or has a leakage point. Check the system for the leakage point. If leakage point is found, repair it and return to (1) again.

  (4) Close the Handle Lo and stop the vacuum pump.

  Keep this state for a few minutes to make sure that the compound pressure gauge pointer does not swing back.

  (5) Remove valve caps from liquid service valve and gas service valve.
- (5) Remove valve caps from liquid service valve and gas service valve.

  (6) Turn the liquid service valve's rod 90 degree counterclockwise with a hexagonal wrench key to open
- valve.


  Close it after 5 seconds, and check for gas leakage.
  Using soapy water, check for gas leakage from indoor unit's flare and outdoor unit's flare and valve rods.

  Wipe off all the water after completing the check.

  (7) Disconnect charging hose from gas service valve's service port and fully open liquid and gas service valves. (Do not attempt to turn valve rod beyond its stop.)

  (8) Tighten service valve caps and service port cap to the specified torque shown in the table below.

Service valve size (mm)	Service valve cap tightening torque (N·m)	Service port cap tightening torque (N·m)
φ6.35 (1/4")	20-30	
φ9.52 (3/8")	20-30	10-12
φ12.7 (1/2")	25-35	



#### **⚠** CAUTION

To prevent vacuum pump oil from entering into the refrigerant system, use a counterflow prevention adapter.

**5. Additional refrigerant charge**Additional refrigerant charge is required only when connecting pipe length exceeds 15m.

5.1 Calculating additional refrigerant charge
Additional refrigerant charge can be calculated using the formula given below.
Additional refrigerant charge (g) = { Connecting pipe length (m) – Factory charged length 15 (m) } x 20 (g/m)

## NOTE

- If additional refrigerant charge calculation result is negative, there is no need to remove the refrigerant.
- If refrigerant recharge is required for the unit with connecting pipe length 15m or shorter, charge the factory charged amount as shown in the table below.
- The maximum refrigerant charge amount is designed as shown in the table below.

	Model SRC 20/25/35	Model SRC40/50/60
The factory refrigerant charge amount (kg)	1.20	1.30
The maximum refrigerant charge amount (kg)	1.40	1.60

## 5.2 Charging refrigerant


- 2.2 charging rerrigerant
   Charge the R32 refrigerant in liquid phase from service port with both liquid and gas service valves shut. Since R32 refrigerant must be charged in the liquid phase, make sure that refrigerant is discharged from the cylinder in the liquid phase all the time.
   When it is difficult to charge a required refrigerant amount, fully open both liquid and gas service valves and charge refrigerant, while running the unit in the cooling mode. When refrigerant is charged with the unit being run, complete the charge operation within 30 minutes.
   Write the additional refrigerant charge calculated from the connecting pipe length on the label attached on the service cover.

### **⚠** CAUTION

- · Running the unit with an insufficient quantity of refrigerant for a long time can cause unit malfunction.
- · Do not charge more than the maximum refrigerant amount. It can cause unit malfunction

### 5. UTILIZATION OF EXISTING PIPE

(1) Check whether an existing pipe system is reusable or not by using the following flow chart.



Consult with our distributor in the area, if you need to recover refrigerant and charge it again.

(2) Clean the existing pipe system according to the procedure given below.

(a) Carry out forced cooling operation of existing unit for 30 minutes.

For 'Forced cooling operation' refer to the indoor unit installation manual.

(b) Stop the indoor fan and carry out forced cooling operation for 3 minutes (Liquid return).

(c) Close the liquid service valve of the outdoor unit and carry out pump down operation (Refer to 6. PUMP DOWN).

(d) Blow with nitrogen gas. If discolored refrigeration oil or any foreign matter is discharged by the blow, wash the pipe system or install a new pipe system.

(3) Remove the flare nuts from the existing pipe system. Go back to 4.CONNECTING PIPING WORK and proceed to step 2.2 Cutting connecting pipe.

#### **↑** CAUTION

- · Do not use the old flare nuts (of existing unit). Make sure that the flare nuts supplied with the (new) outdoor unit are used.
- If the flared / compression connection to the indoor unit is located inside the house / room then this pipework can't be reused.
- If the existing piping is specified as liquid pipe  $\phi$  9.52 or gas pipe  $\phi$  12.7, refer to the following. (SRC40,50 and 60 only

<Table of pipe size restrictions>


Additional charge amount per meter of pipe		0.054kg/m
Pipe size	Liquid pipe	φ9.52
Pipe size	Gas pipe	φ12.7
Maximum one-w	ay pipe length	10
Length covered	vithout additional charge	5

Additional charge amount  $(kg) = \{Main pipe length (m) - Length covered without additional charge shown in the table <math>(m)\}$  x Additional charge amount per meter of pipe shown in the table (kg/m)

#### 6. PUMP DOWN

- (1) Connect charge hose of gauge manifold to service port of outdoor unit. (2) Close the liquid service valve with hexagonal wrench key.

- (3) Fully open the gas service valve with hexagonal wrench key.(4) Carry out forced cooling operation (For forced cooling operation procedure, refer to indoor unit installation
- manual).
  (5) When the low pressure gauge becomes 0.01MPa, close the gas service valve and stop forced cooling



## 7. ELECTRICAL WIRING WORK

#### **⚠ WARNING**

- Make sure that all the electrical work is carried out in accordance with the national or regional electri-cal standards.
- Make sure that the earth leakage breaker and circuit breaker of appropriate capacities are installed Refer to the table given below).

  Do not turn on the power until the electrical work is completed.

  Do not turn on condensive capacitor for power factor improvement under any circumstances (It does not improve power factor. Moreover, it can cause an abnormal overheat accident).

Model	Phase	Earth leakage breaker	Circuit breaker
SRC20/25/35	Cinnla abass	Leakage current: 30mA,	Over current: 16A
SRC40/50/60	Single phase	0.1 sec or less	Over current: 20A

Main fuse specification

Model	Specification	Parts No.	Code on LABEL, WIRING
SRC20/25/35	250V 15A	SSA564A136	F7
SRC40/50/60	250V 20A	SSA564A136A	F4

#### 1. Preparing cable

(1) Selecting cable

Select the power source cable and connecting cable in accordance with the specifications mentioned below


(a) Power source cable
3 cores\* 2.5mm\* or more, conformed with 60245 IEC57
When selecting the power source cable length, make sure that voltage drop is less than 2%.
If the wire length gets longer, increase the wire diameter.

(b) Connecting cable 4 cores\* 1.5mm², conformed with 60245 IEC57

\* 1 Earth wire is included (Yellow/Green).

(2) Arrange each wire length as shown below

Make sure that each wire is stripped 10mm from the end.



(3) Attach round crimp-type terminal to each wire as shown in the below Select the size of round crimp-type terminal after considering the specifications of terminal block and wire



#### **⚠** CAUTION

Power source cable and connecting cable must conform to the specifications mentioned in the manual. Using cables with wrong specifications may result in unit malfunction.

#### 2. Connecting cable

- 2. Connecting cable

  (1) Remove the service cover and the terminal cover.

  (2) Connect the cables according to the instructions and figures given below.

  (a) Connect the earth wire of power source cable.

  An earth wire must be connected before connecting the other wires of power source cable.


  Keep the earth wire longer than the remaining two wires of power source cable.


  (b) Connect the remaining two wires (N and L) of power source cable.

  (c) Connect the wires of connecting cable. Make sure that for each wire, outdoor and indoor side terminal ourspace makes. minal numbers match.
  (3) Fasten the cables properly with cable clamps so that no external force may work on terminal connu

Moreover, make sure that cables do not touch the piping, etc. When cables are connected, make sure that all electrical components within the electrical component box are free of loose connector coupling or terminal connection

<Circuit diagram






## 8. FINISHING WORK

#### 1. Heating and condensation prevention

- insulation pad (standard accessory provided with indoor unit).

  (4) Wrap the connecting pipes, connecting cable and drain hose



## NOTE

Locations where relative humidity exceeds 70%, both liquid and gas pipes need to be dressed with 20mm or thicker heat insulation materials.

#### **⚠** CAUTION

- Improper insulation can cause condensate (water) formation during cooling operation.
- Condensate can leak or drip causing damage to household property.

  Poor heat insulating capacity can cause pipe outer surface to reach high temperature during heating operation. It can cause cable deterioration and personal injury.


#### 2. Finishing work

- (1) Dress the connecting pipes (both liquid and gas pipes) with insulation to prevent it from heating and dew condensation.

  Use the heat insulating material which can withstand 120°C or higher temperature. Make sure that insulation is wrapped tightly around the pipes and no gap is left between them.

  (2) Wrap the refrigerant piping of indoor unit with indoor unit well insulation using tape.

  (3) Cover the flare-connected joints (indoor side) with the indoor unit heat insulation and wrap it with an



#### 

Make sure that the connecting pipes do not touch the components within the unit. If pipes touch the internal components, it may go

## 9. INSTALLATION TEST CHECK POINTS

After finishing the installation work, check the following points again before turning on the power. Conduct test run (Refer to indoor unit installation manual) and ensure that the unit operates properly

Power source voltage complies with the rated voltage of air-conditioner. Earth leakage breaker and circuit breaker are installed. Power cable and connecting cable are securely fixed to the terminal block. Both liquid and gas service valves are fully open

No gas leaks from the joints of the service valves Indoor and outdoor side pipe joints have been insulated. Drain hose (if installed) is fixed properly. Screw of the terminal cover and the service cover are tightened properly.

## (3) Safety precautions in handling air-conditioners with flammable refrigerant

(a) Models SRC20ZSX-W SRC25ZSX-W SRC35ZSX-W SRC50ZSX-W, -W1 SRC60ZSX-W, -W1

# WALL TYPE AIR-CONDITIONER R32 REFRIGERANT USED





This equipment uses flammable refrigerants. If the refrigerant is leaked, together with an external ignition source, there is a possibility of ignition.



There is information included in the user's manual and/or installation manual.



The user's manual should be read carefully.

A service personnel should be handing this equipment with reference to the installation manual.

The precautionary items mentioned below are distinguished into two levels, 
 \( \bar{\Lambda} \) WARNING and 
 \( \bar{\Lambda} \) CAUTION.

MARNING: Wrong installation would cause serious consequences such as injuries or death.

⚠ CAUTION : Wrong installation might cause serious consequences depending on circumstances.

#### **⚠ WARNING**

- Strict compliance of the domestic laws must be observed when disposing the appliance.
- observed when disposing the appliance.
   Do not use means to accelerate the defrost operation process or to clean, other than those recommended by the manufacturer.
- The appliance shall be stored in a room without continuously operating ignition sources (for example: open flames, an operating gas appliance or an operating electric heater.
- Do not pierce or burn.
- Be aware that refrigerants may not contain an odour.
- The indoor unit shall be stored in a room that has a minimum area of 4.0 m<sup>2</sup>.

## **⚠** CAUTION

### 1. General

- That the installation of pipe-work shall be kept to a minimum
- That pipe-work shall be protected from physical damage.
- That compliance with national gas regulations shall be observed.
   That mechanical connections shall be accessible
- That mechanical connections shall be accessible for maintenance purposes.
- Keep any required ventilation openings clear of obstruction.
- Servicing shall be performed only as recommended by the manufacturer.

#### 2. Unventilated areas

 The appliance shall be stored in a well-ventilated area where the room size corresponds to the room area as specified for operation.

#### 3. Qualification of workers

 The staff in servicing operations must hold the national qualification or other relevant qualifications.

#### 4. Information on servicing

- 4.1 Checks to the area
- Prior to beginning work on systems containing flammable refrigerants, safety checks are necessary to ensure that the risk of ignition is minimised.
- For repair to the refrigerating system, 4.3 to 4.7 shall be completed prior to conducting work on the system.
- 4.2 Work procedure
- Work shall be undertaken under a controlled procedure so as to minimise the risk of a flammable gas or vapour being present while the work is being performed.
- 4.3 General work area
- All maintenance staff and others working in the local area shall be instructed on the nature of work being carried out.
- · Work in confined spaces shall be avoided.
- The area around the workspace shall be sectioned off.
- Ensure that the conditions within the area have been made safe by control of flammable material.
- 4.4 Checking for presence of refrigerant
- The area shall be checked with an appropriate refrigerant detector prior to and during work, to ensure the technician is aware of potentially toxic or flammable atmospheres.
- Ensure that the leak detection equipment being used is suitable for use with all applicable refrigerants, i.e.
- non-sparking, adequately sealed or intrinsically safe.

- 4.5 Presence of fire extinguisher
- If any hot work is to be conducted on the refrigeration equipment or any associated parts, appropriate fire extinguishing equipment shall be available to hand. Have a dry powder or CO₂ fire extinguisher adjacent to the charging area.
- 4.6 No ignition sources
- No person carrying out work in relation to a refrigeration system which involves exposing any pipe work shall use any sources of ignition in such a manner that it may lead to the risk of fire or explosion.
- All possible ignition sources, including cigarette smoking, should be kept sufficiently far away from the site of installation, repairing, removing and disposal, during which refrigerant can possibly be released to the surrounding space.
- Prior to work taking place, the area around the equipment is to be surveyed to make sure that there are no flammable hazards or ignition risks.
- "No Smoking" signs shall be displayed.
- 4.7 Ventilated area
- Ensure that the area is in the open or that it is adequately ventilated before breaking into the system or conducting any hot work.
- A degree of ventilation shall continue during the period that the work is carried out.
- The ventilation should safely disperse any released refrigerant and preferably expel it externally into the atmosphere.
- 4.8 Checks to the refrigeration equipment
- Where electrical components are being changed, they shall be fit for the purpose and to the correct specification
- At all times the manufacturer's maintenance and service guidelines shall be followed.
- If in doubt consult the manufacturer's technical department for assistance.
- The following checks shall be applied to installations using flammable refrigerants:
  - the charge size is in accordance with the room size within which the refrigerant containing parts are installed:
- the ventilation machinery and outlets are operating adequately and are not obstructed;
- if an indirect refrigerating circuit is being used, the secondary circuit shall be checked for the presence of refrigerant;
- marking to the equipment continues to be visible and legible. Markings and signs that are illegible shall be corrected;
- refrigeration pipe or components are installed in a position where they are unlikely to be exposed to any substance which may corrode refrigerant containing components, unless the components are constructed of materials which are inherently resistant to being corroded or are suitably protected against being so corroded.

- 4.9 Checks to electrical devices
- Repair and maintenance to electrical components shall include initial safety checks and component inspection procedures.
- If a fault exists that could compromise safety, then no electrical supply shall be connected to the circuit until it is satisfactorily dealt with.
- If the fault cannot be corrected immediately but it is necessary to continue operation, an adequate temporary solution shall be used.
- This shall be reported to the owner of the equipment so all parties are advised.
- Initial safety checks shall include:
- that capacitors are discharged: this shall be done in a safe manner to avoid possibility of sparking;
- that no live electrical components and wiring are exposed while charging, recovering or purging the system:
- that there is continuity of earth bonding.

#### 5. Repairs to sealed components

- During repairs to sealed components, all electrical supplies shall be disconnected from the equipment being worked upon prior to any removal of sealed covers, etc.
- If it is absolutely necessary to have an electrical supply to equipment during servicing, then a permanently operating form of leak detection shall be located at the most critical point to warn of a potentially hazardous situation.
- Particular attention shall be paid to the following to ensure that by working on electrical components, the casing is not altered in such a way that the level of protection is affected.
- This shall include damage to cables, excessive number of connections, terminals not made to original specification, damage to seals, incorrect fitting of glands, etc.
- Ensure that the apparatus is mounted securely.
- Ensure that seals or sealing materials have not degraded to the point that they no longer serve the purpose of preventing the ingress of flammable atmosphares
- Replacement parts shall be in accordance with the manufacturer's specifications.

#### NOTE

The use of silicon sealant can inhibit the effectiveness of some types of leak detection equipment. Intrinsically safe components do not have to be isolated prior to working on them.

#### **⚠** CAUTION

#### 6. Repair to intrinsically safe components

- Do not apply any permanent inductive or capacitance loads to the circuit without ensuring that this will not exceed the permissible voltage and current permitted for the equipment in use.
- Intrinsically safe components are the only types that can be worked on while live in the presence of a flammable atmosphere.
- The test apparatus shall be at the correct rating
- Replace components only with parts specified by the manufacturer.
- Other parts may result in the ignition of refrigerant in the atmosphere from a leak

#### 7. Cabling

Check that cabling will not be subject to wear, corrosion, excessive pressure, vibration, sharp edges or any other adverse environmental effects The check shall also take into account the effects of aging or continual vibration from sources such as compressors or fans

## 8. Detection of flammable refrigerants

- Under no circumstances shall potential sources of ignition be used in the searching for or detection of refrigerant leaks.
- A halide torch (or any other detector using a naked flame) shall not be used.

#### 9. Leak detection methods

- Electronic leak detectors may be used to detect refrigerant leaks but, in the case of flammable refrigerants, the sensitivity may not be adequate, or may need re-calibration. (Detection equipment shall be calibrated in a refrigerant-free area.)
- Ensure that the detector is not a potential source of ignition and is suitable for the refrigerant used
- Leak detection equipment shall be set at a percentage of the LFL of the refrigerant and shall be calibrated to the refrigerant employed, and the appropriate percentage of gas (25 % maximum) is confirmed.
- Leak detection fluids are suitable for use with most refrigerants but the use of detergents containing chlorine shall be avoided as the chlorine may react with the refrigerant and corrode the copper pipe-work.
- If a leak is suspected, all naked flames shall be removed/extinguished.
- If a leakage of refrigerant is found which requires brazing, all of the refrigerant shall be recovered from the system, or isolated (by means of shut off valves) in a part of the system remote from the leak
- For appliances containing flammable refrigerants, oxygen free nitrogen (OFN) shall then be purged through the system both before and during the brazing process.

## 10. Removal and evacuation

- · When breaking into the refrigerant circuit to make repairs – or for any other purpose – conventional procedures shall be used. However, for flammable refrigerants it is important that best practice is
- followed since flammability is a consideration. The following procedure shall be adhered to:

   remove refrigerant;
- purge the circuit with inert gas;
- evacuate:
- purge again with inert gas;
- open the circuit by cutting or brazing.
- The refrigerant charge shall be recovered into the correct recovery cylinders.
- For appliances containing flammable refrigerants, the system shall be "flushed" with OFN to render the unit safe.
- This process may need to be repeated several times
- Compressed air or oxygen shall not be used for purging refrigerant systems.

- For appliances containing flammable refrigerants, flushing shall be achieved by breaking the vacuum in the system with OFN and continuing to fill until the working pressure is achieved, then venting to atmosphere, and finally pulling down to a vacuum. This process shall be repeated until no refrigerant is within the system.
- When the final OFN charge is used, the system shall be vented down to atmospheric pressure to enable work to take place.
- This operation is absolutely vital if brazing operations on the pipe-work are to take place. Ensure that the outlet for the vacuum pump is not
- close to any ignition sources and that ventilation is available

#### 11. Charging procedures

- In addition to conventional charging procedures, the following requirements shall be followed
- Ensure that contamination of different refrigerants does not occur when using charging equipment. Hoses or lines shall be as short as possible to minimise the amount of refrigerant contained in
- Cylinders shall be kept upright.Ensure that the refrigeration system is earthed prior to charging the system with refrigerant
- Label the system when charging is complete (if not already).
- Extreme care shall be taken not to overfill the refrigeration system.
- Prior to recharging the system, it shall be pressure-tested with the appropriate purging gas.
- The system shall be leak-tested on completion of charging but prior to commissioning.

  A follow up leak test shall be carried out prior to
- leaving the site.

#### 12. Decommissioning

- Before carrying out this procedure, it is essential that the technician is completely familiar with the equipment and all its detail.
- It is recommended good practice that all refrigerants are recovered safely.
- Prior to the task being carried out, an oil and refrigerant sample shall be taken in case analysis is required prior to re-use of reclaimed refrigerant
- It is essential that electrical power is available before the task is commenced.
- a) Become familiar with the equipment and its operation.
- b) Isolate system electrically.
- c) Before attempting the procedure ensure that: mechanical handling equipment is available, if required, for handling refrigerant cylinders;
- all personal protective equipment is available and being used correctly;
- the recovery process is supervised at all times by a competent person;
- recovery equipment and cylinders conform to the appropriate standards.
- d) Pump down refrigerant system, if possible.
- e) If a vacuum is not possible, make a manifold so that refrigerant can be removed from various parts of the system.
- f) Make sure that cylinder is situated on the scales before recovery takes place.
- g) Start the recovery machine and operate in accordance with manufacturer's instructions.
- h) Do not overfill cylinders. (No more than 80 %
- volume liquid charge).

  Do not exceed the maximum working pressure of the cylinder, even temporarily.
- When the cylinders have been filled correctly and the process completed, make sure that the cylinders and the equipment are removed from site promptly and all isolation valves on the equipment are closed off.
- k) Recovered refrigerant shall not be charged into another refrigeration system unless it has been cleaned and checked.

#### 13. Labelling

- Equipment shall be labelled stating that it has been de-commissioned and emptied of refrigerant. The label shall be dated and signed.
- For appliances containing flammable refrigerants, ensure that there are labels on the equipment stating the equipment contains flammable refrigerant.

### 14. Recovery

- When removing refrigerant from a system, either for servicing or decommissioning, it is recommended good practice that all refrigerants are removed
- When transferring refrigerant into cylinders, ensure that only appropriate refrigerant recovery cylinders are employed.
- Ensure that the correct number of cylinders for holding the total system charge are available.
- All cylinders to be used are designated for the recovered refrigerant and labelled for that refrigerant (i.e. special cylinders for the recovery of refrigerant).
- Cylinders shall be complete with pressure relief valve and associated shut-off valves in good working order.
- Empty recovery cylinders are evacuated and, if possible, cooled before recovery occurs.
- The recovery equipment shall be in good working order with a set of instructions concerning the equipment that is at hand and shall be suitable for the recovery of all appropriate refrigerants
- including, when applicable, flammable refrigerants. In addition, a set of calibrated weighing scales shall be available and in good working order.
- Hoses shall be complete with leak-free disconnect couplings and in good condition. Before using the recovery machine, check that it
- is in satisfactory working order, has been properly maintained and that any associated electrical components are sealed to prevent ignition in the event of a refrigerant release.
- Consult manufacturer if in doubt.
- The recovered refrigerant shall be returned to the refrigerant supplier in the correct recovery cylinder, and the relevant Waste Transfer Note arranged. Do not mix refrigerants in recovery units and especially not in cylinders.
- If compressors or compressor oils are to be removed, ensure that they have been evacuated to an acceptable level to make certain that flammable refrigerant does not remain within the lubricant.
- The evacuation process shall be carried out prior to returning the compressor to the suppliers.
- Only electric heating to the compressor body shall
- be employed to accelerate this process. When oil is drained from a system, it shall be carried out safely.

#### (15. Other safety precautions

- A brazed, welded, or mechanical connection shall be made before opening the valves to permit refrigerant to flow between the refrigerating system parts.
- Flammable refrigerant used, refrigerant tubing protected or enclosed to avoid mechanical damage (IEC/EN 60335-2-40/A1).
- Tubing protected to extent that it will not be handled or used for carrying during moving of product (IEC/ EN 60335-2-40/A1).
- Flammable refrigerant used, low temperature solder alloys, such as lead/tin alloys, not acceptable for pipe connections (IEC/EN 60335-2-40/A1).
- When there is flare connection, it must be installed outdoor

#### (b) Model SRC50ZSX-W2

RSA012A090A ⚠



This equipment uses flammable refrigerants. If the refrigerant is leaked, together with an external ignition source, there is a possibility of ignition.



There is information included in the user's manual and/or installation manual.



The user's manual should be read carefully.



A service personnel should be handing this equipment with reference to the installation manual.

- · This safety precaution sheet is for R32 refrigerant. If you want to know the type of refrigerant in the unit, check the label attached to the outdoor unit.
- The precautionary items mentioned below are distinguished into two levels, A WARNING and A CAUTION.

⚠ WARNING : Wrong installation would cause serious consequences such as injuries or death.

⚠ CAUTION : Wrong installation might cause serious consequences depending on circumstances.

#### **⚠ WARNING**

- Strict compliance of the domestic laws must be observed when disposing the appliance.
- Do not use means to accelerate the defrost operation process or to clean, other than those recommended by the manufacturer.
- The appliance shall be stored in a room without continuously operating ignition sources (for example: open flames, an operating gas appliance or an operating electric heater).
- · Do not pierce or burn.
- Be aware that refrigerants may not contain an

## **⚠** CAUTION

#### 1. General

- That the installation of pipe-work shall be kept to a minimum.
- That pipe-work shall be protected from physical damage.
- That compliance with national gas regulations shall be observed.
- That mechanical connections shall be accessible for maintenance purposes.
- Keep any required ventilation openings clear of obstruction.
- Servicing shall be performed only as recommended by the manufacturer.

  The instance of the control of the
- Equipment piping in the occupied space shall be installed in such a way to protect against accidental damage in operation and service.
- Precautions shall be taken to avoid excessive vibration or pulsation to refrigerating piping.
- Protection devices, piping and fittings shall be protected as far as possible against adverse environmental effects, for example, the danger of water collecting and freezing in relief pipes or the accumulation of dirt and debris.
- Provision shall be made for expansion and contraction of long runs of piping.
- Piping in refrigerating systems shall be so designed and installed to minimize the likelihood hydraulic shock damaging the system.
- The indoor equipment and pipes shall be securely mounted and guarded such that accidental rupture of equipment cannot occur from such events as moving furniture or reconstruction activities.

### 2. Unventilated areas

 The appliance shall be stored in a well-ventilated area where the room size corresponds to the room area as specified for operation.

## Qualification of workers

 The staff in servicing operations must hold the national qualification or other relevant qualifications.

## 4. Information on servicing

- 4.1 Checks to the area
- Prior to beginning work on systems containing flammable refrigerants, safety checks are necessary to ensure that the risk of ignition is minimised.
- For repair to the refrigerating system, 4.2 to 4.6 shall be completed prior to conducting work on the system.
- 4.2 Work procedure
- Work shall be undertaken under a controlled procedure so as to minimise the risk of a flammable gas or vapour being present while the work is being performed.

- 4.3 General work area
- All maintenance staff and others working in the local area shall be instructed on the nature of work being carried out.
- Work in confined spaces shall be avoided
- 4.4 Checking for presence of refrigerant
- The area shall be checked with an appropriate refrigerant detector prior to and during work, to ensure the technician is aware of potentially toxic or flammable atmospheres.
- Ensure that the leak detection equipment being used is suitable for use with all applicable refrigerants, i.e. non-sparking, adequately sealed or intrinsically safe.
- 4.5 Presence of fire extinguisher
- If any hot work is to be conducted on the refrigerating equipment or any associated parts, appropriate fire extinguishing equipment shall be available to hand. Have a dry powder or CO<sub>2</sub> fire extinguisher adjacent to the charging area.
- 4.6 No ignition sources
- No person carrying out work in relation to a refrigerating system which involves exposing any pipe work shall use any sources of ignition in such a manner that it may lead to the risk of fire or explosion.
- All possible ignition sources, including cigarette smoking, should be kept sufficiently far away from the site of installation, repairing, removing and disposal, during which refrigerant can possibly be released to the surrounding space.
- Prior to work taking place, the area around the equipment is to be surveyed to make sure that there are no flammable hazards or ignition risks.
- "No Smoking" signs shall be displayed.
- 4.7 Ventilated area
- Ensure that the area is in the open or that it is adequately ventilated before breaking into the system or conducting any hot work.
- A degree of ventilation shall continue during the period that the work is carried out.
- The ventilation should safely disperse any released refrigerant and preferably expel it externally into the atmosphere.
- 4.8 Checks to the refrigerating equipment
- Where electrical components are being changed, they shall be fit for the purpose and to the correct specification.
- At all times the manufacturer's maintenance and service guidelines shall be followed.
- If in doubt consult the manufacturer's technical department for assistance.
- The following checks shall be applied to installations using flammable refrigerants:
   the actual refrigerant aboves in in according
  - the actual refrigerant charge is in accordance with the room size within which the refrigerant containing parts are installed;

- the ventilation machinery and outlets are operating adequately and are not obstructed;
   if an indirect refrigerating circuit is being used,
- if an indirect refrigerating circuit is being used, the secondary circuit shall be checked for the presence of refrigerant;
- marking to the equipment continues to be visible and legible. Markings and signs that are illegible shall be corrected:
- refrigerating pipe or components are installed in a position where they are unlikely to be exposed to any substance which may corrode refrigerant containing components, unless the components are constructed of materials which are inherently resistant to being corroded or are suitably protected against being so corroded.
- 4.9 Checks to electrical devices
- Repair and maintenance to electrical components shall include initial safety checks and component inspection procedures.
- If a fault exists that could compromise safety, then no electrical supply shall be connected to the circuit until it is satisfactorily dealt with.
- If the fault cannot be corrected immediately but it is necessary to continue operation, an adequate temporary solution shall be used.
- This shall be reported to the owner of the equipment so all parties are advised.
- Initial safety checks shall include:
  - that capacitors are discharged: this shall be done in a safe manner to avoid possibility of sparking;
- that no live electrical components and wiring are exposed while charging, recovering or purging the system;
- that there is continuity of earth bonding.

## 5. Repairs to sealed components

- During repairs to sealed components, all electrical supplies shall be disconnected from the equipment being worked upon prior to any removal of sealed covers, etc.
- If it is absolutely necessary to have an electrical supply to equipment during servicing, then a permanently operating form of leak detection shall be located at the most critical point to warn of a potentially hazardous situation.
- Particular attention shall be paid to the following to ensure that by working on electrical components, the casing is not altered in such a way that the level of protection is affected.
- This shall include damage to cables, excessive number of connections, terminals not made to original specification, damage to seals, incorrect fitting of glands, etc.
- Ensure that the apparatus is mounted securely.

#### **⚠** CAUTION

- Ensure that seals or sealing materials have not degraded to the point that they no longer serve the purpose of preventing the ingress of flammable atmospheres
- Replacement parts shall be in accordance with the manufacturer's specifications.

#### 6. Repair to intrinsically safe components

- Do not apply any permanent inductive or capacitance loads to the circuit without ensuring that this will not exceed the permissible voltage and current permitted for the equipment in use.
- Intrinsically safe components are the only types that can be worked on while live in the presence of a flammable atmosphere.
  The test apparatus shall be at the correct rating.
- Replace components only with parts specified by the manufacturer.
- Other parts may result in the ignition of refrigerant in the atmosphere from a leak

The use of silicon sealant can inhibit the effectiveness of some types of leak detection equipment. Intrinsically safe components do not have to be isolated prior to working on them.

#### (7. Cabling)

Check that cabling will not be subject to wear, corrosion, excessive pressure, vibration, sharp edges or any other adverse environmental effects. The check shall also take into account the effects of aging or continual vibration from sources such as compressors or fans.

#### 8. Detection of flammable refrigerants

- Under no circumstances shall potential sources of ignition be used in the searching for or detection of refrigerant leaks.
- A halide torch (or any other detector using a naked
- flame) shall not be used. Electronic leak detectors may be used to detect refrigerant leaks but, in the case of flammable refrigerants, the sensitivity may not be adequate, or may need re-calibration. (Detection equipment shall be calibrated in a refrigerant-free area.)
- Ensure that the detector is not a potential source of ignition and is suitable for the refrigerant used.
- Leak detection equipment shall be set at a percentage of the LFL of the refrigerant and shall be calibrated to the refrigerant employed, and the appropriate percentage of gas (25 % maximum) is confirmed.
- Leak detection fluids are suitable for use with most refrigerants but the use of detergents containing chlorine shall be avoided as the chlorine may react with the refrigerant and corrode the copper pipe-work.

Examples of leak detection fluids are

- bubble method,
- fluorescent method agents.
- If a leak is suspected, all naked flames shall be removed/extinguished.
- If a leakage of refrigerant is found which requires brazing, all of the refrigerant shall be recovered from the system, or isolated (by means of shut off valves) in a part of the system remote from the leak.
- Removal of refrigerant shall be according to Item 9.

## 9. Removal and evacuation

- When breaking into the refrigerant circuit to make repairs – or for any other purpose – conventional procedures shall be used. However, for flammable refrigerants it is important that best practice is followed since flammability is a consideration.
- The following procedure shall be adhered to:
- remove refrigerant;purge the circuit with inert gas (option for A2L);
- evacuate (option for A2L);
   purge with inert gas (option for A2L);
   open the circuit by cutting or brazing.

- · The refrigerant charge shall be recovered into the correct recovery cylinders.
  For appliances containing flammable refrigerants
- other than A2L refrigerants, the system shall be purged with oxygen-free nitrogen to render the appliance safe.
- This process may need to be repeated several times.
- Compressed air or oxygen shall not be used for purging refrigerant systems.
- For appliances containing flammable refrigerants, other than A2L refrigerants, refrigerants purging shall be achieved by breaking the vacuum in the system with oxygen-free nitrogen and continuing to fill until the working pressure is achieved, then venting to atmosphere, and finally pulling down to a vacuum. This process shall be repeated until no refrigerant is within the system.
- When the final oxygen-free nitrogen charge is used, the system shall be vented down to atmospheric pressure to enable work to take place. This operation is absolutely vital if brazing operations on the pipe-work are to take place.
- Ensure that the outlet for the vacuum pump is not close to any ignition sources and that ventilation is available.

#### 10. Charging procedures

- In addition to conventional charging procedures, the following requirements shall be followed.

  – Ensure that contamination of different refrigerants
- does not occur when using charging equipment. Hoses or lines shall be as short as possible to minimise the amount of refrigerant contained in
- Cylinders shall be kept in an appropriate position according to the instructions.
- Ensure that the refrigerating system is earthed
- prior to charging the system with refrigerant. Label the system when charging is complete (if not already).
- Extreme care shall be taken not to overfill the refrigerating system.
- Prior to recharging the system, it shall be pressure-tested with the appropriate purging gas.
- The system shall be leak-tested on completion of charging but prior to commissioning
- A follow up leak test shall be carried out prior to leaving the site.

## ( 11. Decommissioning

- Before carrying out this procedure, it is essential that the technician is completely familiar with the equipment and all its detail.
- It is recommended good practice that all refrigerants are recovered safely.
- Prior to the task being carried out, an oil and refrigerant sample shall be taken in case analysis is required prior to re-use of recovered refrigerant.
- It is essential that electrical power is available before the task is commenced.
- a) Become familiar with the equipment and its operation.b) Isolate system electrically.
- c) Before attempting the procedure ensure that:
  - mechanical handling equipment is available, if required, for handling refrigerant cylinders;
  - all personal protective equipment is available and being used correctly; the recovery process is supervised at all times by
  - a competent person;
  - recovery equipment and cylinders conform to the appropriate standards.
- d) Pump down refrigerant system, if possible
- e) If a vacuum is not possible, make a manifold so that refrigerant can be removed from various parts of the system.
- f) Make sure that cylinder is situated on the scales before recovery takes place.
- g) Start the recovery machine and operate in accordance with instructions.
- h) Do not overfill cylinders. (No more than 80 %
- volume liquid charge).
  i) Do not exceed the maximum working pressure of the cylinder, even temporarily.

- j) When the cylinders have been filled correctly and the process completed, make sure that the cylinders and the equipment are removed from site promptly and all isolation valves on the equipment are closed off.
- k) Recovered refrigerant shall not be charged into another refrigerating system unless it has been cleaned and checked.

### 12. Labelling

- Equipment shall be labelled stating that it has been de-commissioned and emptied of refrigerant. The
- label shall be dated and signed.
  For appliances containing flammable refrigerants, ensure that there are labels on the equipment stating the equipment contains flammable refrigerant.

#### 13. Recovery

- When removing refrigerant from a system, either for servicing or decommissioning, it is recommended good practice that all refrigerants are removed
- safely.
  When transferring refrigerant into cylinders, ensure that only appropriate refrigerant recovery cylinder are employed.
- Ensure that the correct number of cylinders for holding the total system charge is available
- All cylinders to be used are designated for the recovered refrigerant and labelled for that refrigerant (i.e. special cylinders for the recovery of refrigerant).
- Cylinders shall be complete with pressure relief valve and associated shut-off valves in good working order.
- Empty recovery cylinders are evacuated and, if
- possible, cooled before recovery occurs.

  The recovery equipment shall be in good working order with a set of instructions concerning the equipment that is at hand and shall be suitable for the recovery of all appropriate refrigerants
- including, when applicable, flammable refrigerants. In addition, a set of calibrated weighing scales shall be available and in good working order
- Hoses shall be complete with leak-free disconnect couplings and in good condition.
- Before using the recovery machine, check that it is in satisfactory working order, has been properly maintained and that any associated electrical components are sealed to prevent ignition in the event of a refrigerant release. Consult manufacturer if in doubt.
- The recovered refrigerant shall be returned to the refrigerant supplier in the correct recovery cylinder, and the relevant Waste Transfer Note arranged. Do not mix refrigerants in recovery units and especially not in cylinders.
- If compressors or compressor oils are to be removed, ensure that they have been evacuated to an acceptable level to make certain that flammable refrigerant does not remain within the lubricant.
- The evacuation process shall be carried out prior to returning the compressor to the suppliers.
- Only electric heating to the compressor body shall be employed to accelerate this process.
- When oil is drained from a system, it shall be carried out safely.

## 14. Other safety precautions

- A brazed, welded, or mechanical connection shall be made before opening the valves to permit refrigerant
- to flow between the refrigerating system parts. Flammable refrigerant used, refrigerant tubing protected or enclosed to avoid mechanical damage (IEC/EN 60335-2-40/A1). Tubing protected to extent that it will not be handled
- or used for carrying during moving of product (IEC/ EN 60335-2-40/A1)
- Flammable refrigerant used, low temperature solder alloys, such as lead/tin alloys, not acceptable for pipe connections (IEC/EN 60335-2-40/A1).
- Do not use flare nut indoor which is locally procured.

## Selection of installation location for the indoor unit


• Minimum installation area for indoor unit

## **⚠** CAUTION

The indoor unit shall be installed in a room with minimum installation area or more according to the refrigerant charge amount (factory refrigerant charge + additional refrigerant charge).

For factory refrigerant charge, refer to the outdoor unit label model name or installation sheet.

For additional refrigerant charge, refer to the outdoor unit installation sheet.

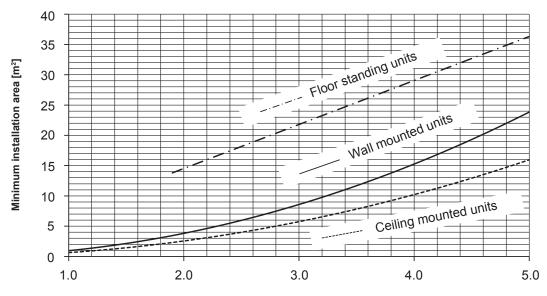

Refrigerant charge amount [kg]

Defrigerent charge	Minimum installation area		[m²]	
Refrigerant charge amount [kg]	Wall mounted units	Ceiling mounted units	Floor standing units	
1.0	1.0	0.6		
1.1	1.2	0.8		
1.2	1.4	0.9		
1.3	1.6	1.1		
1.4	1.9	1.3	No requirements	
1.5	2.1	1.4		
1.6	2.4	1.6		
1.7	2.8	1.8		
1.8	3.1	2.1		
1.9	3.4	2.3	13.8	
2.0	3.8	2.6	14.5	
2.1	4.2	2.8	15.3	
2.2	4.6	3.1	16.0	
2.3	5.0	3.4	16.7	
2.4	5.5	3.7	17.4	
2.5	6.0	4.0	18.2	
2.6	6.4	4.3	18.9	
2.7	7.0	4.7	19.6	
2.8	7.5	5.0	20.3	
2.9	8.0	5.4	21.1	
3.0	8.6	5.7	21.8	

Refrigerant charge amount [kg]	Minimum installation area [m²]			
	Wall mounted units	Ceiling mounted units	Floor standing units	
3.1	9.2	6.1	22.5	
3.2	9.8	6.5	23.2	
3.3	10.4	7.0	24.0	
3.4	11.0	7.4	24.7	
3.5	11.7	7.8	25.4	
3.6	12.4	8.3	26.1	
3.7	13.1	8.7	26.9	
3.8	13.8	9.2	27.6	
3.9	14.5	9.7	28.3	
4.0	15.3	10.2	29.0	
4.1	16.0	10.7	29.8	
4.2	16.8	11.3	30.5	
4.3	17.6	11.8	31.2	
4.4	18.5	12.4	32.0	
4.5	19.3	12.9	32.7	
4.6	20.2	13.5	33.4	
4.7	21.1	14.1	34.1	
4.8	22.0	14.7	34.9	
4.9	22.9	15.3	35.6	
5.0	23.8	16.0	36.3	

## (c) Models SRC50ZSX-W3, 60ZSX-W3

# RSA012A090D A

### R32 REFRIGERANT USED



This equipment uses flammable refrigerants. If the refrigerant is leaked, together with an external ignition source, there is a possibility of ignition.



There is information included in the user's manual and/or installation manual.



The user's manual should be read carefully.

A service personnel should be handing this equipment with reference to the installation manual.

- · This safety precaution sheet is for R32 refrigerant. If you want to know the type of refrigerant in the unit, check the label attached to the outdoor unit.
- The precautionary items mentioned below are distinguished into two levels, 🛕 WARNING and 🛕 CAUTION .

MARNING: Wrong installation would cause serious consequences such as injuries or death.

A CAUTION: Wrong installation might cause serious consequences depending on circumstances

#### **⚠ WARNING**

- Strict compliance of the domestic laws must be observed when disposing the appliance
- observed when disposing the appliance.

  Do not use means to accelerate the defrost operation process or to clean, other than those recommended by the manufacturer.
- The appliance shall be stored in a room without continuously operating ignition sources (for example open flames, an operating gas appliance or an operating electric heater).
- · Do not pierce or burn.
- Be aware that refrigerants may not contain an odour.
- The ducts connected to an appliance shall not contain a potential ignition source.

## **⚠** CAUTION

#### 1. General

- That the installation of pipe-work shall be kept to a minimum.
- That pipe-work shall be protected from physical damage.
   That compliance with national gas regulations shall
- be observed.

  That mechanical connections shall be accessible
- final mechanical connections shall be accessible for maintenance purposes.
   Keep any required ventilation openings clear of
- obstruction.Servicing shall be performed only as recommended
- Servicing snall be performed only as recommended by the manufacturer.

   Followers piping in the occupied space shall be
- Equipment piping in the occupied space shall be installed in such a way to protect against accidental damage in operation and service.
- Precautions shall be taken to avoid excessive vibration or pulsation to refrigerating piping.
- Protection devices, piping and fittings shall be protected as far as possible against adverse environmental effects, for example, the danger of water collecting and freezing in relief pipes or the accumulation of dirt and debris.
- Provision shall be made for expansion and contraction of long runs of piping.
- Piping in refrigerating systems shall be so designed and installed to minimize the likelihood hydraulic shock damaging the system.
- The indoor equipment and pipes shall be securely mounted and guarded such that accidental rupture of equipment cannot occur from such events as moving furniture or reconstruction activities.
- Instructions for wiring to external zoning dampers and/or mechanical ventilation, to ensure that upon detection of a leak, the zoning dampers are driven fully open and additional mechanical ventilation is activated
- For appliances using A2L refrigerants, connected via an air duct system to one or more rooms, the supply and return air shall be directly ducted to the space.
   Open areas such as false ceilings shall not be used as a return air duct.
- The following information requirements apply for enhanced tightness refrigerating systems using A2L refrigerants.
- Where safety shut off valves are specified, the minimum room area may be determined based on the maximum amount of refrigerant that can be leaked as determined in GG.12.2.
   (IEC 60335-2-40:2018)
- Where safety shut off valves are specified, the location of the valve in the refrigerating system relative to the occupied spaces shall be as described in GG.12.1.(IEC 60335-2-40:2018)

#### (2. Unventilated areas

- The appliance shall be stored in a well-ventilated area where the room size corresponds to the room area as specified for operation.
- If the refrigerant charge amount in the system is ≥ 1.84 kg, an unventilated area where the appliance is installed shall be so constructed that should any refrigerant leak, it will not stagnate so as to create a fire or explosion hazard.

#### (3. Qualification of workers

 The staff in servicing operations must hold the national qualification or other relevant qualifications.

#### 4. Information on servicing

- 4.1 Checks to the area
- Prior to beginning work on systems containing flammable refrigerants, safety checks are necessary to ensure that the risk of ignition is minimised.
- For repair to the refrigerating system, 4.2 to 4.6 shall be completed prior to conducting work on the system.

## 4.2 Work procedure

- Work shall be undertaken under a controlled procedure so as to minimise the risk of a flammable gas or vapour being present while the work is being performed.
- 4.3 General work area
- All maintenance staff and others working in the local area shall be instructed on the nature of work being carried out.
- Work in confined spaces shall be avoided.
- 4.4 Checking for presence of refrigerant
- The area shall be checked with an appropriate refrigerant detector prior to and during work, to ensure the technician is aware of potentially toxic or flammable atmospheres.
- Ensure that the leak detection equipment being used is suitable for use with all applicable refrigerants, i.e. non-sparking, adequately sealed or intrinsically safe.
- 4.5 Presence of fire extinguisherIf any hot work is to be conducted on the
- If any hot work is to be conducted on the refrigerating equipment or any associated parts, appropriate fire extinguishing equipment shall be available to hand. Have a dry powder or CO₂ fire extinguisher adjacent to the charging area.

- 4.6 No ignition sources
- No person carrying out work in relation to a refrigerating system which involves exposing any pipe work shall use any sources of ignition in such a manner that it may lead to the risk of fire or explosion.
- All possible ignition sources, including cigarette smoking, should be kept sufficiently far away from the site of installation, repairing, removing and disposal, during which refrigerant can possibly be released to the surrounding space.
   Prior to work taking place, the area around the
- Prior to work taking place, the area around the equipment is to be surveyed to make sure that there are no flammable hazards or ignition risks.
- "No Smoking" signs shall be displayed.
- 4.7 Ventilated area
- Ensure that the area is in the open or that it is adequately ventilated before breaking into the system or conducting any hot work.
- A degree of ventilation shall continue during the period that the work is carried out.
- The ventilation should safely disperse any released refrigerant and preferably expel it externally into the atmosphere.
- 4.8 Checks to the refrigerating equipment
- Where electrical components are being changed, they shall be fit for the purpose and to the correct specification.
- At all times the manufacturer's maintenance and service guidelines shall be followed.
   If in doubt consult the manufacturer's technical
- If in doubt consult the manufacturer's technical department for assistance.

  The state of t
- The following checks shall be applied to installations using flammable refrigerants:
- the actual refrigerant charge is in accordance with the room size within which the refrigerant containing parts are installed;
- the ventilation machinery and outlets are
- operating adequately and are not obstructed;
   if an indirect refrigerating circuit is being used,
  the secondary circuit shall be checked for the
  presence of refrigerant;
- marking to the equipment continues to be visible and legible. Markings and signs that are illegible shall be corrected;
- refrigerating pipe or components are installed in a position where they are unlikely to be exposed to any substance which may corrode refrigerant containing components, unless the components are constructed of materials which are inherently resistant to being corroded or are suitably protected against being so corroded.

#### **↑** CAUTION

#### 4.9 Checks to electrical devices

- Repair and maintenance to electrical components shall include initial safety checks and component inspection procedures.
- If a fault exists that could compromise safety, then no electrical supply shall be connected to the circuit until it is satisfactorily dealt with.

  If the fault cannot be corrected immediately but it
- is necessary to continue operation, an adequate temporary solution shall be used. This shall be reported to the owner of the
- equipment so all parties are advised.
- · Initial safety checks shall include:
- that capacitors are discharged: this shall be done in a safe manner to avoid possibility of sparking;
- that no live electrical components and wiring are exposed while charging, recovering or purging the system;
- that there is continuity of earth bonding

#### 5. Repairs to sealed components

- During repairs to sealed components, all electrical supplies shall be disconnected from the equipment being worked upon prior to any removal of sealed covers, etc.
- If it is absolutely necessary to have an electrical supply to equipment during servicing, then a permanently operating form of leak detection shall be located at the most critical point to warn of a potentially hazardous situation.
- Particular attention shall be paid to the following to ensure that by working on electrical components, the casing is not altered in such a way that the level of protection is affected.
- This shall include damage to cables, excessive number of connections, terminals not made to original specification, damage to seals, incorrect fitting of glands, etc.
- Ensure that the apparatus is mounted securely.
- Ensure that seals or sealing materials have not degraded to the point that they no longer serve the purpose of preventing the ingress of flammable atmospheres
- Replacement parts shall be in accordance with the manufacturer's specifications

#### (6. Repair to intrinsically safe components

- Do not apply any permanent inductive or capacitance loads to the circuit without ensuring that this will not exceed the permissible voltage and current permitted for the equipment in use. Intrinsically safe components are the only types that
- can be worked on while live in the presence of a flammable atmosphere.

  The test apparatus shall be at the correct rating.
- Replace components only with parts specified by the manufacturer.
- Other parts may result in the ignition of refrigerant in the atmosphere from a leak.

The use of silicon sealant can inhibit the effectiveness of some types of leak detection equipment. Intrinsically safe components do not have to be isolated prior to working on them

## Cabling

Check that cabling will not be subject to wear, corrosion, excessive pressure, vibration, sharp edges or any other adverse environmental effects. The check shall also take into account the effects of aging or continual vibration from sources such as compressors or fans

### (8. Detection of flammable refrigerants

- Under no circumstances shall potential sources of ignition be used in the searching for or detection of refrigerant leaks.
- A halide torch (or any other detector using a naked flame) shall not be used.
- Electronic leak detectors may be used to detect refrigerant leaks but, in the case of flammable refrigerants, the sensitivity may not be adequate, or may need re-calibration. (Detection equipment shall be calibrated in a refrigerant-free area.)
- Ensure that the detector is not a potential source of ignition and is suitable for the refrigerant used
- Leak detection equipment shall be set at a percentage of the LFL of the refrigerant and shall be calibrated to the refrigerant employed, and the appropriate percentage of gas (25 % maximum) is confirmed.
- Leak detection fluids are suitable for use with most refrigerants but the use of detergents containing chlorine shall be avoided as the chlorine may react with the refrigerant and corrode the copper pipe-work.

#### NOTE

Examples of leak detection fluids are

- bubble method.
- fluorescent method agents.
- If a leak is suspected, all naked flames shall be removed/extinguished.
- If a leakage of refrigerant is found which requires brazing, all of the refrigerant shall be recovered from the system, or isolated (by means of shut off valves) in a part of the system remote from the leak
- Removal of refrigerant shall be according to Item 9.

#### 9. Removal and evacuation

- When breaking into the refrigerant circuit to make repairs - or for any other purpose - conventional procedures shall be used. However, for flammable refrigerants it is important that best practice is followed since flammability is a consideration. The following procedure shall be adhered to:
- - remove refrigerant;
  - purge the circuit with inert gas (option for A2L);
- evacuate (option for A2L);
- purge with inert gas (option for A2L);
- open the circuit by cutting or brazing.
   The refrigerant charge shall be recovered into the
- correct recovery cylinders.
- For appliances containing flammable refrigerants other than A2L refrigerants, the system shall be purged with oxygen-free nitrogen to render the appliance safe for flammable refrigerants.
- This process may need to be repeated several times
- Compressed air or oxygen shall not be used for purging refrigerant systems.
- For appliances containing flammable refrigerants, other than A2L refrigerants, refrigerants purging shall be achieved by breaking the vacuum in the system with oxygen-free nitrogen and continuing to fill until the working pressure is achieved, then venting to atmosphere, and finally pulling down to a vacuum. This process shall be repeated until no refrigerant is within the system.
- When the final oxygen-free nitrogen charge is used, the system shall be vented down to atmospheric pressure to enable work to take place. This operation is absolutely vital if brazing operations on the pipe-work are to take place.
- Ensure that the outlet for the vacuum pump is not close to any ignition sources and that ventilation is

#### ( 10. Charging procedures

- In addition to conventional charging procedures, the following requirements shall be followed.
  - Ensure that contamination of different refrigerants does not occur when using charging equipment Hoses or lines shall be as short as possible to minimise the amount of refrigerant contained in
  - Cylinders shall be kept in an appropriate position according to the instructions
  - Ensure that the refrigerating system is earthed
  - prior to charging the system with refrigerant. Label the system when charging is complete (if not already).
  - Extreme care shall be taken not to overfill the
- refrigerating system.

  Prior to recharging the system, it shall be pressure-
- tested with the appropriate purging gas.

  The system shall be leak-tested on completion of charging but prior to commissioning
- A follow up leak test shall be carried out prior to leaving the site.

#### (11. Decommissioning)

- Before carrying out this procedure, it is essential that the technician is completely familiar with the equipment and all its detail.
- It is recommended good practice that all refrigerants are recovered safely.
- Prior to the task being carried out, an oil and refrigerant sample shall be taken in case analysis is required prior to re-use of recovered refrigerant.
- It is essential that electrical power is available before the task is commenced.
- a) Become familiar with the equipment and its operation.
- b) Isolate system electrically.
- c) Before attempting the procedure ensure that:
- mechanical handling equipment is available, if required, for handling refrigerant cylinders;
- all personal protective equipment is available and being used correctly;
- the recovery process is supervised at all times by a competent person;
- recovery equipment and cylinders conform to the appropriate standards.
- d) Pump down refrigerant system, if possible
- e) If a vacuum is not possible, make a manifold so that refrigerant can be removed from various parts of the system.
- f) Make sure that cylinder is situated on the scales before recovery takes place.
  g) Start the recovery machine and operate in
- accordance with instructions.
- h) Do not overfill cylinders. (No more than 80 %volume liquid charge).

  Do not exceed the maximum working pressure of
- the cylinder, even temporarily.
- j) When the cylinders have been filled correctly and the process completed, make sure that the cylinders and the equipment are removed from site promptly and all isolation valves on the equipment are closed off.
- k) Recovered refrigerant shall not be charged into another refrigerating system unless it has been cleaned and checked.

## (12. Labelling)

- Equipment shall be labelled stating that it has been de-commissioned and emptied of refrigerant. The label shall be dated and signed.
- For appliances containing flammable refrigerants, ensure that there are labels on the equipment stating the equipment contains flammable refrigerant.

## **⚠** CAUTION

### 13. Recovery

- When removing refrigerant from a system, either for servicing or decommissioning, it is recommended good practice that all refrigerants are removed safely.
- When transferring refrigerant into cylinders, ensure that only appropriate refrigerant recovery cylinders are employed.
  Ensure that the correct number of cylinders for
- Ensure that the correct number of cylinders fo holding the total system charge is available.
- All cylinders to be used are designated for the recovered refrigerant and labelled for that refrigerant (i.e. special cylinders for the recovery of refrigerant).
- Cylinders shall be complete with pressure relief valve and associated shut-off valves in good working order.
- Empty recovery cylinders are evacuated and, if possible, cooled before recovery occurs.
- The recovery equipment shall be in good working order with a set of instructions concerning the equipment that is at hand and shall be suitable for the recovery of all appropriate refrigerants including, when applicable, flammable refrigerants.

- In addition, a set of calibrated weighing scales shall be available and in good working order.
- Hoses shall be complete with leak-free disconnect couplings and in good condition.
- Before using the recovery machine, check that it is in satisfactory working order, has been properly maintained and that any associated electrical components are sealed to prevent ignition in the event of a refrigerant release.
   Consult manufacturer if in doubt.
- The recovered refrigerant shall be returned to the refrigerant supplier in the correct recovery cylinder, and the relevant Waste Transfer Note arranged.
   Do not mix refrigerants in recovery units and especially not in cylinders.
- If compressors or compressor oils are to be removed, ensure that they have been evacuated to an acceptable level to make certain that flammable refrigerant does not remain within the lubricant.
  The evacuation process shall be carried out prior to
- The evacuation process shall be carried out prior to returning the compressor to the suppliers.
- Only electric heating to the compressor body shall be employed to accelerate this process.
- When oil is drained from a system, it shall be carried out safely.

## 14. Other safety precautions

- A brazed, welded, or mechanical connection shall be made before opening the valves to permit refrigerant to flow between the refrigerating system parts.
- Flammable refrigerant used, refrigerant tubing protected or enclosed to avoid mechanical damage (IEC/EN 60335-2-40).
- Tubing protected to extent that it will not be handled or used for carrying during moving of product (IEC/EN 60335-2-40).
- Flammable refrigerant used, low temperature solder alloys, such as lead/tin alloys, not acceptable for pipe connections (IEC/EN 60335-2-40).
- Do not use flare nut indoor which is locally procured.

## Selection of installation location for the indoor unit

• Minimum installation area for indoor unit

## **⚠** CAUTION

The indoor unit shall be installed in a room with minimum installation area or more according to the refrigerant charge amount (factory refrigerant charge + additional refrigerant charge).

For factory refrigerant charge, refer to the outdoor unit label model name or installation sheet.

For additional refrigerant charge, refer to the outdoor unit installation sheet.

- If the refrigerant charge amount in the system is < 1.84 kg, there are no additional minimum floor area requirements.
- If the refrigerant charge amount in the system is  $\geqq$  1.84 kg, you need to comply with additional minimum floor area requirements as described in the following table.
- For further details regarding the installation location of indoor unit, refer to technical manual.

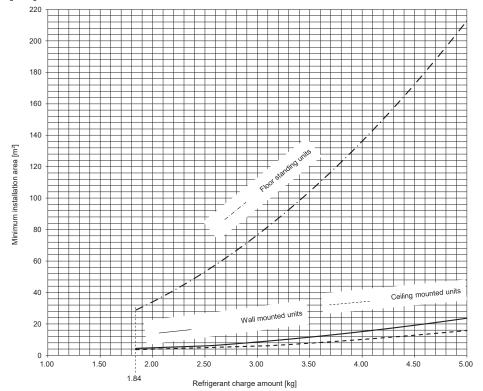


Figure 1. Minimum installation area (A min) graph

Table 1. Minimum installation area (A min) table

	Minimum installation area [m²]			
Refrigerant charge amount [kg]	Wall mounted units H=1.8 m	Ceiling mounted units H=2.2 m	Floor standing units H=0.6 m*	
1.00				
1.10				
1.20				
1.30				
1.40	No requirements			
1.50				
1.60				
1.70				
1.80				
1.84	4.44	3.64	28.82	
1.90	4.59	3.76	30.73	
2.00	4.83	3.95	34.05	
2.10	5.07	4.15	37.54	
2.20	5.31	4.35	41.20	
2.30	5.55	4.55	45.03	
2.40	5.80	4.74	49.03	
2.50	6.04	4.94	53.20	
2.60	6.40	5.14	57.54	
2.70	6.90	5.34	62.05	
2.80	7.42	5.53	66.73	
2.90	7.96	5.73	71.58	

	Minimum installation area [m²]			
Refrigerant charge amount [kg]	Wall mounted units H=1.8 m	Ceiling mounted units H=2.2 m	Floor standing units H=0.6 m*	
3.00	8.52	5.93	76.60	
3.10	9.09	6.12	81.79	
3.20	9.69	6.49	87.16	
3.30	10.30	6.90	92.69	
3.40	10.94	7.32	98.39	
3.50	11.59	7.76	104.26	
3.60	12.26	8.21	110.31	
3.70	12.95	8.67	116.52	
3.80	13.66	9.15	122.90	
3.90	14.39	9.63	129.45	
4.00	15.14	10.13	136.18	
4.10	15.90	10.65	143.07	
4.20	16.69	11.17	150.14	
4.30	17.49	11.71	157.37	
4.40	18.31	12.26	164.77	
4.50	19.15	12.82	172.35	
4.60	20.01	13.40	180.09	
4.70	20.89	13.99	188.01	
4.80	21.79	14.59	196.09	
4.90	22.71	15.20	204.35	
5.00	23.65	15.83	212.78	

\*For floor standing units, the value of installation height (H) is considered 0.6 m to comply to IEC 60335-2-40:2018 Clause GG.2.