



PLATE EXCHANGER

High-efficiency polymeric membrane counter-flow ERV

CASING (Standard)

Material: 24-gauge galvanized steel

Drain connections: optional

Duct connections: 5" (127 mm)

Insulation: EPS molded polystyrene

Length: 23" (584.2 mm)

Height: 19" (482.6 mm)

Width: 16" (406.4 mm)

Weight: 48 lb (22 kg)

Exhaust Damper: Closed by gravity

Swivel ports for horizontal, vertical, oblique or mixed installations.



MOUNTING

Mounting chains included

Wall mounting optional (P/N 699921)



ELECTRICAL SPECIFICATIONS

120 V, 60 Hz, 139 W, 2.41 A



FILTERS

(Standard)

Quantity:

2 washable MERV 6 filters (P/N 699771)

Optional filter types: MERV 8 (P/N 699772),

MERV 13 (P/N 699881)

InspirAIR® ELITE ERV

EK150-TFX

154 CFM at 0.4 in.w.g



UNIT



CORE



BLOWERS & MOTORS

Two motorized impellers (backwards inclined)

Quick-connect motors for easy and efficient maintenance
EC motor



DEFROST

Automatic Programmed Recirculation: Cycles are controlled by a temperature sensor when the outside temperature drops below 10.4°F (-12°C).

WARRANTY

Limited 5 years on the cores and all covered components.

WALL CONTROLS

Low voltage dry contact (24VAC) for interlock with heating and cooling systems. For more details, please refer to the wall control specification sheets.



Digital Multifunction Control (P/N 611242-FC)



LCD Electronic Multifunction Control (P/N 611227)




20/40/60 Minute Timer (P/N 611228)




Speed Control (Low/Intermittent/High)
(P/N 611229)



Mode Control (Recirculation) (P/N 611230)

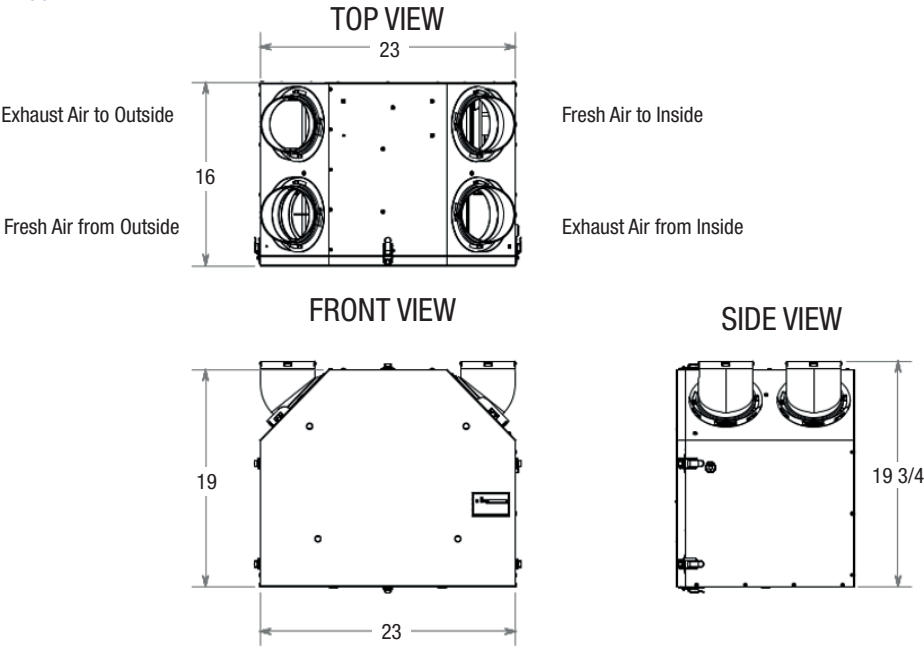

EK150-TFX: PERFORMANCE

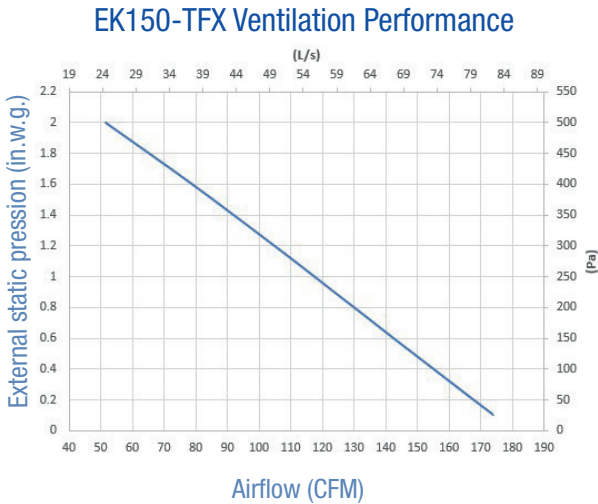

Thermal Performance – EK150-TFX								
Supply Temperature		Net Airflow		Power Consumed (w)	Sensible Recovery Efficiency	Adjusted Sensible Recovery Efficiency	Latent Recovery/ Moisture Transfer	Total Recovery Efficiency
°F	°C	CFM	L/s					
Heating								
32	0	50	23	23	83%	86%	74%	-
32	0	65	31	29	83%	86%	73%	-
14	-10	66	31	27	82%	84%	74%	-
Cooling								
95	35	65	31	29	-	-	88%	83%

Project:		Architect:	
Location:		Engineer:	
Model #:		Contractor:	
Quantity:		Comments:	
Submitted By:			
Date:			